



CONTRACT DRAWINGS
FOR THE CONSTRUCTION OF

RUNWAY LIGHTS AND SIGNS
IMPROVEMENT PROJECT

LAKE HAVASU CITY MUNICIPAL AIRPORT
LAKE HAVASU CITY, ARIZONA



LAKE HAVASU CITY PROJECT NO.: 104015

FAA NO: TBD


ADOT GRANT NO. TBD

C&S PROJECT: K33.004.009

MARCH 2025

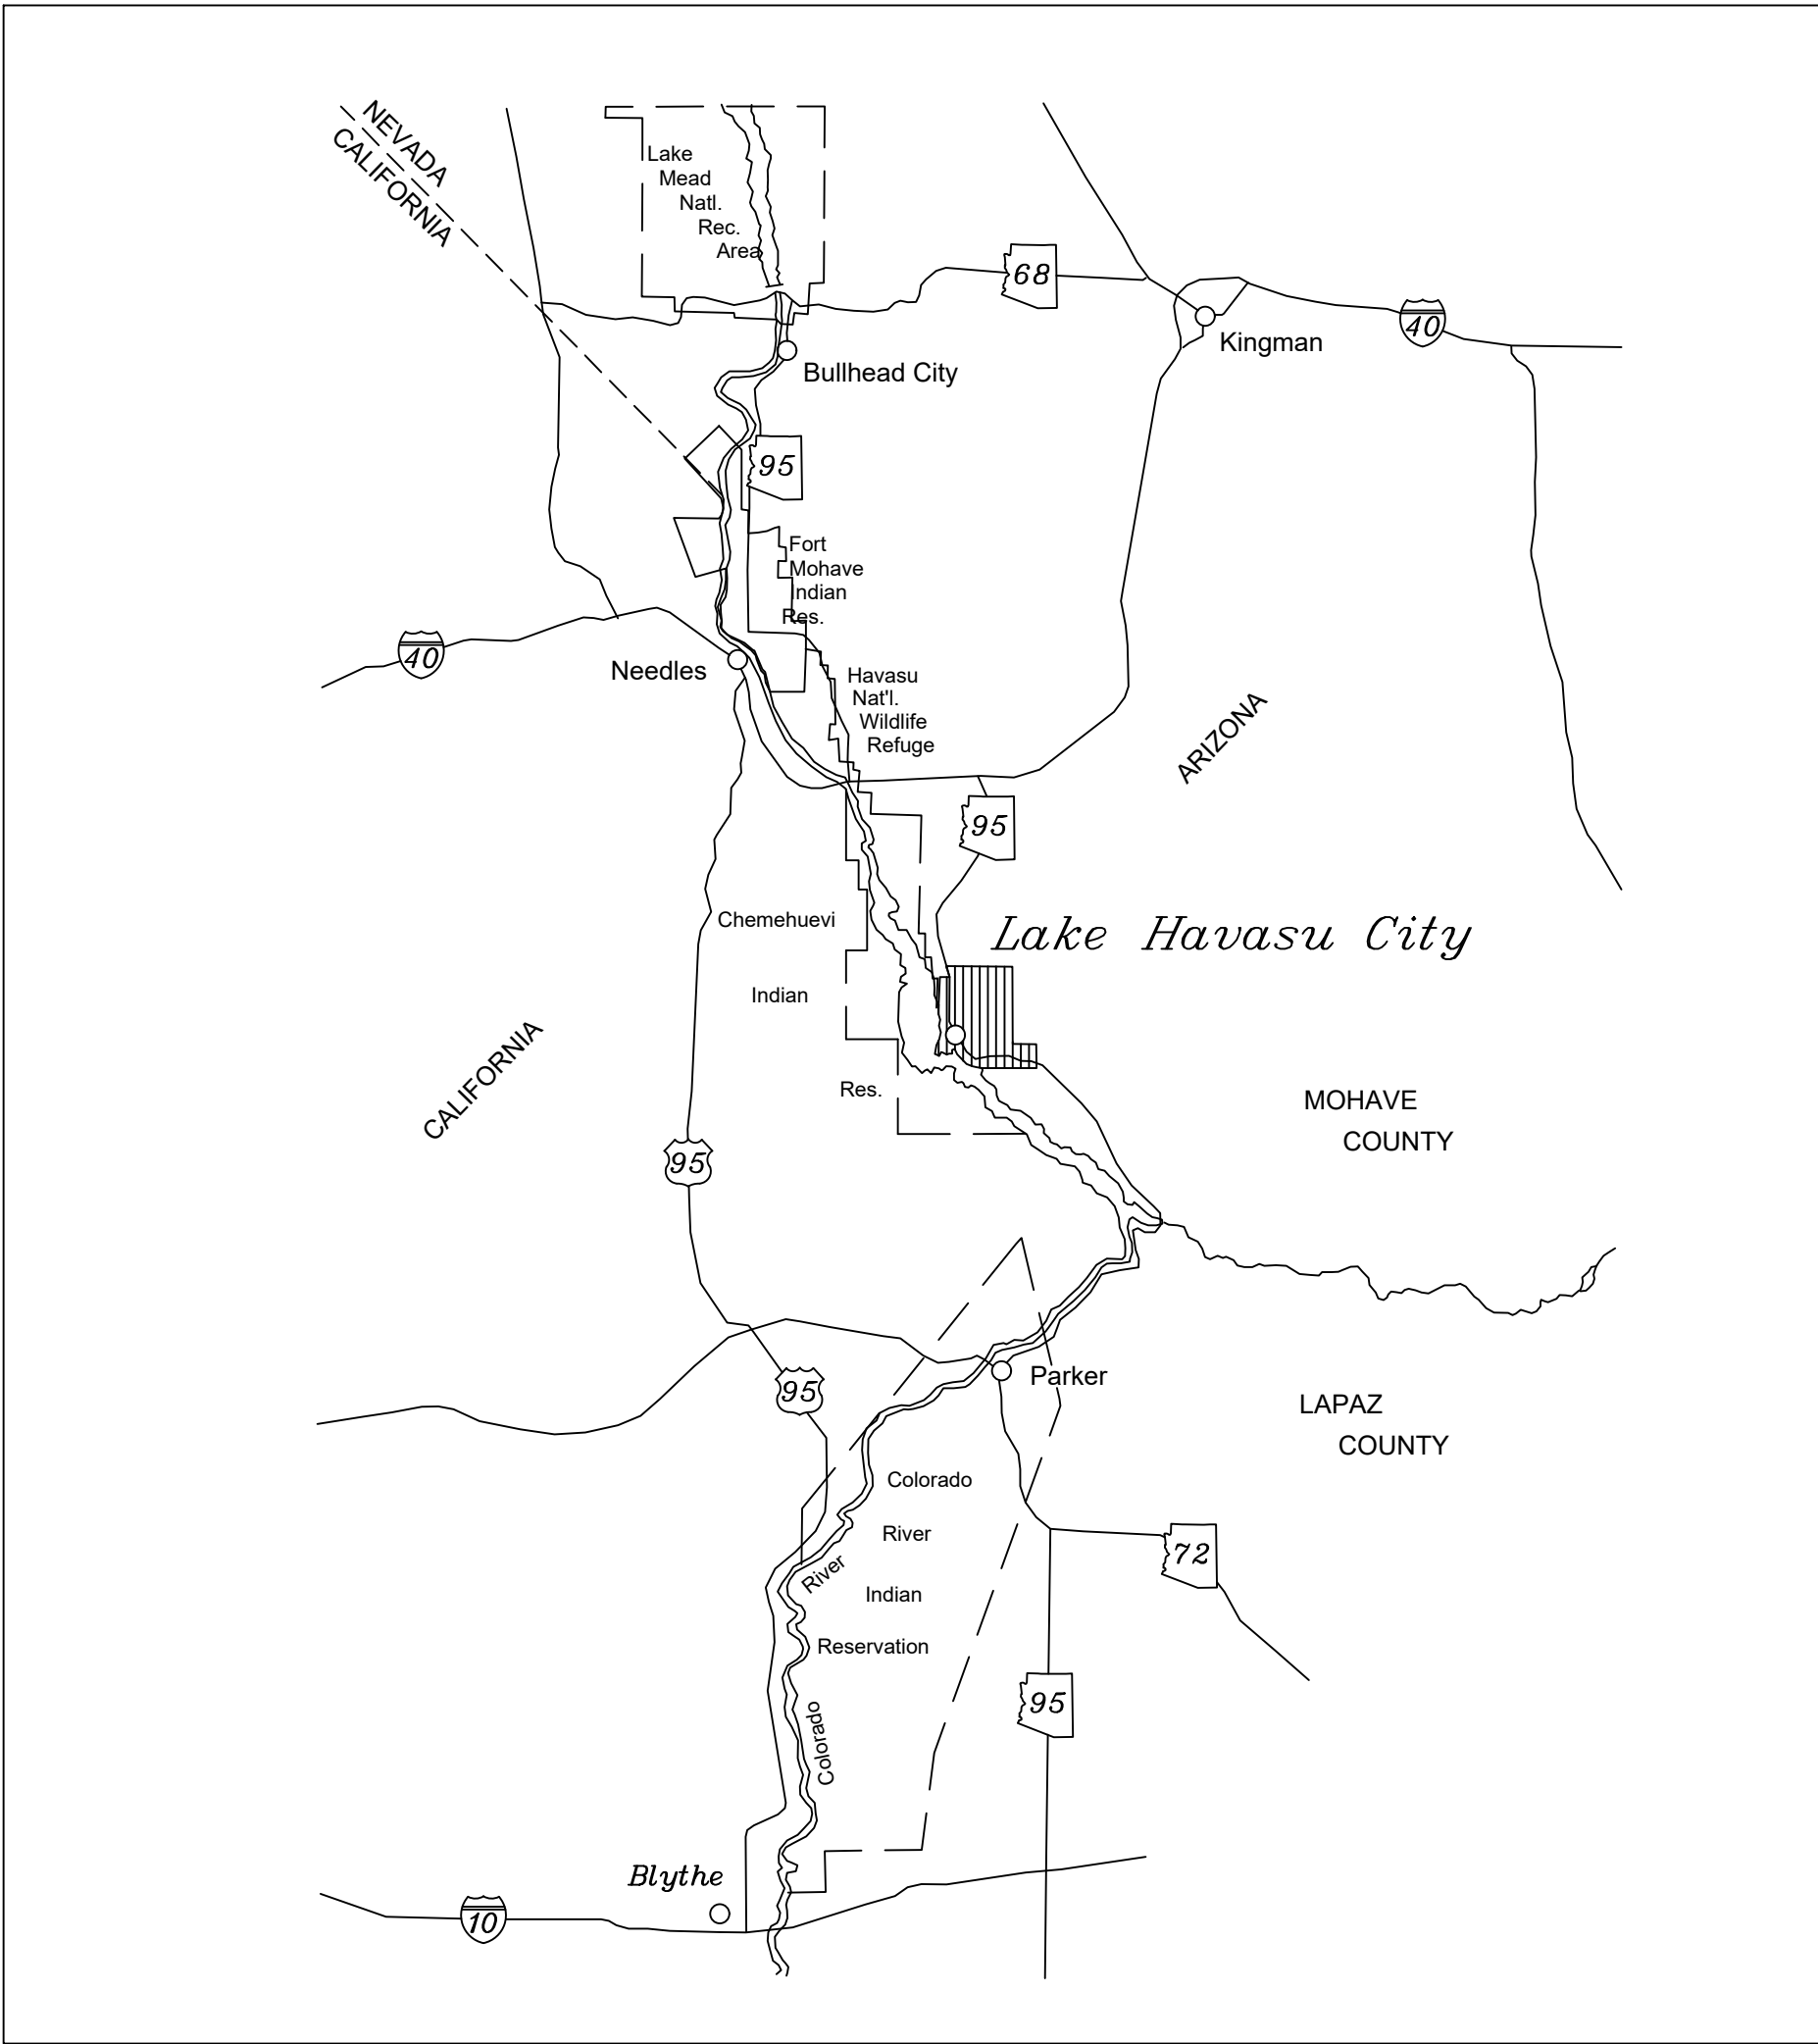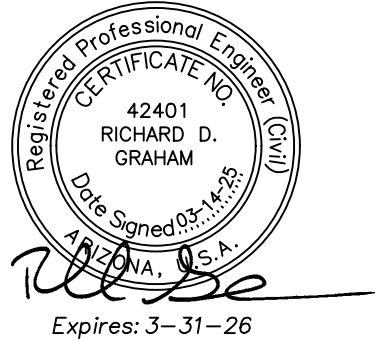

LOCATION MAP

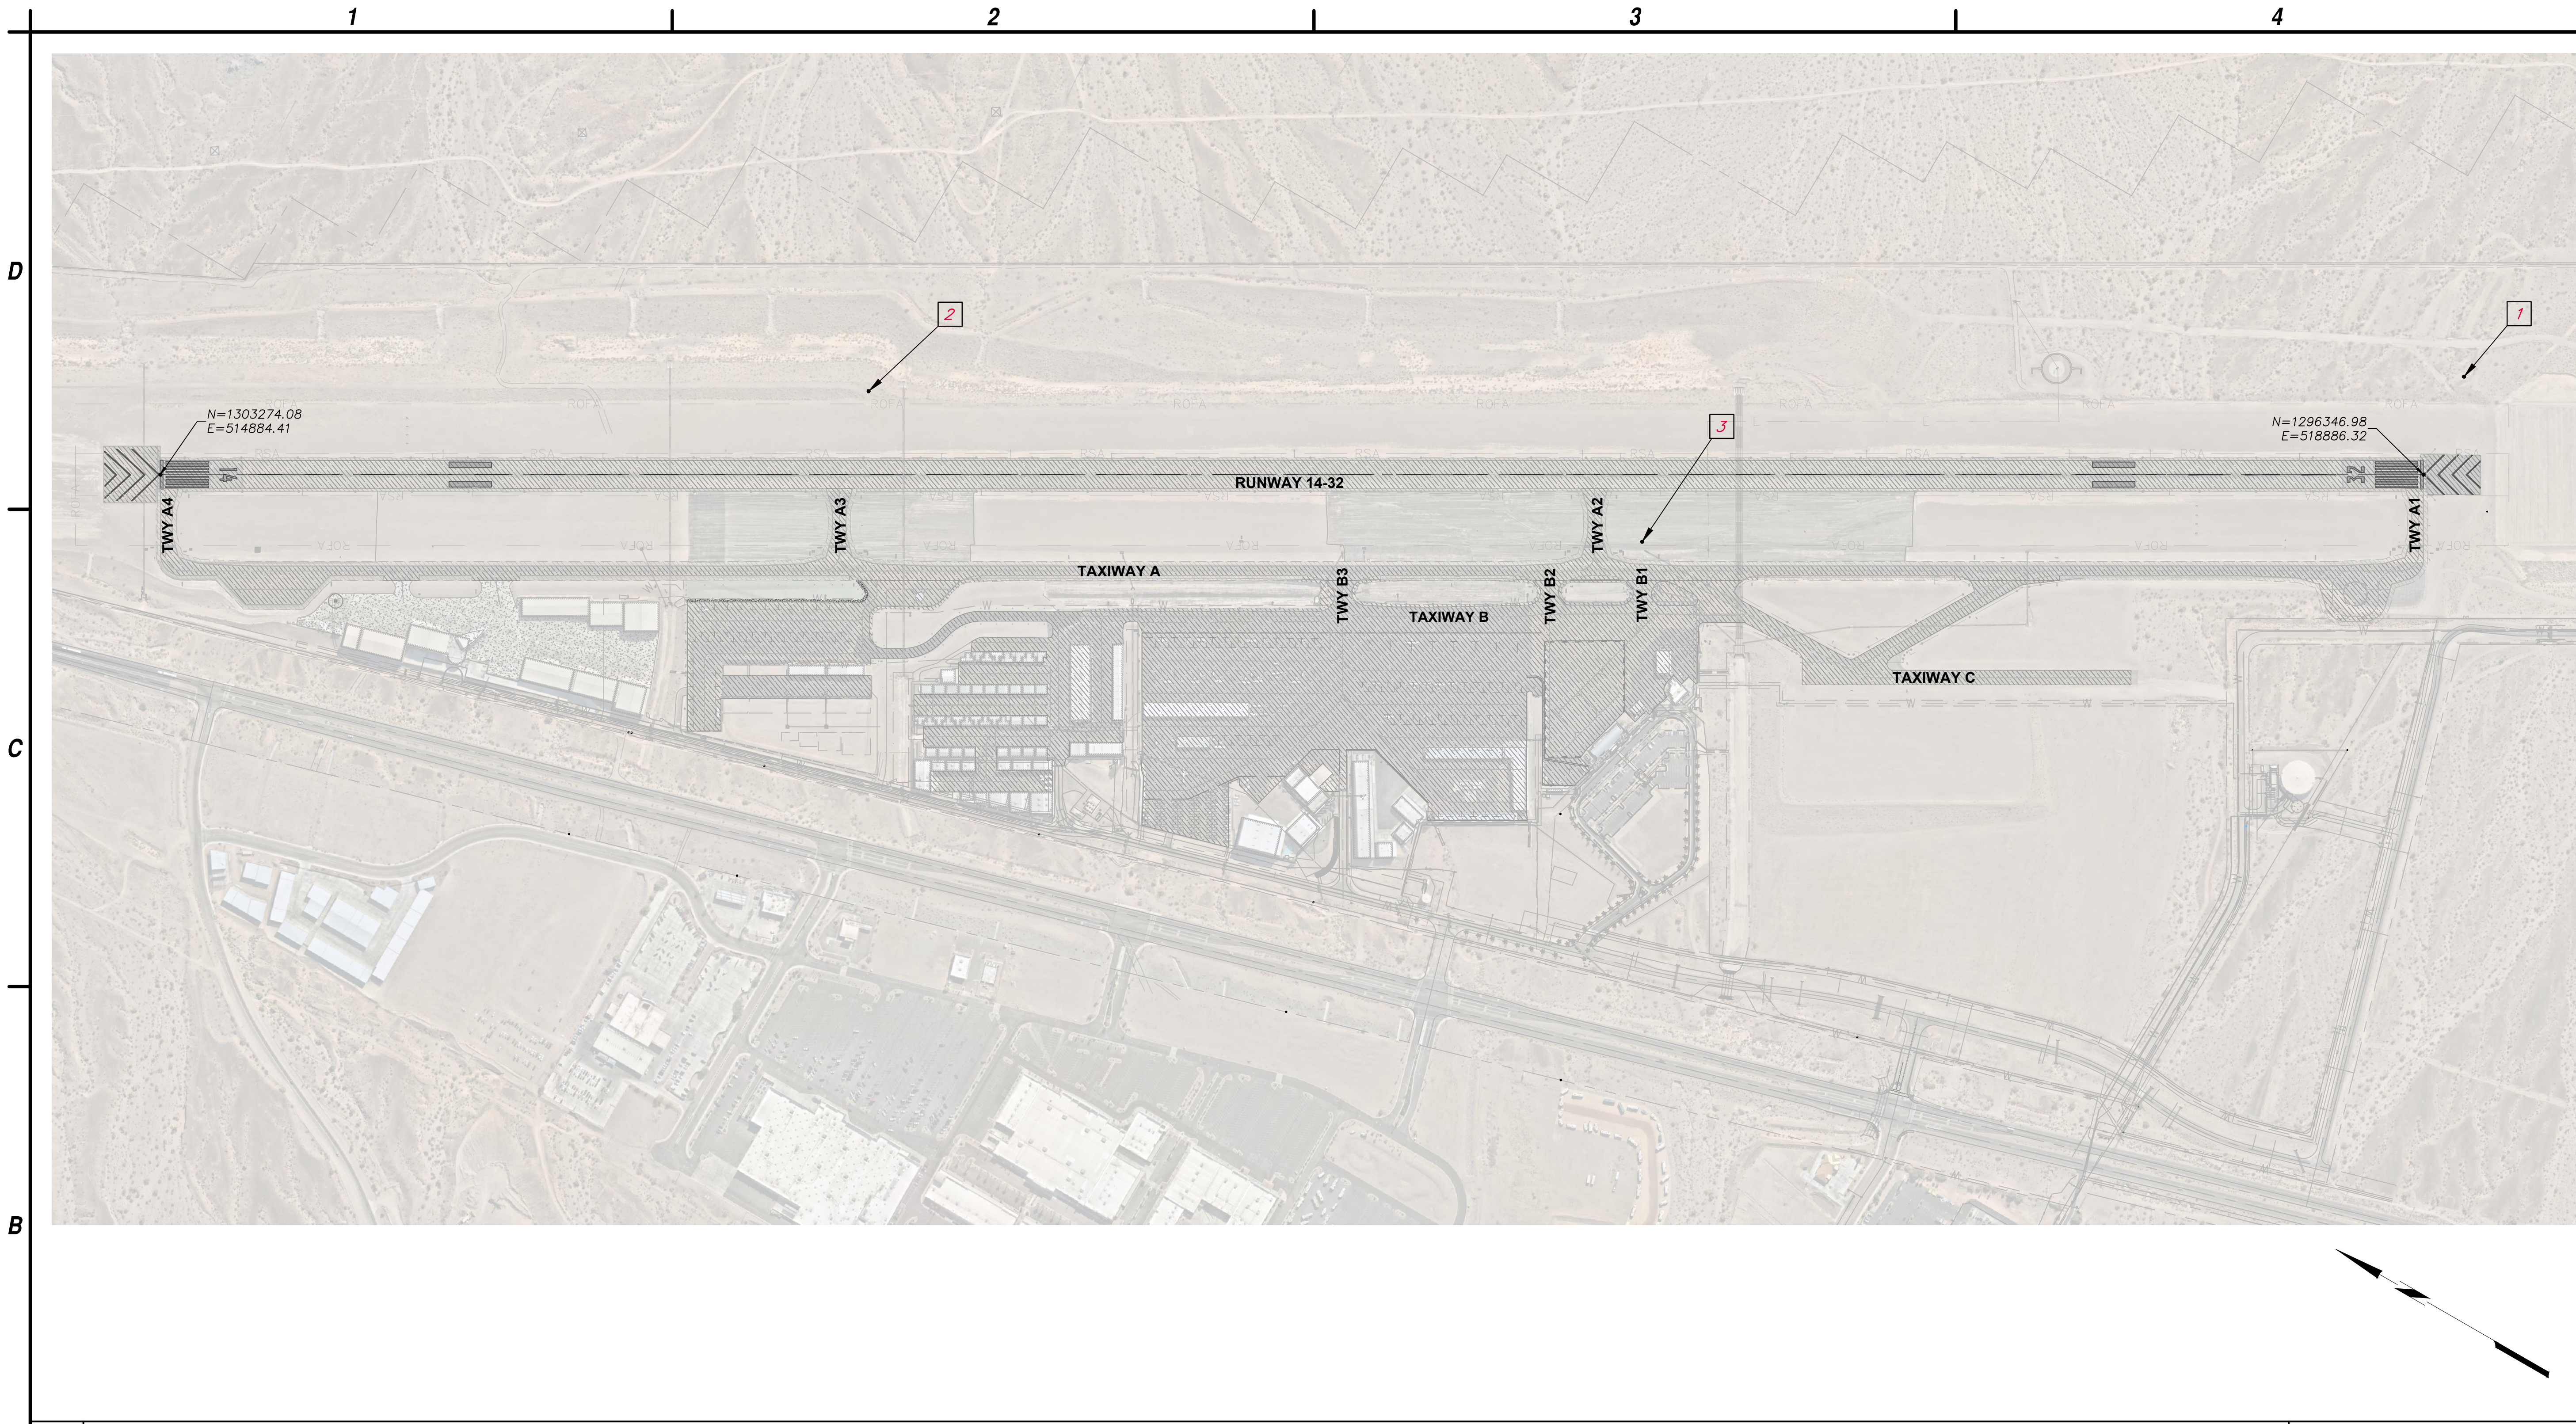

B1 GENERAL PLAN AND SURVEY CONTROL

BASIS OF BEARINGS AND COORDINATES

LINEAR UNIT: INTERNATIONAL FEET
GEODETTIC DATUM: NORTH AMERICAN DATUM OF 1983 (NA2011)
VERTICAL DATUM: NAVD 1988 (SEE BELOW)
SYSTEM: U.S. STATE PLANE OF 1983 (AT GRID)
ZONE: ARIZONA WEST ZONE (0203)
PROJECTION
TRANSVERSE MERCATOR
LATITUDE OF GRID ORIGIN: 31°00'00" N
LONGITUDE OF CENTRAL MERIDIAN: 113°45'00" W
NORTHING AT GRID ORIGIN: 0.000 FT
EASTING AT CENTRAL MERIDIAN: 700,000.000 FT
SCALE FACTOR ON CENTRAL MERIDIAN: 0.9999333333

ALL DISTANCES AND BEARINGS SHOWN HEREON ARE GRID VALUES BASED ON THE PRECEDING PROJECTION DEFINITION.
THE BASIS OF BEARINGS IS TRUE GEODETTIC NORTH AS DETERMINED FROM THE GPS SOLUTION. NOTE THAT THE GRID BEARINGS SHOWN HEREON (OR IMPLIED BY GRID COORDINATES) DO NOT EQUAL GEODETTIC BEARINGS DUE TO MERIDIAN CONVERGENCE.
ORTHOMETRIC HEIGHTS (ELEVATIONS) WERE TRANSFERRED TO THE SITE FROM NGS POINT "HAVASU". THE FIELD SURVEY WAS CONDUCTED USING GPS REFERENCED TO THE FOLLOWING COORDINATES.
POINT "HAVASU" (EU1257)
LATITUDE: N34°33'58.27478"
LONGITUDE: W114°21'41.53094"
ELLIPSOID HEIGHT: 596.027 FT
POINT "HII D" PACS (AC6812)
LATITUDE: N34°34'04.29375"
LONGITUDE: W114°21'24.75967"
ELLIPSOID HEIGHT: 653.547 FT
POINT "HII B" SACS (AC6814)
LATITUDE: N34°34'30.29151"
LONGITUDE: W114°21'35.79711"
ELLIPSOID HEIGHT: 659.905 FT

SURVEY CONTROL POINTS

PT#	NORTHING	EASTING	ELEVATION	DESCRIPTION
1	1296396.18	519257.86	799.34	GVT HII A AC6813
2	1301253.55	516392.41	760.56	GVT HII B AC6814
3	1298619.79	517299.55	754.26	GVT HII D AC6812



A1 BASIS OF BEARINGS AND COORDINATES
NOT TO SCALE

A3 NOT USED
NOT TO SCALE

A4 SURVEY CONTROL POINTS AND LEGEND
NOT TO SCALE



C&S Engineers, Inc.
2575 East Camelback Rd
Suite 740
Phoenix, Arizona 85016
Phone: 602-997-7536
Fax: 602-755-2094
www.cscos.com

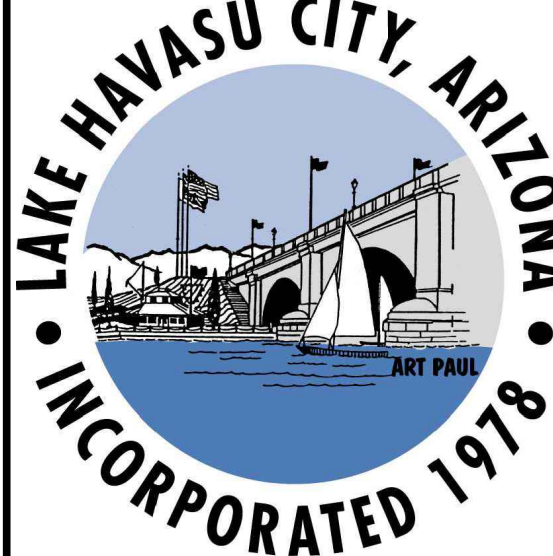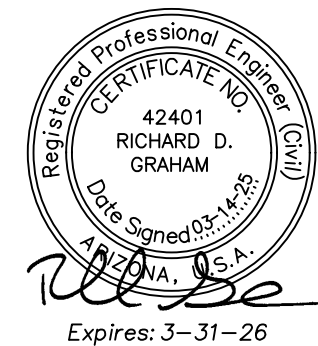


**RUNWAY LIGHTS AND SIGNS
IMPROVEMENT PROJECT**
LAKE HAVASU CITY MUNICIPAL AIRPORT
LAKE HAVASU CITY, AIRIZONA

MARK	DATE	DESCRIPTION
REVISIONS		
PROJECT NO: K33004009		
DATE: MARCH 2025		
DRAWN BY: STB		
DESIGNED BY: AS		
CHECKED BY: RJB		

**GENERAL PLAN
SURVEY AND
CONTROL**

G100

Mar 17, 2025 - 8:46pm
F:\Project\K33 - Lake Havasu City, AZ\K33\004\009 - T.O. 9 - RW Lights and Signs\Design\CADD\Sheet Files\K33004009_03_G100_GEN & SURVEY PLAN.dwg

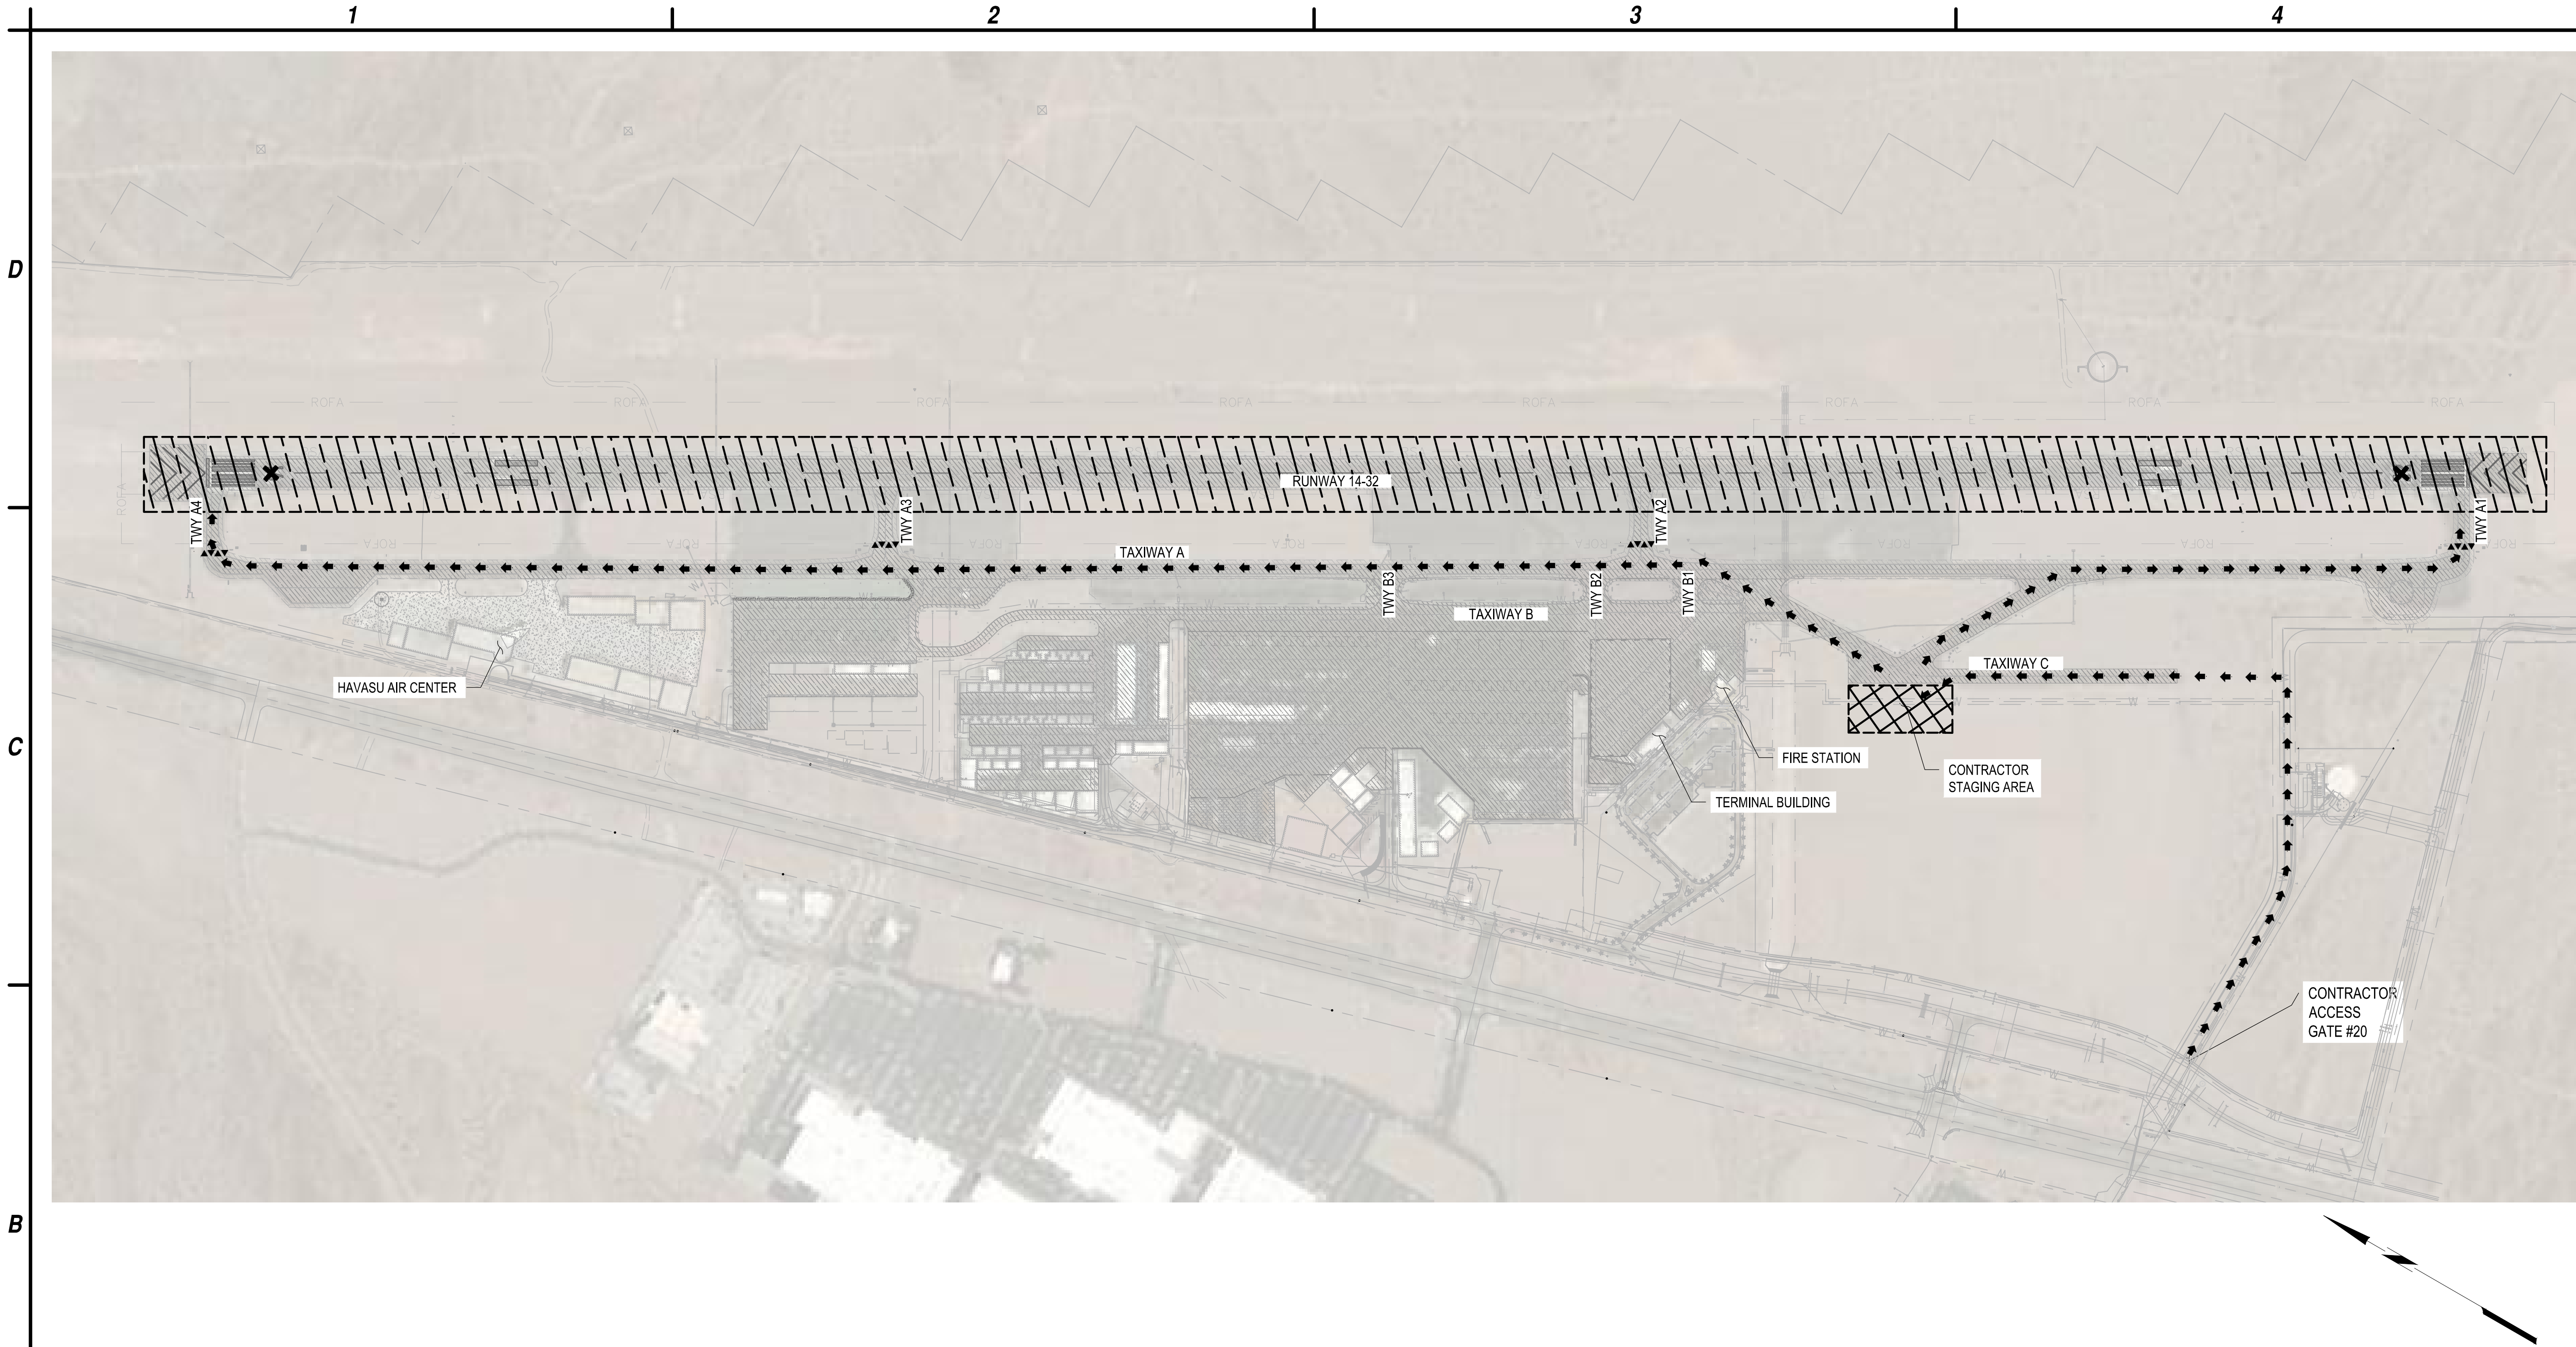

B1 CONSTRUCTION SAFETY AND PHASING PLAN

SCALE: 1" = 300'



A1 INTERLOCKING AIRFIELD BARRICADE DETAIL

SCALE: NOT TO SCALE

BARRICADE NOTES:

1. MAXIMUM SPACING BETWEEN BARRICADES SHALL BE 5 FEET. BARRICADES SHALL BE SET BACK 2 FEET FROM THE LIMITS OF CONSTRUCTION.
2. THE CONTRACTOR SHALL BE RESPONSIBLE FOR MAINTAINING PROPER POSITIONING OF ALL BARRICADES.
3. WATER-FILLED TYPE BARRICADES SHALL BE USED (SEE SPECIFICATIONS)
4. EACH BARRICADE SHALL HAVE TWO FLASHING LAMPS (DUSK TO DAWN).

360° BATTERY/SOLAR POWERED RED FLASHING LAMP (DUSK TO DAWN)

6"X6" WIDE REFLECTIVE STRIPING INTERNATIONAL ORANGE AND WHITE

A2 LIGHTED CLOSED RUNWAY MARKING DETAIL

SCALE: NOT TO SCALE

L-893 LIGHTED CLOSED RUNWAY MARKER AS MANUFACTURED BY HALI-BRITE, INC., SHERWIN INDUSTRIES, INC., OR APPROVED EQUAL. LIGHTED CLOSED RUNWAY MARKING SHALL BE PROVIDED BY CONTRACTOR. THE CONTRACTOR IS ALSO RESPONSIBLE FOR FUELING AND MAINTENANCE REQUIRED DURING CONSTRUCTION.

NOTES:

1. CLOSED RUNWAY MARKINGS SHALL BE PLACED AT EACH END OF THE RUNWAY DIRECTLY OR AS NEAR AS PRACTICABLE TO THE RUNWAY DESIGNATION NUMBERS.

A3 PHASING NOTES

SCALE: NOT TO SCALE

1. WORK AREA A SHALL BE PERFORMED WITHIN 30 CALENDAR DAYS.
2. WORK IN THE WORK AREA SHALL BE NIGHT WORK.

A4 LEGEND

WORK AREA 'A' - RUNWAY 14-32 CLOSED

CONTRACTOR STAGING AREA


LOW PROFILE BARRICADES - SEE DETAIL A1, THIS SHEET

CONTRACTOR ACCESS/HAUL ROUTE

LIGHTED CLOSED RUNWAY MARKING - SEE DETAIL A2, THIS SHEET



C&S Engineers, Inc.
2575 East Camelback Rd
Suite 740
Phoenix, Arizona 85016
Phone: 602-997-7536
Fax: 602-755-2094
www.cscos.com

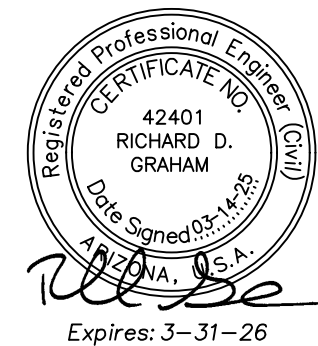

**RUNWAY LIGHTS AND SIGNS
IMPROVEMENT PROJECT**

**LAKE HAVASU CITY MUNICIPAL AIRPORT
LAKE HAVASU CITY, AIRIZONA**

MARK	DATE	DESCRIPTION
REVISIONS		
PROJECT NO: K33004009		
DATE: MARCH 2025		
DRAWN BY: STB		
DESIGNED BY: AS		
CHECKED BY: RJB		

**CONSTRUCTION
SAFETY AND
PHASING PLAN**

GC101

D

C

B

A

SELECTED FAA ADVISORY CIRCULARS FOR AIRPORT PROJECTS (MOST RECENT VERSION):

150/5340-18	STANDARDS FOR AIRPORT SIGN SYSTEMS
150/5340-30	DESIGN & INSTALLATION DETAILS FOR AIRPORT VISUAL AIDS
150/5345-7	SPECIFICATION FOR L-824 UNDERGROUND ELECTRICAL CABLE FOR AIRPORT LIGHTING CIRCUITS
150/5345-26	SPECIFICATION FOR L-823 PLUG AND RECEPTACLE, CABLE CONNECTORS
150/5345-42	SPECIFICATION FOR AIRPORT LIGHT BASES, TRANSFORMER HOUSINGS, JUNCTION BOXES, AND ACCESSORIES
150/5345-46	SPECIFICATION OF RUNWAY AND TAXIWAY LIGHT FIXTURES
150/5345-47	SPECIFICATION FOR SERIES TO SERIES ISOLATION TRANSFORMERS FOR AIRPORT LIGHTING SYSTEMS
150/5345-53	AIRPORT LIGHTING EQUIPMENT CERTIFICATION PROGRAM
150/5370-2	OPERATIONAL SAFETY ON AIRPORTS DURING CONSTRUCTION
150/5370-10	STANDARDS FOR SPECIFYING CONSTRUCTION OF AIRPORTS

ELECTRICAL LEGEND:
(UNLESS OTHERWISE NOTED ON PLANS)

	EXISTING ELECTRICAL CONDUIT AND CONDUCTOR		
	PVC W/#8-5KV L-824 TYPE "C" CABLE PER INDICATED LIGHTING CIRCUIT. (QUANTITY AND SIZE AS INDICATED ON PLAN SHEETS) (/ - INDICATES NUMBER OF CONDUCTORS)		
	SPLICE POINT OF EXISTING AND NEW CONDUIT AND COUNTERPOISE		
	EXISTING TAXIWAY EDGE LIGHT		NEW L-861(L) LED ELEVATED RUNWAY EDGE LIGHT ON EXISTING L-867 BASE CAN
	EXISTING RUNWAY EDGE LIGHT		NEW L-861(L) LED (YELLOW/WHITE) ELEVATED RUNWAY EDGE LIGHT ON EXISTING L-867 BASE CAN
	EXISTING RUNWAY END LIGHT		NEW L-858B(L) LED SIZE 5 RUNWAY DISTANCE REMAINING SIGN AND ISOLATION TRANSFORMER. (MOUNTED ON EXISTING OR NEW SIGN BASE AS INDICATED ON PLAN SHEETS).
	EXISTING AIRFIELD GUIDANCE SIGN		NEW L-849(L) LED REIL UNIT ON EXISTING CONCRETE FOUNDATION
	EXISTING HANDHOLE		
	EXISTING RETROREFLECTIVE MARKER		NEW ELEVATED LED L-861E(L) RUNWAY THRESHOLD/END LIGHT AND ISOLATION TRANSFORMER ON EXISTING L-867 BASE CAN.

ELECTRICAL ABBREVIATIONS:

1/C	SINGLE CONDUCTOR
2/C	TWO CONDUCTORS
BCC	BARE COPPER CONDUCTOR (GROUND)
CCR	CONSTANT CURRENT REGULATOR
CE	CONCRETE ENCASED
CKT	CIRCUIT
DIA	DIAMETER
EA	EACH
FAA	FEDERAL AVIATION ADMINISTRATION
GND	GROUND
LED	LIGHT EMITTING DIODE
LF	LINEAR FEET
NPI	NON-PAY ITEM
PVC	POLY-VINYL CHLORIDE
RDR	RUNWAY DISTANCE REMAINING
REIL	RUNWAY END IDENTIFIER LIGHT
RWY	RUNWAY
SE	SLURRY ENCASED
SGN	SIGN
TXY	TAXIWAY
TYP	TYPICAL



SHEET INDEX:

E-001	ELECTRICAL LEGEND
E-002	ELECTRICAL NOTES
ED-101 - ED-109	AIRFIELD ELECTRICAL DEMOLITION PLANS
EA-201 - EA-209	AIRFIELD ELECTRICAL PLANS
EA-301	RUNWAY DISTANCE REMAINING SIGN SCHEDULE
EA-401	DUCTBANK DETAILS
EA-402	GROUNDING DETAILS
EA-403	5KV CABLE SPLICE AND EDGE LIGHT DETAILS
EA-404	RUNWAY END IDENTIFIER LIGHT (REIL) DETAILS
EA-501	AIRFIELD LIGHTING VAULT EQUIPMENT MODIFICATIONS
EA-502	AIRFIELD LIGHTING VAULT PANEL SCHEDULES

Mar 17, 2025 - 4:37pm
Q:\PROJECTS\24000\240116 Lake Havasu Airport_MIRLS, REILS, RDRe\CAD\CAD SHEETS\240116 E-001 Electrical Legend.dwg



C&S Engineers, Inc.

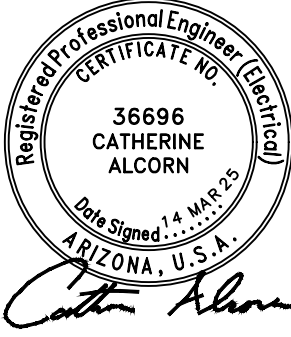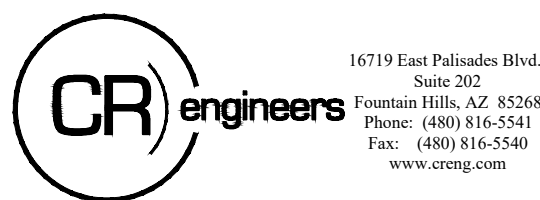

RUNWAY LIGHTS AND SIGNS
IMPROVEMENT PROJECT
LAKE HAVASU CITY MUNICIPAL AIRPORT
LAKE HAVASU CITY, AIRIZONA

MARK	DATE	DESCRIPTION
REVISIONS		
PROJECT NO: K33004009		
DATE: MARCH 2025		
DRAWN BY: JBW		
DESIGNED BY: SW		
CHECKED BY: CA		

ELECTRICAL
LEGEND

E-001

D

C

B

A

GENERAL ELECTRICAL REQUIREMENTS

- THE COMPLETED INSTALLATION SHALL CONFORM TO ALL APPLICABLE FEDERAL, STATE AND LOCAL CODES, ORDINANCES, AND REGULATIONS. CONTRACTOR SHALL OBTAIN NECESSARY PERMITS AND INSPECTIONS REQUIRED BY THE AUTHORITIES HAVING JURISDICTION. ALL WORK SHALL BE DONE IN A NEAT, WORKMANLIKE, FINISHED, AND SAFE MANNER, ACCORDING TO THE LATEST PUBLISHED N.E.C.A. STANDARDS OF INSTALLATION, UNDER COMPETENT SUPERVISION. INSTALL GROUNDING AS REQUIRED BY THE CODE(S) AND FAA ADVISORY CIRCULAR REQUIREMENTS AND DETAILED PER THIS PLAN SET. THE CONTRACTOR SHALL BE OSHA 10 AND NFPA 70E TRAINED.
- ALL MATERIALS SHALL BE NEW AND MANUFACTURED IN ACCORDANCE WITH NEMA, ANSI, U.L. OR OTHER APPLICABLE STANDARDS AND FAA CERTIFIED PER AC150/5345-53. THE USE OF MANUFACTURER'S NAMES, MODELS, AND NUMBERS IS INTENDED TO ESTABLISH STYLE, QUALITY, APPEARANCE, USEFULNESS, AND BID PRICE. PROPOSED SUBSTITUTIONS SHALL BE SUBMITTED IN WRITING AND REVIEWED BY THE ENGINEER BEFORE ORDERING.
- PROTECT ALL ELECTRICAL MATERIAL AND EQUIPMENT INSTALLED UNDER THIS DIVISION AGAINST DAMAGE BY OTHER TRADES, WEATHER CONDITIONS OR ANY OTHER CAUSES. EQUIPMENT FOUND DAMAGED OR IN OTHER THAN NEW CONDITION WILL BE REJECTED AS DEFECTIVE.
- LEAVE THE SITE CLEAN, REMOVE ALL DEBRIS, EMPTY CARTONS, TOOLS, CONDUIT, WIRE SCRAPS AND ALL MISCELLANEOUS SPARE EQUIPMENT AND MATERIALS USED IN THE WORK DURING CONSTRUCTION. ALL COMPONENTS SHALL BE FREE OF DUST, GRIT AND FOREIGN MATERIALS, LEFT AS NEW BEFORE FINAL ACCEPTANCE OF WORK.
- EXPOSED CONDUITS TO BE GALVANIZED RIGID STEEL, MINIMUM SIZE 3/4", UNLESS OTHERWISE NOTED ON THE PLANS.
- ALL SAFETY SWITCHES AND OTHER DISTRIBUTION AND CONTROL ELECTRICAL EQUIPMENT SHALL BE U.L. LISTED AND RATED FOR HEAVY DUTY SERVICE.
- ALL WIRING DEVICES SHALL BE SPECIFICATION GRADE.
- ALL ELECTRICAL EQUIPMENT, CONDUIT, WIRING, BOXES, ETC. SHALL BE SUBMITTED TO THE ENGINEER FOR REVIEW PRIOR TO ORDERING. THE SUBMITTALS SHALL BE NEATLY GROUPED AND ORGANIZED. PERTINENT INFORMATION SHALL BE HIGHLIGHTED, AND THE SPECIFIC PRODUCT SHALL BE IDENTIFIED. ALL SUBMITTALS SHALL BE COMPLETE, AND PRESENTED IN ONE PACKAGE. THE SUBMITTAL SHALL INCLUDE A COMPLETE LIST OF THE EQUIPMENT AND MATERIALS, INCLUDING THE MANUFACTURER'S NAME, PRODUCT SPECIFICATION, DESCRIPTIVE DATA, TECHNICAL LITERATURE, PERFORMANCE CHARTS, CATALOG CUTS, INSTALLATION INSTRUCTIONS, AND SPARE PART RECOMMENDATIONS FOR EACH DIFFERENT ITEM OF THE EQUIPMENT SPECIFIED.
- CONDUIT/CONDUCTOR RUNS SHOWN ARE DIAGRAMMATICAL ONLY. THE BEST FINAL CONDUIT ROUTING SHALL BE AS DETERMINED BY THE ELECTRICAL CONTRACTOR AT THE TIME OF CONSTRUCTION. THE CITY INSPECTOR AND AIRPORT REPRESENTATIVE MUST FIELD REVIEW CONTRACTOR'S PROPOSED CONDUIT ROUTING AND HANDHOLE LOCATIONS PRIOR TO ANY SAW CUTTING OR EXCAVATIONS.
- IT IS THE OBLIGATION OF THE CONTRACTOR TO ORGANIZE HIS WORK, SO THAT A COMPLETE ELECTRICAL, INSTRUMENTATION, AND CONTROL SYSTEM FOR THE FACILITY WILL BE PROVIDED, AND WILL BE SUPPORTED BY ACCURATE SHOP AND RECORD DRAWINGS, AND O & M MANUALS.
- CONTRACTOR SHALL COORDINATE WITH AIRPORT FOR LOCK-OUT/TAG-OUT OF ALL ELECTRICAL AIRFIELD CIRCUITS AFFECTED BY CONSTRUCTION. ALL AFFECTED CIRCUITS MUST BE OPERATIONAL PRIOR TO END OF EACH SHIFT.
- CONTRACTOR SHALL COMPLY WITH REQUIREMENTS FOR CONFINED SPACE PROGRAM IN ACCORDANCE WITH OSHA REGULATION STANDARDS - 29 CFR, PART 1910.146.
- PRIOR TO PERFORMING UNDERGROUND EXCAVATION, THE CONTRACTOR SHALL NOTIFY SAFFORD AIRPORT STAFF AND THE BLUE STAKE CENTER TO OBTAIN FIELD UNDERGROUND UTILITIES LOCATION MARKING. THE CONTRACTOR SHALL UNCOVER, AHEAD OF CONSTRUCTION, ALL LINES BEING TIED INTO AND ALL INTERSECTING ELECTRICAL LINES AND UTILITIES AS SHOWN ON THE PLANS OR MARKED BY BLUE STAKE TO VERIFY THEIR LOCATION AND DEPTH. CONTRACTOR SHALL ASSUME THAT ALL EXISTING DUCTBANKS THAT CROSS EXISTING AIRFIELD PAVEMENTS OR ARE WITHIN RUNWAY OR TAXIWAY SAFETY AREAS ARE ENCASED. UTILITY SERVICES AND ALL EXISTING ELECTRICAL LINES SHALL BE LOCATED AND PROTECTED BY THE CONTRACTOR. COORDINATE WITH ENGINEER AND/OR APPROPRIATE UTILITY COMPANY. ALL PRECAUTIONS SHALL BE USED WHILE WORKING NEAR ALL UTILITIES, TO AVOID INJURY OR DEATH TO PERSONNEL, PROPERTY DAMAGE AND/OR INTERRUPTION OF SERVICE.
- CONTRACTOR SHALL VACUUM TO REMOVE EXCESS WATER FROM EXISTING HANDHOLES AND BASE CANS PRIOR TO INSTALLATION OF NEW CABLE (NPI).
- GROUND RODS AND COUNTERPOISE WIRE ARE CONSIDERED INCIDENTAL TO FIXTURE AND CONDUIT INSTALLATION.
- ELECTRICAL CONTRACTOR SHALL COORDINATE ALL DEMOLITION AND CONSTRUCTION WORK WITH THE CIVIL CONTRACTOR TO REDUCE CONFLICTS THAT WILL AFFECT CONSTRUCTION PHASING AND SCHEDULING.
- ELECTRICAL CONTRACTOR SHALL FIELD VERIFY ALL HANDHOLE STATIONS AND OFFSETS AND CONFIRM LOCATIONS ARE WITHIN SPECIFICATION TOLERANCES.
- CONSTRUCTION TRAFFIC SHALL YIELD TO AIRCRAFT TRAFFIC AT ALL TIMES.
- TRENCHES WITHIN RUNWAY AND TAXIWAY SAFETY AREAS SHALL BE RESTORED TO SAFETY AREA REQUIREMENTS AND READY FOR SAFFORD AIRPORT OPERATIONS INSPECTION 15 MINUTES BEFORE RE-OPENED TO TRAFFIC. OPEN TRENCHES ARE NOT PERMITTED IN OPERATIONAL AREAS. TRENCHES SHALL BE BACKFILLED TO GRADE WITH NO LIPS OR DIPS THAT EXCEED 2".
- CONTRACTOR SHALL MINIMIZE TRACKING OF FOREIGN OBJECT DEBRIS (FOD) ONTO PAVEMENT. ALL MUD AND DEBRIS SHALL BE REMOVED AT CONTRACTOR'S EXPENSE PRIOR TO SHIFT END.

ELECTRICAL GENERAL NOTES

- GROUND RODS AND COUNTERPOISE WIRE ARE CONSIDERED INCIDENTAL TO FIXTURE AND CONDUIT INSTALLATION.
- ELECTRICAL CONTRACTOR SHALL COORDINATE ALL DEMOLITION AND CONSTRUCTION WITH CIVIL CONTRACTOR TO REDUCE CONFLICTS THAT AFFECT CONSTRUCTION PHASING AND SCHEDULING.
- CONTRACTOR SHALL FIELD VERIFY ALL FIXTURE STATION AND OFFSETS AND CONFIRM ALL LOCATIONS ARE WITHIN SPECIFICATION TOLERANCES.

ELECTRICAL CONSTRUCTION PHASING NOTES

- CONTRACTOR SHALL COORDINATE ALL WORK WITH AIRPORT MAINTENANCE, AIRPORT OPERATIONS, AND THE ENGINEER AS NECESSARY.
- CONTRACTOR SHALL GIVE 72 HOURS NOTICE PRIOR TO WORKING ON OR AROUND ANY DUCTBANKS, HANDHOLES, ETC.
- CONTRACTOR SHALL MAINTAIN OR HAVE SUFFICIENT MATERIAL/ EQUIPMENT REQUIRED TO PROVIDE TEMPORARY LIGHTING AND CIRCUIT EXTENSIONS. THIS INCLUDES, BUT IS NOT LIMITED TO FIXTURES, TRANSFORMERS, BASES, CONDUIT, L-824 CABLE & L-823 SPLICE KITS. THESE ITEMS WILL NOT BE AVAILABLE FROM THE AIRPORT MAINTENANCE SHOP.
- THE CONTRACTOR SHALL MAINTAIN QUALIFIED PERSONNEL WITH THE APPROPRIATE EQUIPMENT, FOR THE INSTALLATION AND SPLICING OF AIRFIELD LIGHTING. SUCH PERSONNEL SHALL BE CAPABLE OF 60 MINUTE RESPONSE TIME IF THEY ARE NOT ALREADY PRESENT ON THE AIRFIELD.
- TURN OFF AND COVER EXISTING SIGNAGE THAT MAY POTENTIALLY MISDIRECT AIRCRAFT MOVEMENT INTO CLOSED AREAS BARRICADED FOR CONSTRUCTION. SIGNAGE REQUIRING PARTIAL COVERAGE WITH TAXIWAY LOCATION PANELS REMAINING VISIBLE SHALL REMAIN ON WITH ONLY DIRECTIONAL PORTIONS COVERED WITH SECTIONS OF DARK COLORED TARP OR DOUBLE-LAYERED BURLAP THAT DOES NOT PERMIT VISIBILITY OF COVERED PORTION OF ARRAY DAY OR NIGHT. COVERS SHALL BE SECURELY HELD IN PLACE BY RATCHETING LASHING STRAPS, NO TAPE OR ADHESIVES WILL BE PERMITTED.
- COVER EXISTING ELEVATED EDGE LIGHT FIXTURES IN CLOSED AREA BARRICADED FOR CONSTRUCTION WITH 4" PVC PIPE. COVER SHALL EXTEND 2" MIN. ABOVE TOP OF FIXTURE.
- PROVIDE ANY TEMPORARY AIRFIELD CIRCUIT JUMPERS REQUIRED TO MAINTAIN OPERATION OF ALL CIRCUITS AFFECTED BY CONSTRUCTION PRIOR TO START OF DEMOLITION. TEMPORARY CIRCUIT JUMPERS SHALL BE SLEEVED IN 2" CONDUIT, SANDBAGGED OR SECURED TO LOW-LEVEL BARRICADES. TEMPORARY CIRCUIT JUMPERS MAY BE ROUTED THROUGH NEW TAXIWAY CROSSINGS OR EXISTING SPARE CONDUITS AS REQUIRED AND SHALL BE COMPLETELY REMOVED WHEN NO LONGER REQUIRED FOR OPERATION. TEMPORARY JUMPER PLACEMENT SHALL NOT AFFECT AIRCRAFT MOVEMENT OR AIRPORT OPERATIONS.
- UNCOVER SIGNS AND EDGE LIGHT FIXTURES, REMOVE TEMPORARY JUMPERS, AND VERIFY OPERATION AT THE END OF PROJECT.

ELECTRICAL DEMOLITION GENERAL NOTES:

- WITHIN AREAS OF DEMOLITION, AND AS OTHERWISE SHOWN, CAREFULLY REMOVE IDENTIFIED LIGHT FIXTURES, BASES, ISOLATION TRANSFORMERS, HAND HOLES AND OTHER INDICATED ITEMS.
- CABLE REMOVAL**
A. DIRECT BURIAL: REMOVE FROM WITHIN MANHOLES AND HANDHOLES AND REMOVE IN AREAS WHERE EXCAVATION REQUIRES DISTURBING.
B. IN CONDUIT: REMOVE COMPLETELY BETWEEN NEAREST BASES, HANDHOLES OR MANHOLES.
C. RUNWAYS: REMOVE AND REPLACE FOR RECONNECTION INCREMENTALLY DURING EACH SHIFT TO MAINTAIN CIRCUIT OPERATION AS REQUIRED BY AIRPORT.
- AT INDICATED DEVICES TO BE REMOVED OR IN DEMOLITION AREAS INDICATED, REMOVE ALL CONDUCTORS BACK TO NEAREST FIXTURE BASE OR HANDHOLE OUTSIDE DEMOLITION AREA.
- FIXTURES, CABLES, CONDUITS, DUCTS, ETC. WHICH ARE NOT SPECIFICALLY INDICATED TO BE REMOVED (OR WHICH ARE SHOWN TO REMAIN WITHIN AREAS OF GENERAL DEMOLITION) SHALL REMAIN IN-PLACE AND FUNCTIONAL.
- CONTRACTOR SHALL VERIFY EQUIPMENT AND CABLE DESIGNATIONS AND STATUS PRIOR TO REMOVAL OR DISCONNECTING.
- ALL REMOVED LIGHT FIXTURES, BASES, ISOLATION TRANSFORMERS, AND SIGNS SHALL BE SALVAGED AND DELIVERED TO LAKE HAVASU CITY MUNICIPAL AIRPORT OPERATIONS AND MAINTENANCE. ALL OTHER REMOVED MATERIAL SHALL BECOME THE PROPERTY OF THE CONTRACTOR AND SHALL BE REMOVED FROM THE SITE AND PROPERLY DISPOSED OF IN ACCORDANCE WITH LOCAL ORDINANCES.
- DRAWINGS MAY NOT DETAIL ALL EXISTING FACILITIES IN AREAS OF DEMOLITION. CONTRACTOR SHALL REVIEW THE SITE AND RECORD DRAWINGS TO VERIFY THE DEMOLITION EFFORT INVOLVED.
- CONTRACTOR SHALL BE REQUIRED TO HAVE A PRIVATE "ON-SITE" UTILITY LOCATING COMPANY AND POTHOLE EXISTING UTILITY LINES AS NEEDED.

AIRFIELD LIGHT LOCKOUT/TAGOUT POLICY

THE PURPOSE OF THIS POLICY IS TO STANDARDIZE THE LOCKOUT/TAGOUT PROCEDURES BETWEEN ELECTRICAL CONTRACTORS AND LAKE HAVASU MUNICIPAL AIRPORT OPERATIONS.

- CONTRACTOR SHALL COORDINATE WITH LAKE HAVASU MUNICIPAL AIRPORT PRIOR TO A LOCK-OUT/TAG-OUT REQUEST.
- LAKE HAVASU MUNICIPAL AIRPORT WILL ASSIST CONTRACTOR TO TURN OFF THE CLOSED RUNWAYS/TAXIWAYS.
- THE CONTRACTOR WILL SUPPLY AN APPROVED BREAKER-LOCKING DEVICE AND LOCK, THEN LOCK OFF THE INDIVIDUAL BREAKERS FOR THE CIRCUITS TO BE LOCKED OUT. THESE ITEMS WILL REMAIN IN THE VAULTS IN A LOCK BOX PROVIDED BY LAKE HAVASU MUNICIPAL AIRPORT ELECTRICAL SECTION.
- THE S-1 CUTOUTS WILL BE PULLED, LOCKED AND PLACED ON THE CORRESPONDING REGULATOR BY THE ELECTRICAL CONTRACTOR.
- THE ELECTRICAL CONTRACTOR MUST FILL OUT LOCK-OUT FORMS BEFORE LEAVING THE VAULT.
- UPON COMPLETION OF THE LOCKOUT, THE CONTRACTOR WILL REMOVE ALL LOCKS AND INSTALL THE S-1 CUTOUTS. ALL CIRCUITS MUST BE VERIFIED OPERATIONAL IN THE MANUAL MODE ON THE REGULATOR. THE CONTRACTOR SHALL PERFORM A COMPLETE CHECK OF THE LIGHTS IN THE FIELD, TO VERIFY ACTUAL OPERATION.
- WHEN TESTING HAS BEEN COMPLETED, THE CONTRACTOR SHALL NOTIFY LAKE HAVASU MUNICIPAL AIRPORT WHEN LOCK-IN IS COMPLETE AND REGULATORS ARE IN REMOTE CONTROL.
- COMPLETE LOCK-OUT/LOCK-IN FORMS.

THIS PROCEDURAL CHECKLIST MUST BE FOLLOWED TO THE LETTER

D



C

B

A



C&S Engineers, Inc.

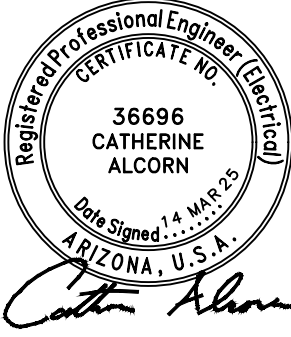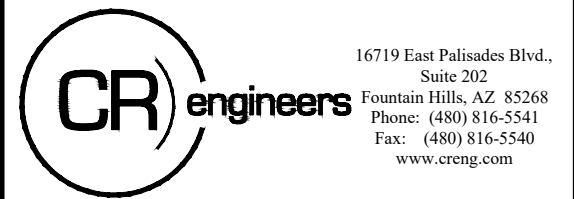

RUNWAY LIGHTS AND SIGNS
IMPROVEMENT PROJECT


LAKE HAVASU CITY MUNICIPAL AIRPORT
LAKE HAVASU CITY, AIRIZONA

MARK	DATE	DESCRIPTION
REVISIONS		
PROJECT NO: K33004009		
DATE: MARCH 2025		
DRAWN BY: JBW		
DESIGNED BY: SW		
CHECKED BY: CA		

ELECTRICAL
NOTES

E-002
6 of 31

Mar 17, 2025 - 4:37pm
Q:\PROJECTS\24000\24016 Lake Havasu Airport - MILLS, RELS, RDns\CAD\CAD SHEETS\24016 E-002 Electrical Notes.dwg

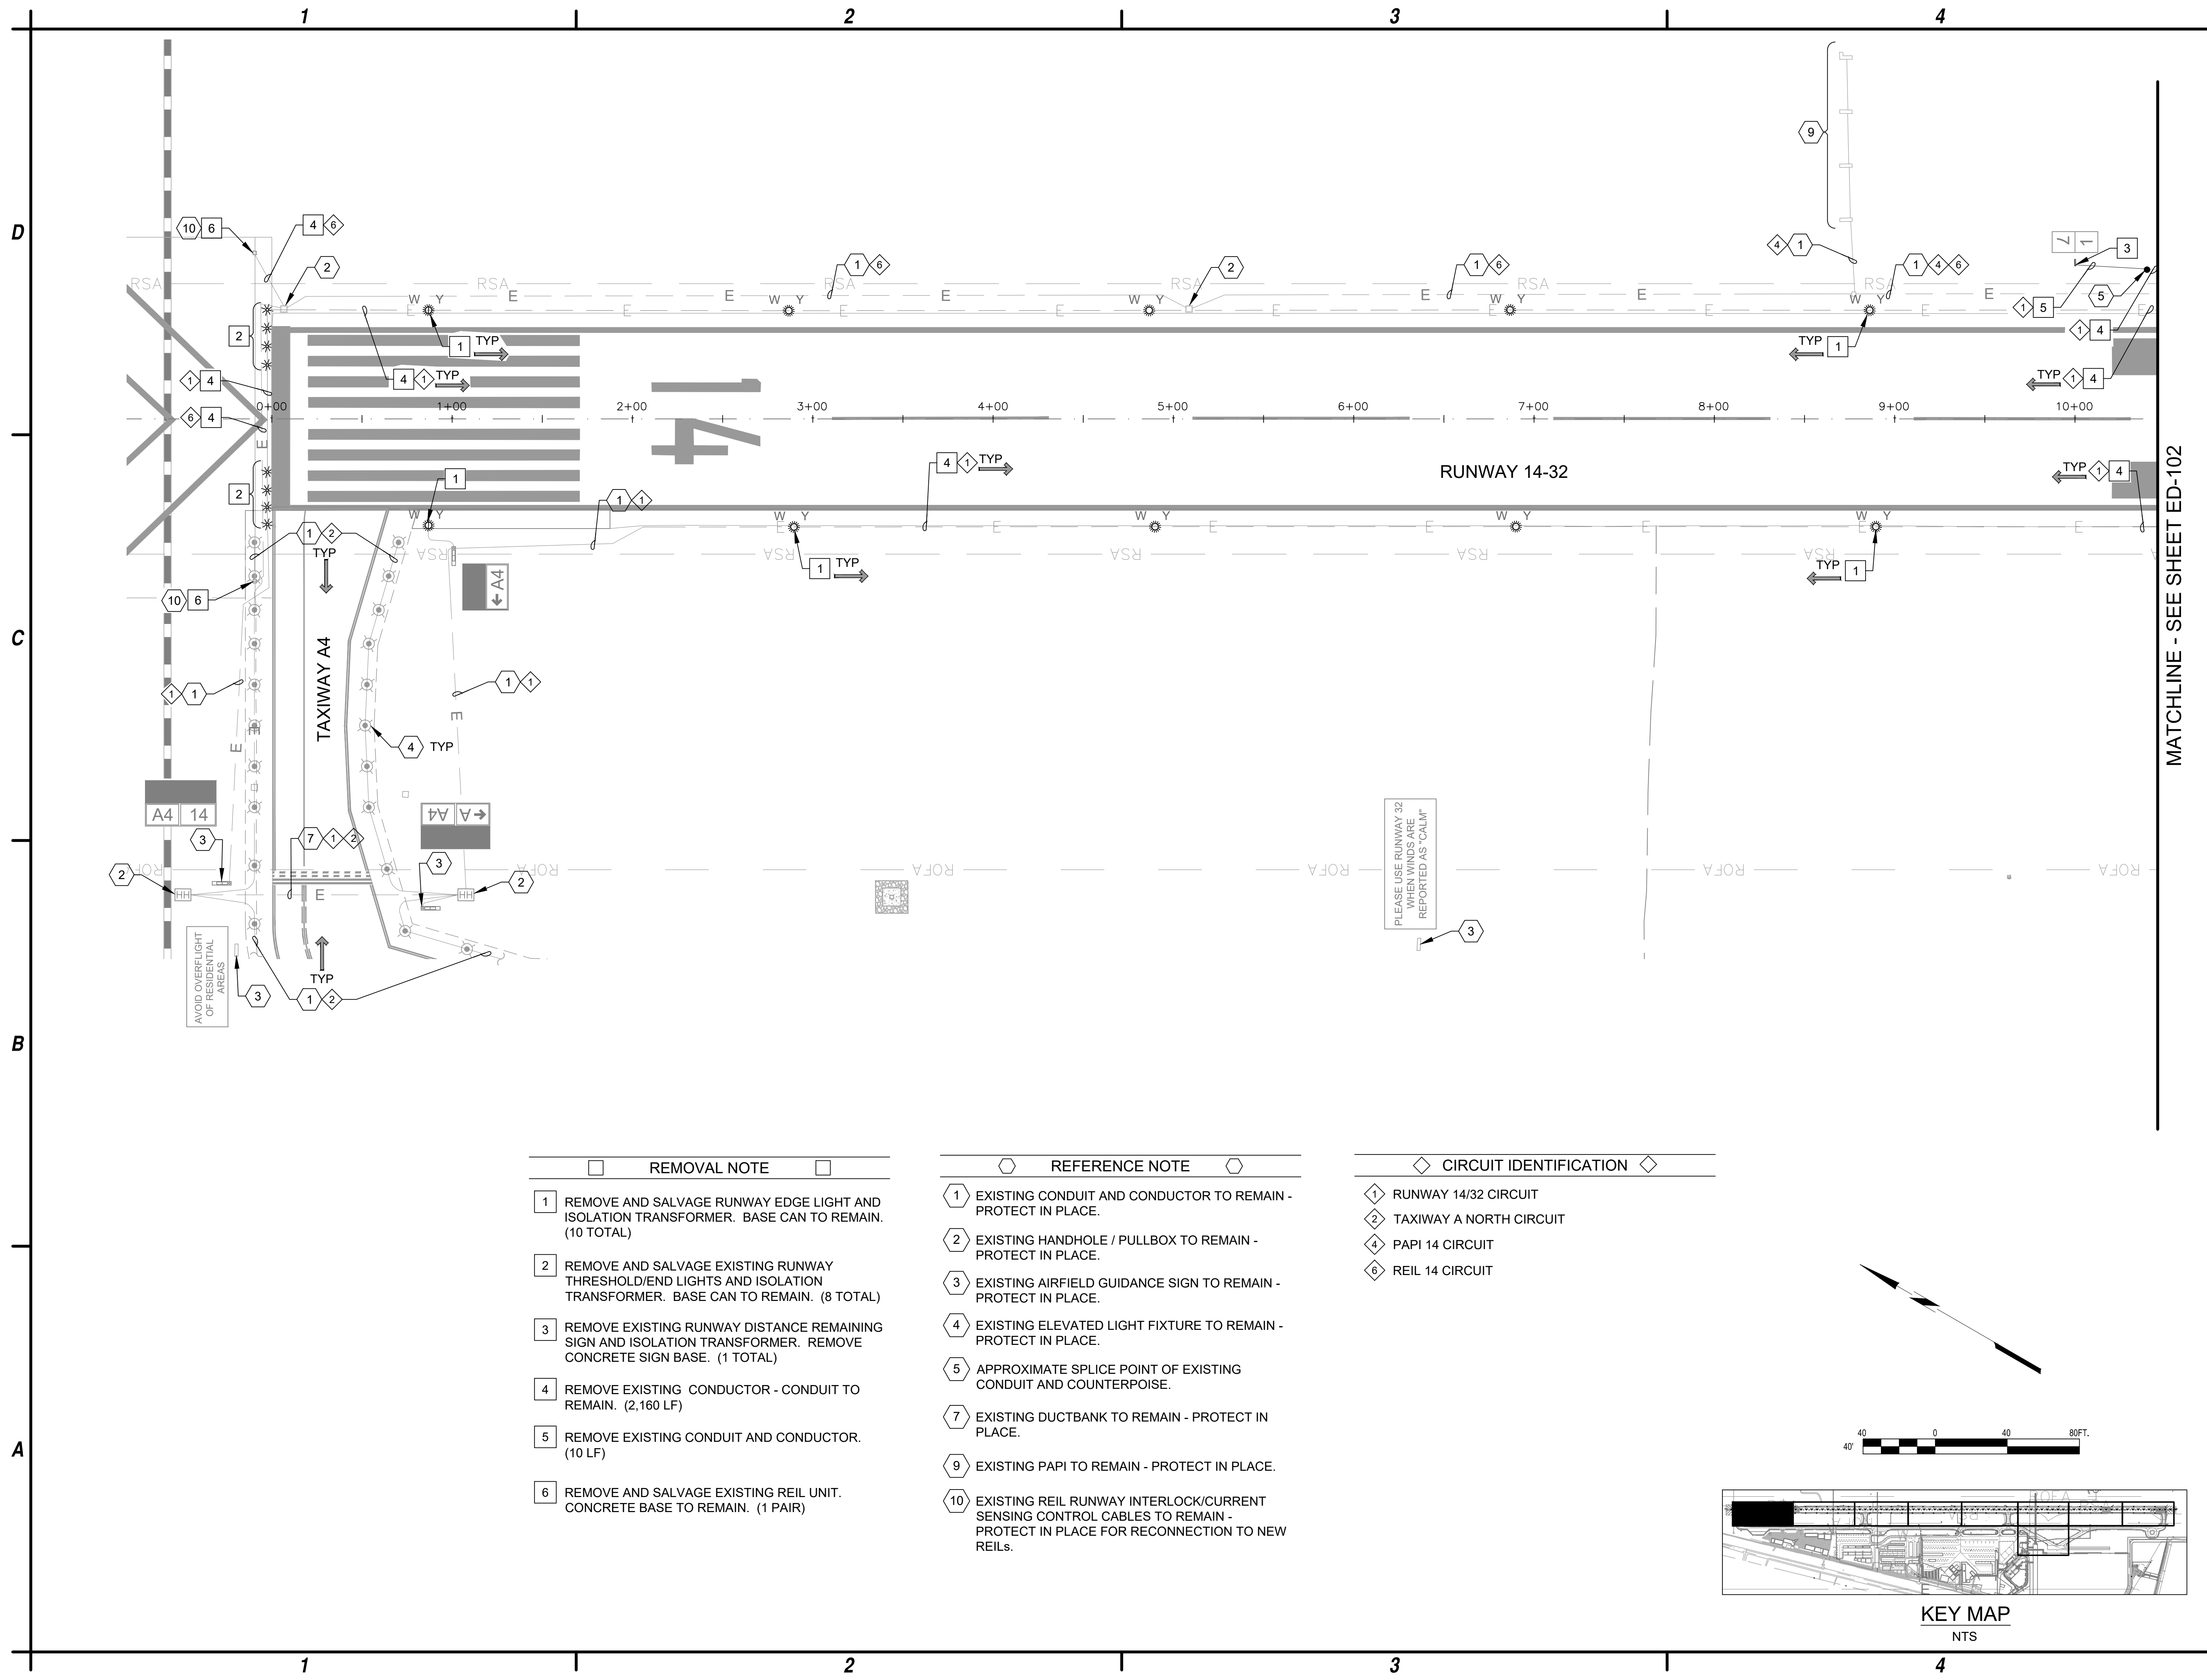


MATCHLINE - SEE SHEET ED-102

- | REMOVAL NOTE | |
|--------------|--|
| 1 | REMOVE AND SALVAGE RUNWAY EDGE LIGHT AND ISOLATION TRANSFORMER. BASE CAN TO REMAIN. (10 TOTAL) |
| 2 | REMOVE AND SALVAGE EXISTING RUNWAY THRESHOLD/END LIGHTS AND ISOLATION TRANSFORMER. BASE CAN TO REMAIN. (8 TOTAL) |
| 3 | REMOVE EXISTING RUNWAY DISTANCE REMAINING SIGN AND ISOLATION TRANSFORMER. REMOVE CONCRETE SIGN BASE. (1 TOTAL) |
| 4 | REMOVE EXISTING CONDUCTOR - CONDUIT TO REMAIN. (2,160 LF) |
| 5 | REMOVE EXISTING CONDUIT AND CONDUCTOR. (10 LF) |
| 6 | REMOVE AND SALVAGE EXISTING REIL UNIT. CONCRETE BASE TO REMAIN. (1 PAIR) |

- | REFERENCE NOTE | |
|----------------|---|
| 1 | EXISTING CONDUIT AND CONDUCTOR TO REMAIN - PROTECT IN PLACE. |
| 2 | EXISTING HANDHOLE / PULLBOX TO REMAIN - PROTECT IN PLACE. |
| 3 | EXISTING AIRFIELD GUIDANCE SIGN TO REMAIN - PROTECT IN PLACE. |
| 4 | EXISTING ELEVATED LIGHT FIXTURE TO REMAIN - PROTECT IN PLACE. |
| 5 | APPROXIMATE SPLICE POINT OF EXISTING CONDUIT AND COUNTERPOISE. |
| 7 | EXISTING DUCTBANK TO REMAIN - PROTECT IN PLACE. |
| 9 | EXISTING PAPI TO REMAIN - PROTECT IN PLACE. |
| 10 | EXISTING REIL RUNWAY INTERLOCK/CURRENT SENSING CONTROL CABLES TO REMAIN - PROTECT IN PLACE FOR RECONNECTION TO NEW REILS. |

- | CIRCUIT IDENTIFICATION | |
|------------------------|-------------------------|
| 1 | RUNWAY 14/32 CIRCUIT |
| 2 | TAXIWAY A NORTH CIRCUIT |
| 4 | PAPI 14 CIRCUIT |
| 6 | REIL 14 CIRCUIT |

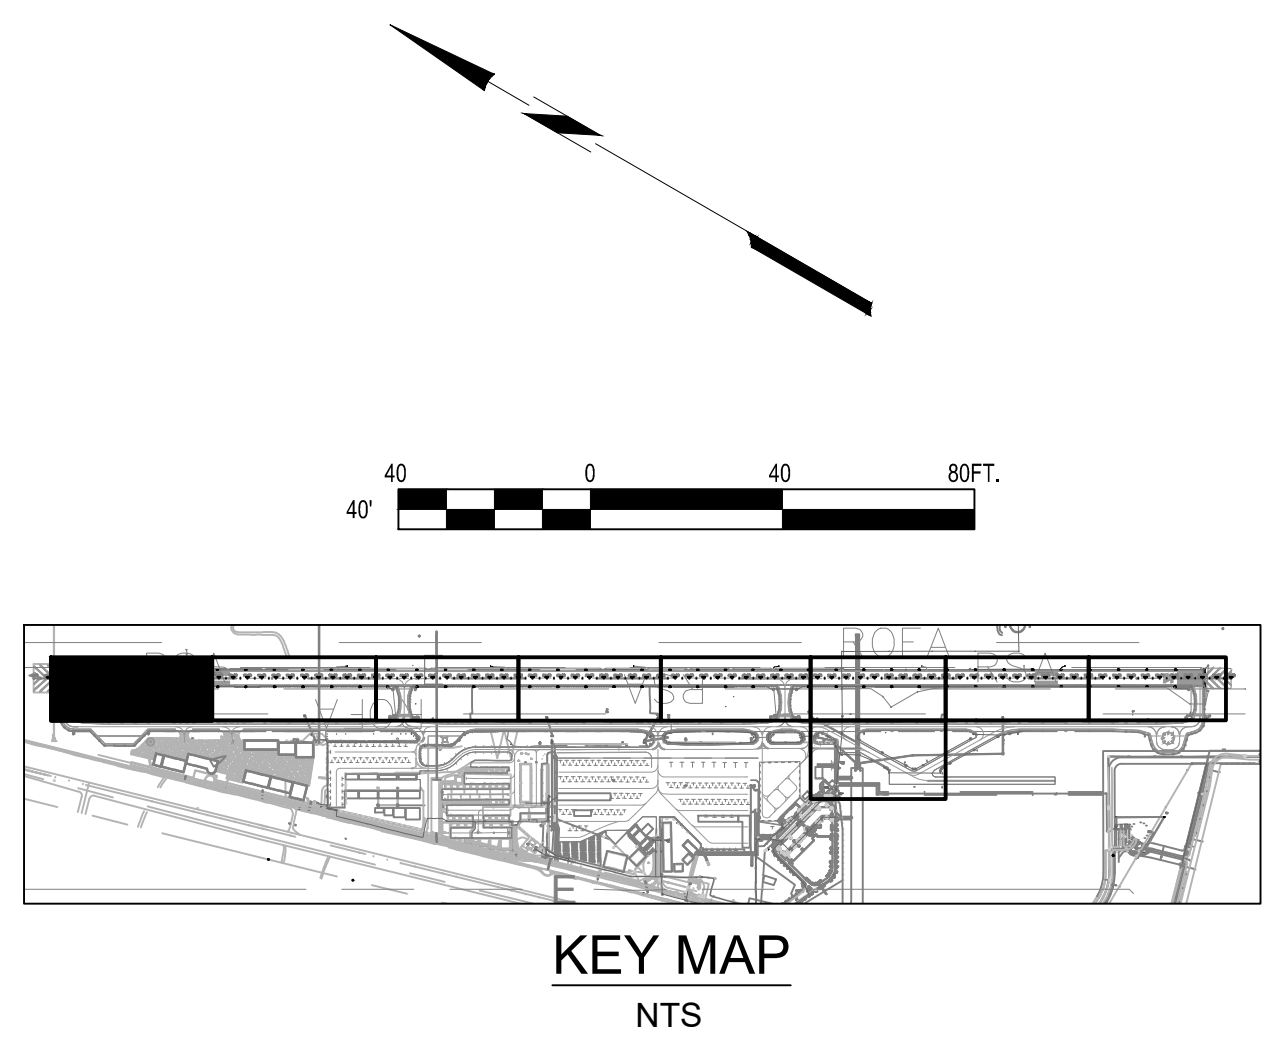

C&S Engineers, Inc.

16719 East Palmdale Blvd., Suite 302
Fountain Hills, AZ 85268
Phone: (480) 816-5541
Fax: (480) 816-5540
www.creng.com

16719 East Palmdale Blvd., Suite 302
Fountain Hills, AZ 85268
Phone: (480) 816-5541
Fax: (480) 816-5540
www.creng.com

Catherine Alcorn

LAKE HAVASU CITY, ARIZONA
INCORPORATED 1978

**RUNWAY LIGHTS AND SIGNS
IMPROVEMENT PROJECT**

**LAKE HAVASU CITY MUNICIPAL AIRPORT
LAKE HAVASU CITY, AIRIZONA**


MARK	DATE	DESCRIPTION
REVISIONS		
PROJECT NO: K33004009		
DATE: MARCH 2025		
DRAWN BY: JBW		
DESIGNED BY: SW		
CHECKED BY: CA		

**AIRFIELD
ELECTRICAL
DEMOLITION
PLAN**

ED-101

7 of 31

Mar 17, 2025 - 4:35pm
Q:\PROJECTS\24000\24016 Lake Havasu Airport_MIRLS, REILS, RDRS\CAD\CAD SHEETS\24016 ED-101-ED-XXX DEMOLITION SHEETS.dwg

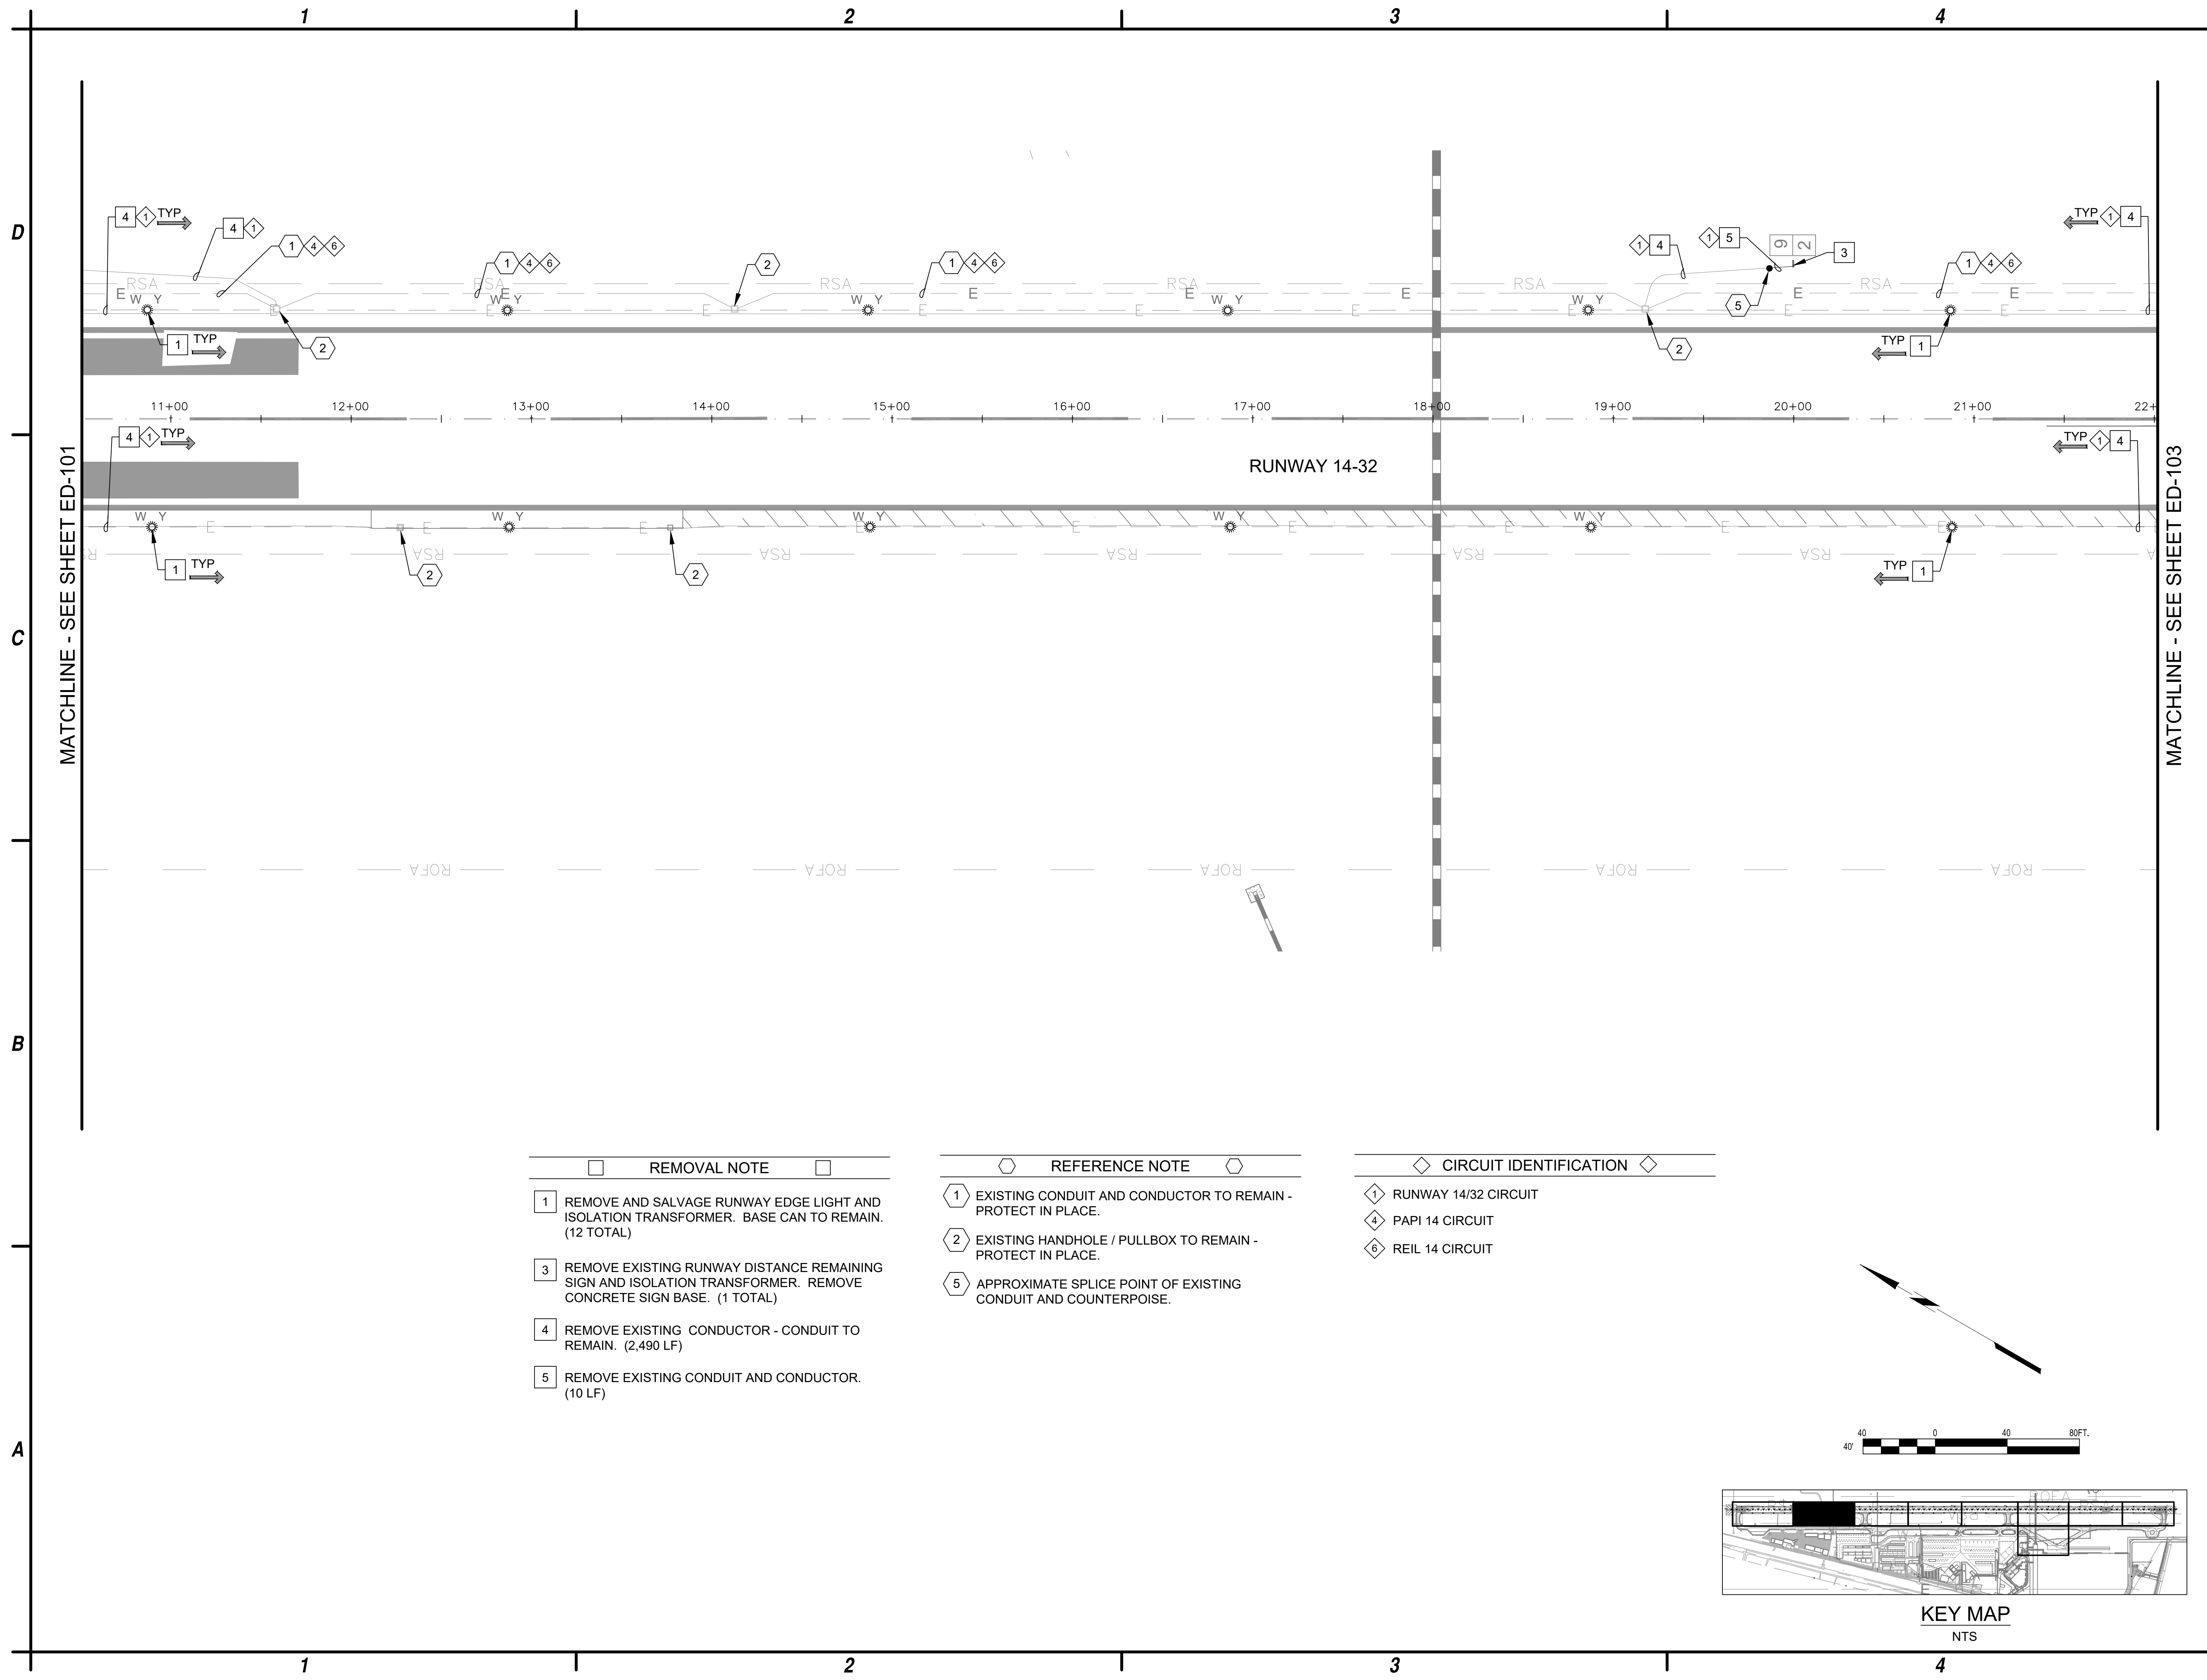



MATCHLINE - SEE SHEET ED-101

MATCHLINE - SEE SHEET ED-103

- | | REMOVAL NOTE | |
|---|--|--|
| 1 | REMOVE AND SALVAGE RUNWAY EDGE LIGHT AND ISOLATION TRANSFORMER. BASE CAN TO REMAIN. (12 TOTAL) | |
| 3 | REMOVE EXISTING RUNWAY DISTANCE REMAINING SIGN AND ISOLATION TRANSFORMER. REMOVE CONCRETE SIGN BASE. (1 TOTAL) | |
| 4 | REMOVE EXISTING CONDUCTOR - CONDUIT TO REMAIN. (2,490 LF) | |
| 5 | REMOVE EXISTING CONDUIT AND CONDUCTOR. (10 LF) | |

- | | REFERENCE NOTE | |
|---|--|--|
| 1 | EXISTING CONDUIT AND CONDUCTOR TO REMAIN - PROTECT IN PLACE. | |
| 2 | EXISTING HANDHOLE / PULLBOX TO REMAIN - PROTECT IN PLACE. | |
| 5 | APPROXIMATE SPLICE POINT OF EXISTING CONDUIT AND COUNTERPOISE. | |

- | | CIRCUIT IDENTIFICATION | |
|---|------------------------|--|
| 1 | RUNWAY 14/32 CIRCUIT | |
| 4 | PAPI 14 CIRCUIT | |
| 6 | REIL 14 CIRCUIT | |

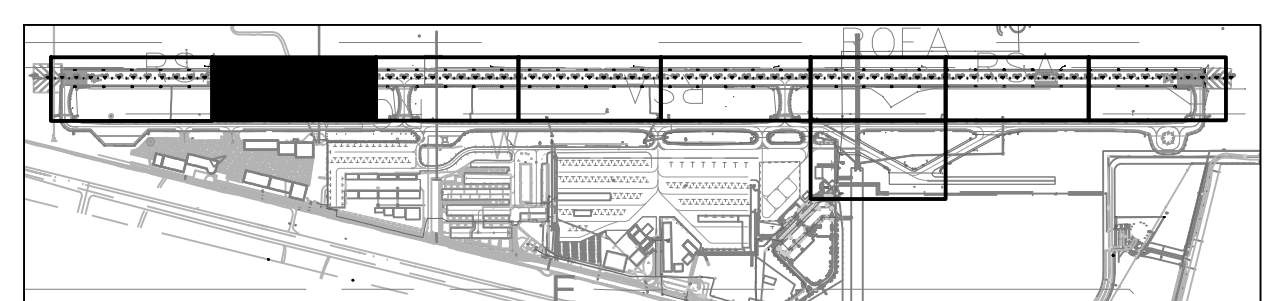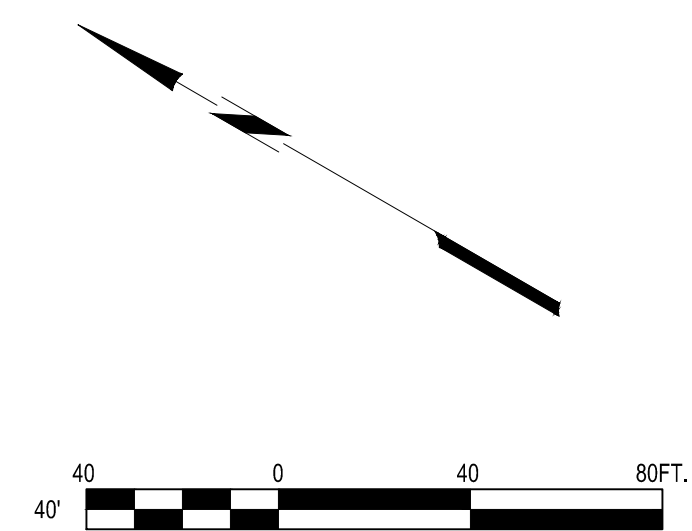

KEY MAP
NTS

C&S
COMPANIES

C&S Engineers, Inc.

CR
engineers

16719 East Palmdale Blvd., Suite 302
Fountain Hills, AZ 85268
Phone: (480) 816-5541
Fax: (480) 816-5540
www.creng.com

Professional Engineer (Qualified)
36696
CATHERINE
ALCORN
State of Arizona
Exp. 12/31/2025
Catherine Alcorn

LAKE HAVASU CITY, ARIZONA
INCORPORATED 1978

**RUNWAY LIGHTS AND SIGNS
IMPROVEMENT PROJECT**

**LAKE HAVASU CITY MUNICIPAL AIRPORT
LAKE HAVASU CITY, AIRIZONA**


MARK	DATE	DESCRIPTION
REVISIONS		
PROJECT NO: K33004009		
DATE: MARCH 2025		
DRAWN BY: JBW		
DESIGNED BY: SW		
CHECKED BY: CA		

**AIRFIELD
ELECTRICAL
DEMOLITION
PLAN**

ED-102

8 of 31

Mar 17, 2025 - 4:36pm
Q:\PROJECTS\24000\24016 Lake Havasu Airport MRLS, RELS, RDRS\CAD\CAD SHEETS\24016 ED-101-ED-XXX DEMOLITION SHEETS.dwg

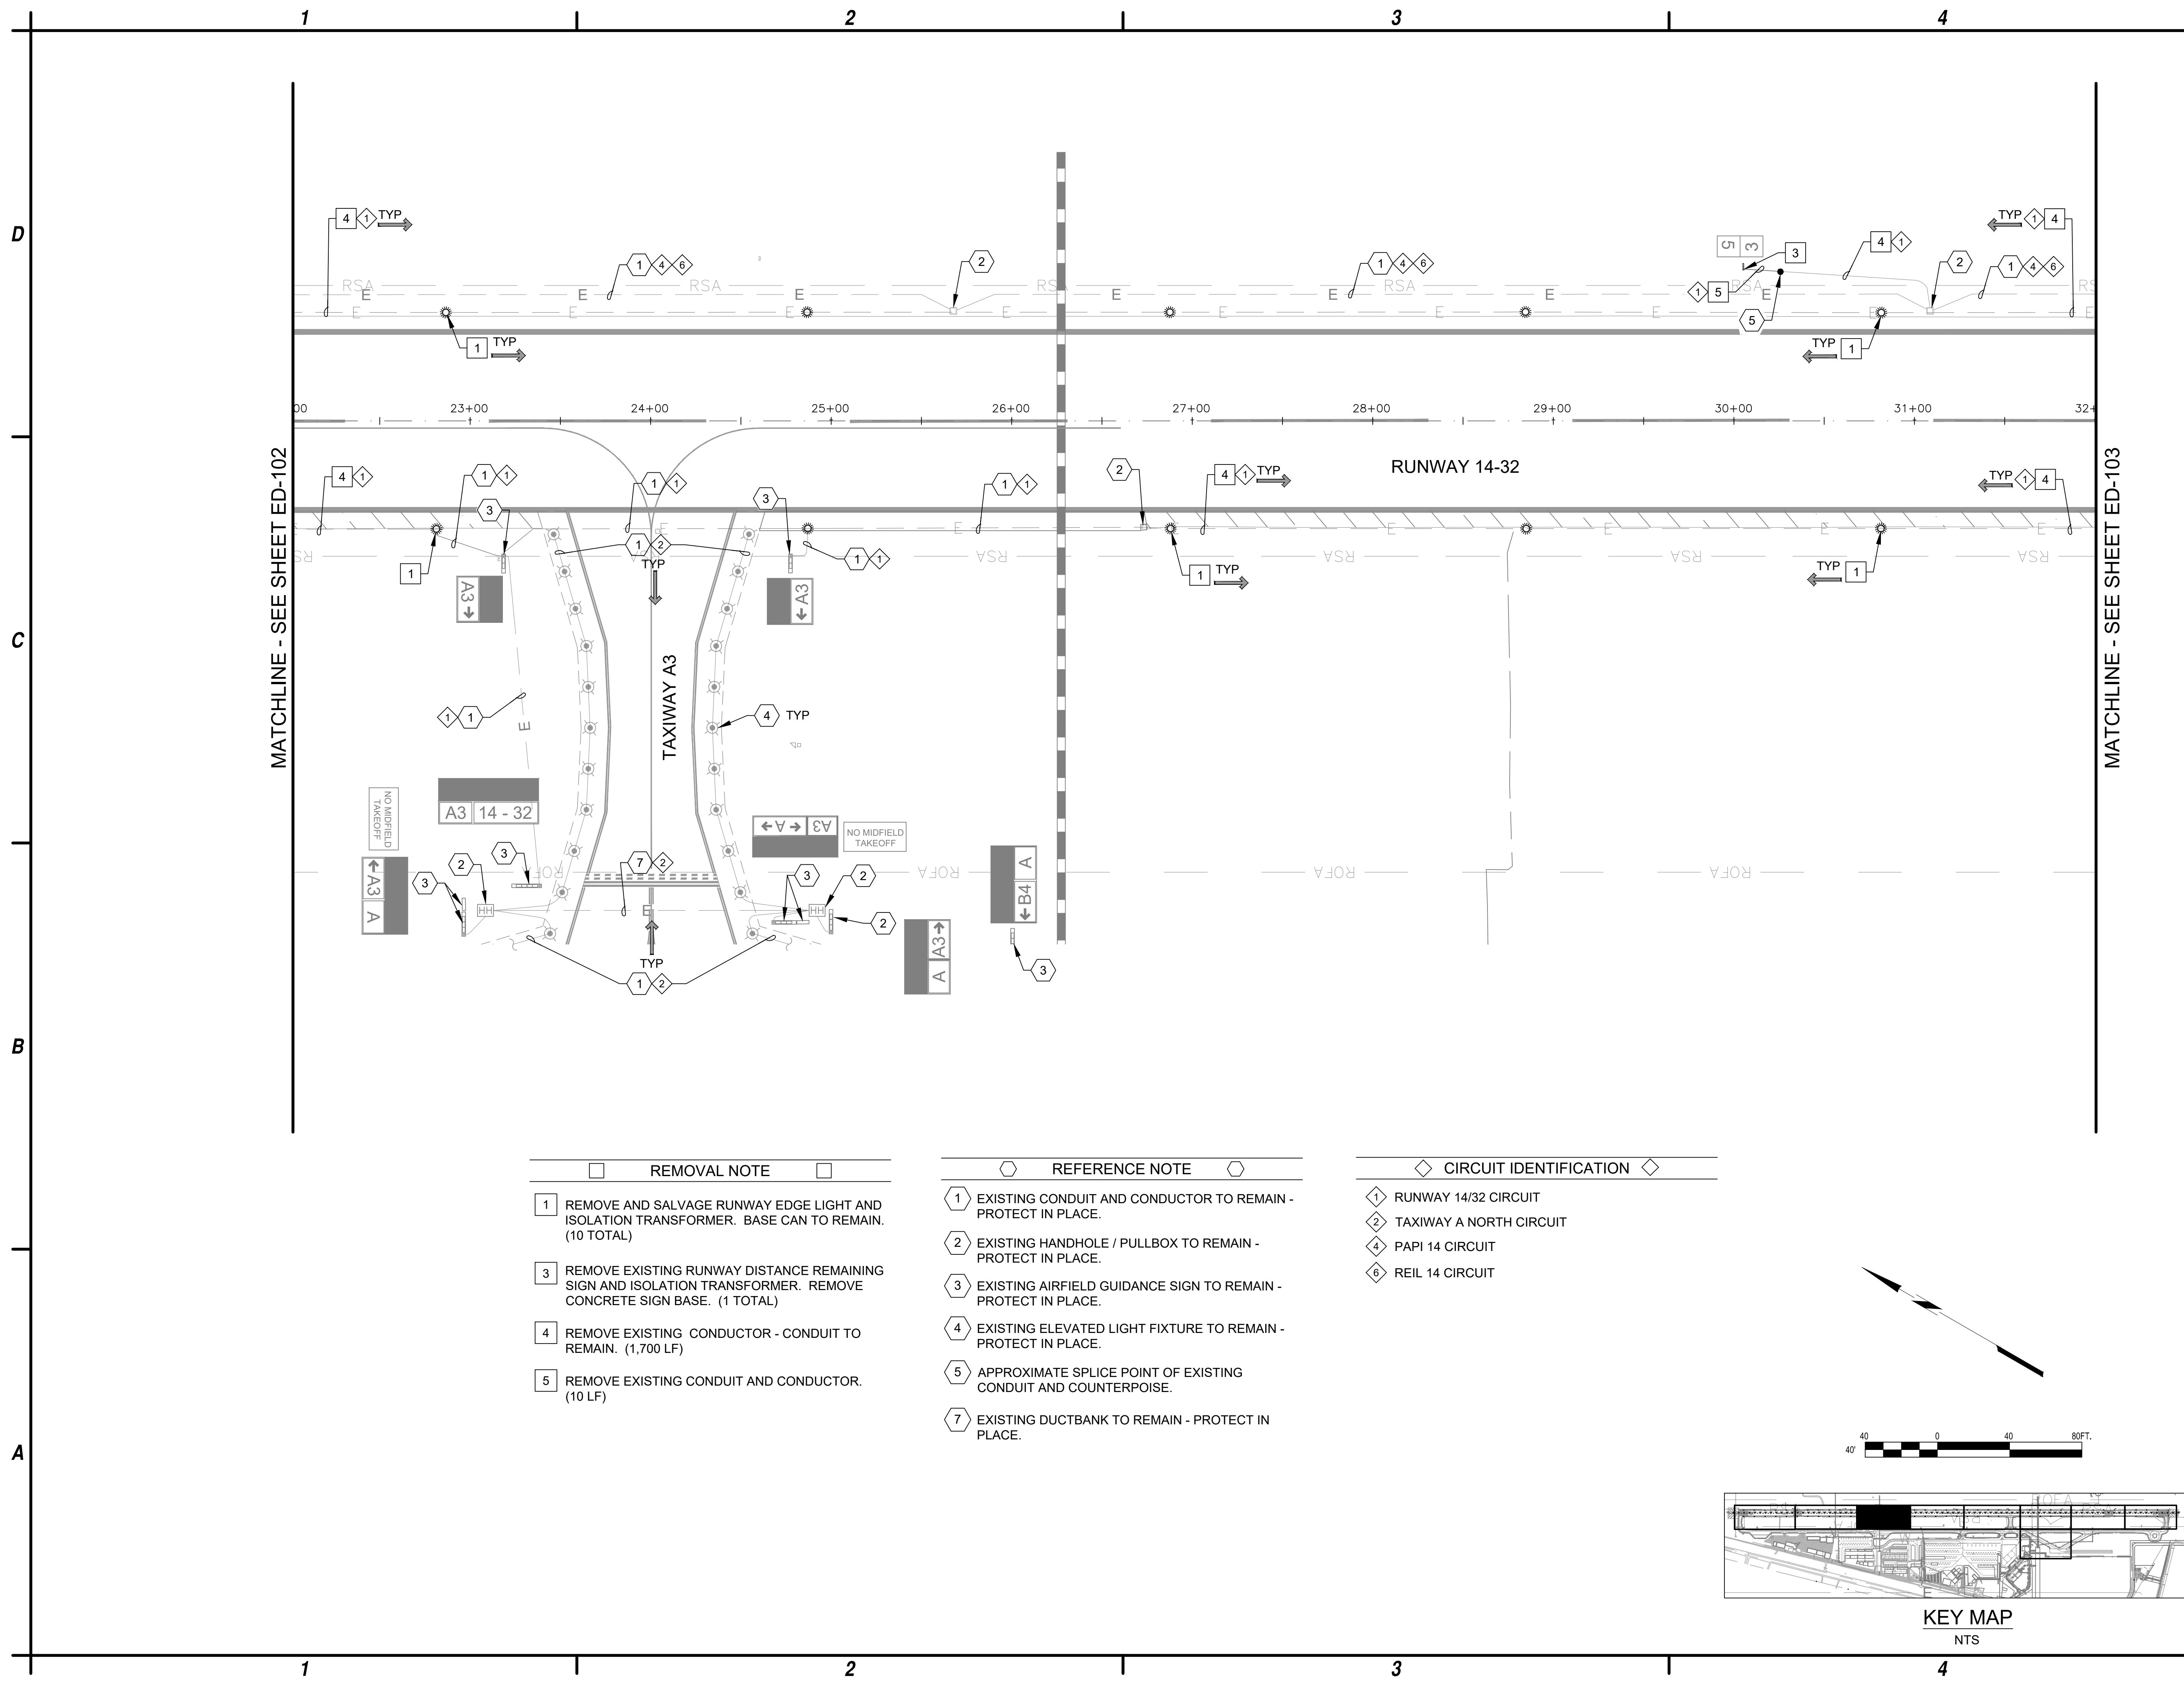



MATCHLINE - SEE SHEET ED-102

MATCHLINE - SEE SHEET ED-103

- | REMOVAL NOTE | |
|--------------|--|
| 1 | REMOVE AND SALVAGE RUNWAY EDGE LIGHT AND ISOLATION TRANSFORMER. BASE CAN TO REMAIN. (10 TOTAL) |
| 3 | REMOVE EXISTING RUNWAY DISTANCE REMAINING SIGN AND ISOLATION TRANSFORMER. REMOVE CONCRETE SIGN BASE. (1 TOTAL) |
| 4 | REMOVE EXISTING CONDUCTOR - CONDUIT TO REMAIN. (1,700 LF) |
| 5 | REMOVE EXISTING CONDUIT AND CONDUCTOR. (10 LF) |

- | REFERENCE NOTE | |
|----------------|--|
| 1 | EXISTING CONDUIT AND CONDUCTOR TO REMAIN - PROTECT IN PLACE. |
| 2 | EXISTING HANDHOLE / PULLBOX TO REMAIN - PROTECT IN PLACE. |
| 3 | EXISTING AIRFIELD GUIDANCE SIGN TO REMAIN - PROTECT IN PLACE. |
| 4 | EXISTING ELEVATED LIGHT FIXTURE TO REMAIN - PROTECT IN PLACE. |
| 5 | APPROXIMATE SPLICE POINT OF EXISTING CONDUIT AND COUNTERPOISE. |
| 7 | EXISTING DUCTBANK TO REMAIN - PROTECT IN PLACE. |

- | CIRCUIT IDENTIFICATION | |
|------------------------|-------------------------|
| 1 | RUNWAY 14/32 CIRCUIT |
| 2 | TAXIWAY A NORTH CIRCUIT |
| 4 | PAPI 14 CIRCUIT |
| 6 | REIL 14 CIRCUIT |

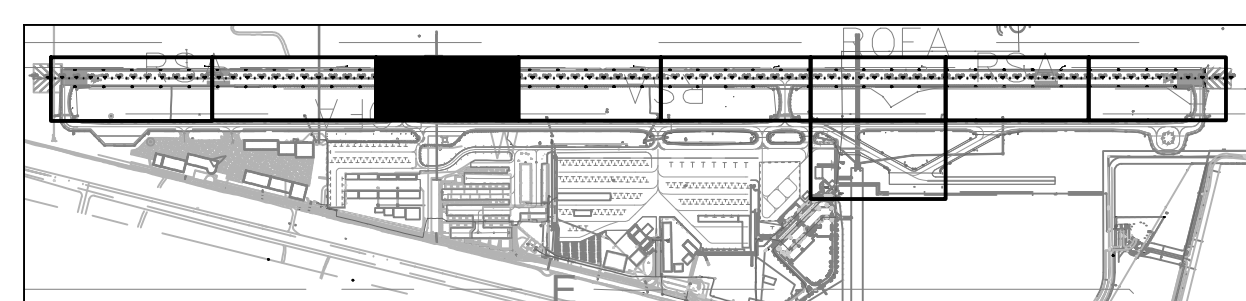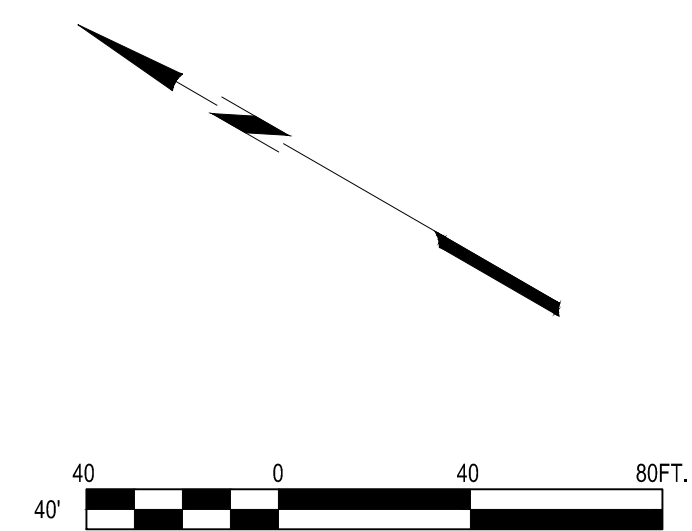

KEY MAP
NTS

C&S Engineers, Inc.

CR engineers

16719 East Palmdale Blvd., Suite 302
Fountain Hills, AZ 85268
Phone: (480) 816-5541
Fax: (480) 816-5540
www.creng.com

Professional Engineer
36696
CATHERINE
ALCORN
State of Arizona
No. 14,486-25
Arizona, U.S.A.

LAKE HAVASU CITY, ARIZONA
INCORPORATED 1978

**RUNWAY LIGHTS AND SIGNS
IMPROVEMENT PROJECT**

**LAKE HAVASU CITY MUNICIPAL AIRPORT
LAKE HAVASU CITY, AIRIZONA**


MARK	DATE	DESCRIPTION
REVISIONS		
PROJECT NO: K33004009		
DATE: MARCH 2025		
DRAWN BY: JBW		
DESIGNED BY: SW		
CHECKED BY: CA		

**AIRFIELD
ELECTRICAL
DEMOLITION
PLAN**

ED-103

9 of 31

Mar 17, 2025 - 4:36pm
Q:\PROJECTS\24000\24016 Lake Havasu Airport MIRLS, RELS, RDRs\CAD\CAD SHEETS\24016 ED-101-ED-XXX DEMOLITION SHEETS.dwg

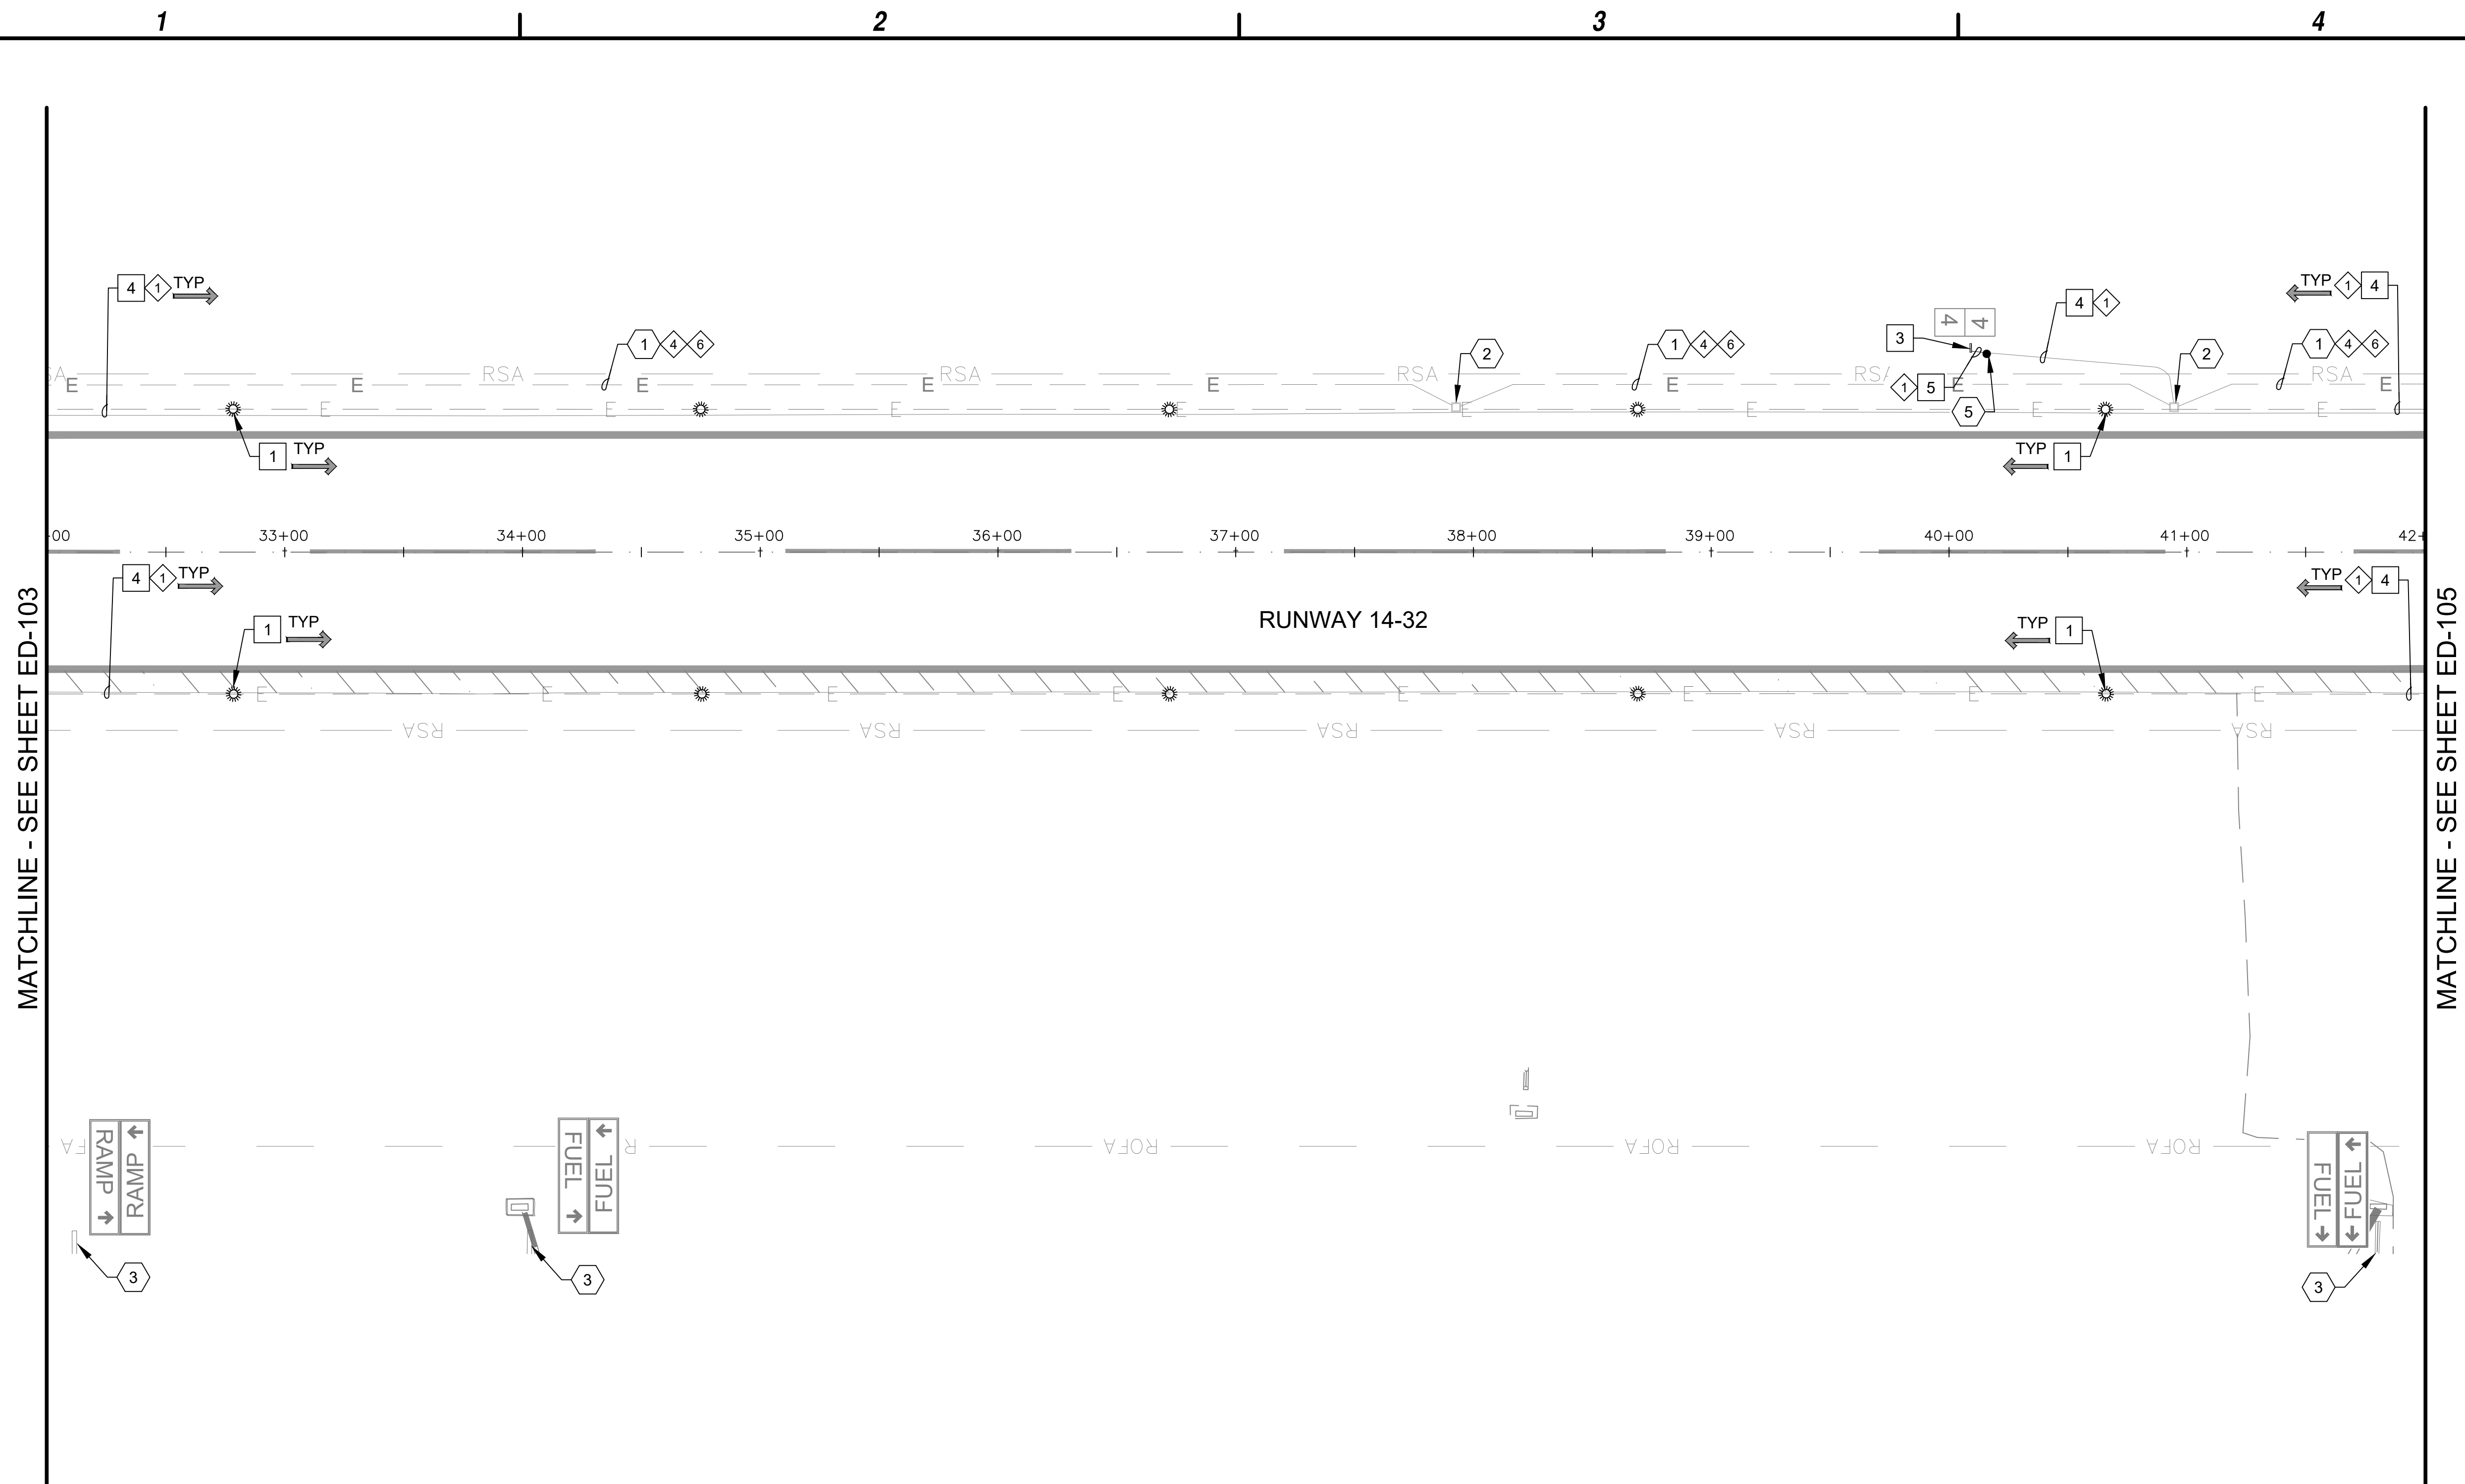



MATCHLINE - SEE SHEET ED-103

MATCHLINE - SEE SHEET ED-105

- | REMOVAL NOTE |
|--|
| 1 REMOVE AND SALVAGE RUNWAY EDGE LIGHT AND ISOLATION TRANSFORMER. BASE CAN TO REMAIN. (10 TOTAL) |
| 3 REMOVE EXISTING RUNWAY DISTANCE REMAINING SIGN AND ISOLATION TRANSFORMER. REMOVE CONCRETE SIGN BASE. (1 TOTAL) |
| 4 REMOVE EXISTING CONDUCTOR - CONDUIT TO REMAIN. (2,085 LF) |
| 5 REMOVE EXISTING CONDUIT AND CONDUCTOR. (10 LF) |

- | REFERENCE NOTE |
|--|
| 1 EXISTING CONDUIT AND CONDUCTOR TO REMAIN - PROTECT IN PLACE. |
| 3 EXISTING AIRFIELD GUIDANCE SIGN TO REMAIN - PROTECT IN PLACE. |
| 5 APPROXIMATE SPLICE POINT OF EXISTING CONDUIT AND COUNTERPOISE. |

- | CIRCUIT IDENTIFICATION |
|------------------------|
| 1 RUNWAY 14/32 CIRCUIT |
| 4 PAPI 14 CIRCUIT |
| 6 REIL 14 CIRCUIT |

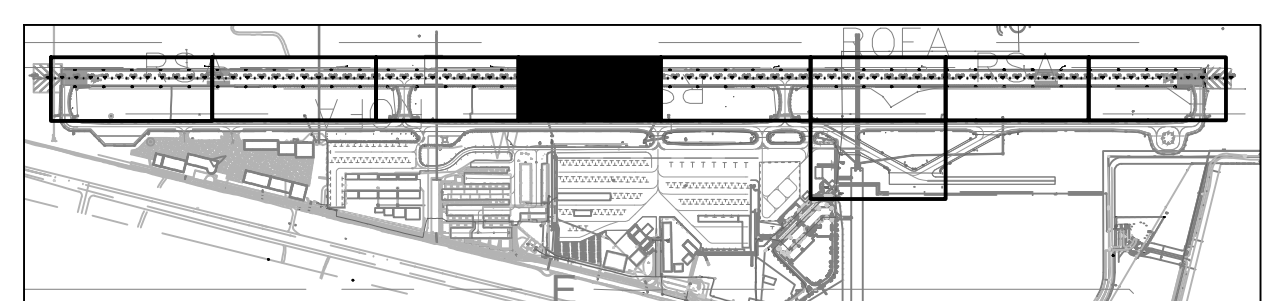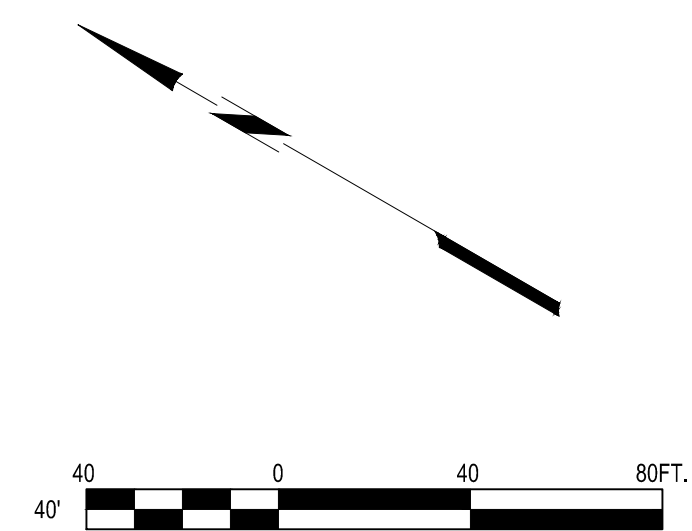

C&S Engineers, Inc.

CR engineers

16719 East Palmdale Blvd., Suite 202
Fountain Hills, AZ 85268
Phone: (480) 816-5541
Fax: (480) 816-5540
www.creng.com

Professional Engineer (Qualified)
36696
CATHERINE
ALCORN
State of Arizona
Exp. 12/31/2025
Catherine Alcorn

LAKE HAVASU CITY, ARIZONA
INCORPORATED 1978

**RUNWAY LIGHTS AND SIGNS
IMPROVEMENT PROJECT**

**LAKE HAVASU CITY MUNICIPAL AIRPORT
LAKE HAVASU CITY, AIRIZONA**


MARK	DATE	DESCRIPTION
REVISIONS		
PROJECT NO: K33004009		
DATE: MARCH 2025		
DRAWN BY: JBW		
DESIGNED BY: SW		
CHECKED BY: CA		

**AIRFIELD
ELECTRICAL
DEMOLITION
PLAN**

ED-104

10 of 31

Mar 17, 2025 - 4:36pm
Q:\PROJECTS\24000\24016 Lake Havasu Airport_MIRLS, REILS, RDrs\CAD\CAD SHEETS\24016 ED-101-ED-XXX DEMOLITION SHEETS.dwg

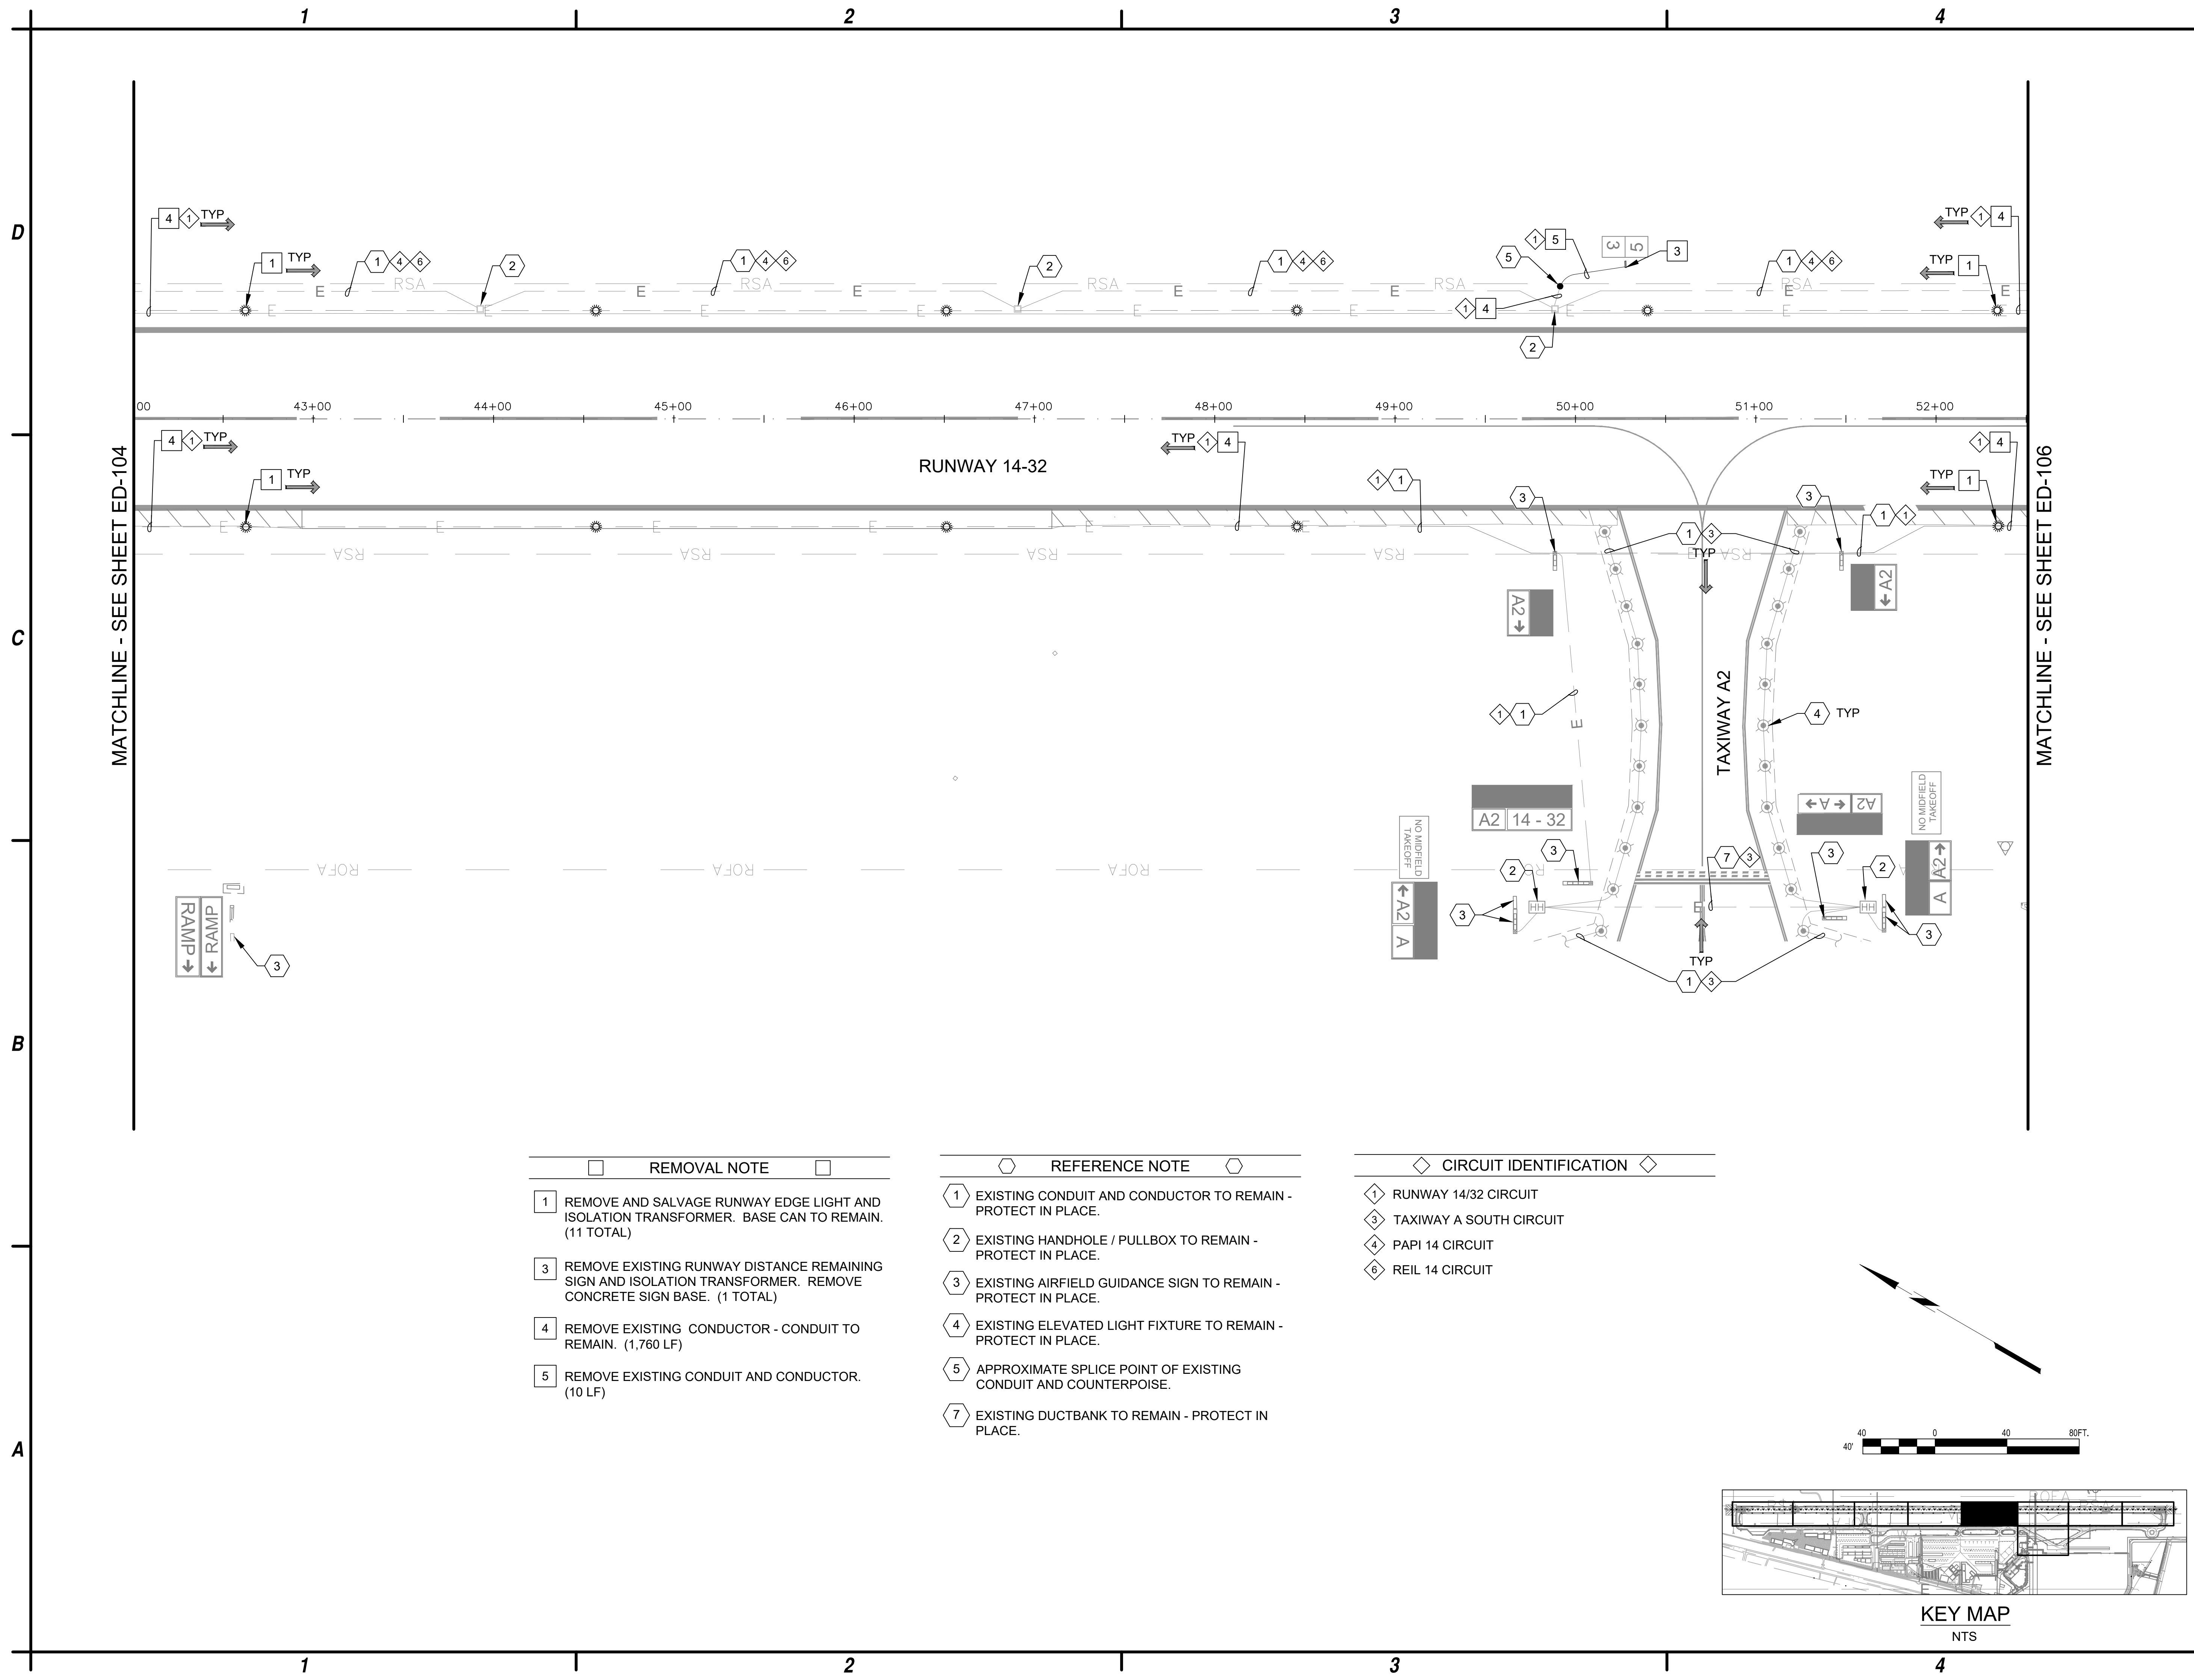



MATCHLINE - SEE SHEET ED-104

MATCHLINE - SEE SHEET ED-106

- | REMOVAL NOTE |
|--|
| 1 REMOVE AND SALVAGE RUNWAY EDGE LIGHT AND ISOLATION TRANSFORMER. BASE CAN TO REMAIN. (11 TOTAL) |
| 3 REMOVE EXISTING RUNWAY DISTANCE REMAINING SIGN AND ISOLATION TRANSFORMER. REMOVE CONCRETE SIGN BASE. (1 TOTAL) |
| 4 REMOVE EXISTING CONDUCTOR - CONDUIT TO REMAIN. (1,760 LF) |
| 5 REMOVE EXISTING CONDUIT AND CONDUCTOR. (10 LF) |

- | REFERENCE NOTE |
|--|
| 1 EXISTING CONDUIT AND CONDUCTOR TO REMAIN - PROTECT IN PLACE. |
| 2 EXISTING HANDHOLE / PULLBOX TO REMAIN - PROTECT IN PLACE. |
| 3 EXISTING AIRFIELD GUIDANCE SIGN TO REMAIN - PROTECT IN PLACE. |
| 4 EXISTING ELEVATED LIGHT FIXTURE TO REMAIN - PROTECT IN PLACE. |
| 5 APPROXIMATE SPLICE POINT OF EXISTING CONDUIT AND COUNTERPOISE. |
| 7 EXISTING DUCTBANK TO REMAIN - PROTECT IN PLACE. |

- | CIRCUIT IDENTIFICATION |
|---------------------------|
| 1 RUNWAY 14/32 CIRCUIT |
| 3 TAXIWAY A SOUTH CIRCUIT |
| 4 PAPI 14 CIRCUIT |
| 6 REIL 14 CIRCUIT |

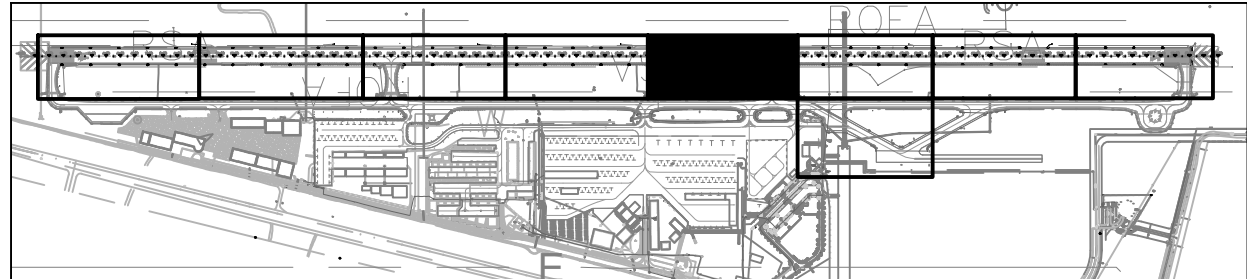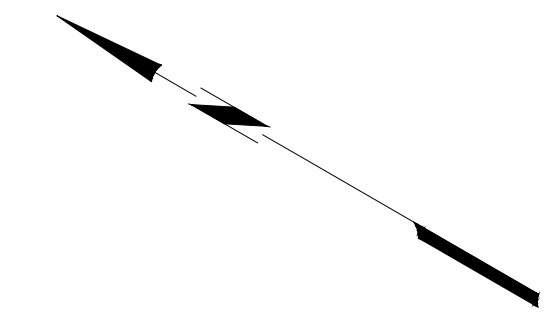

KEY MAP
NTS

C&S
COMPANIES

C&S Engineers, Inc.

CR
engineers

16719 East Palmdale Blvd., Suite 302
Fountain Hills, AZ 85268
Phone: (480) 816-5541
Fax: (480) 816-5540
www.creng.com

Professional Engineer (Qualified)
36696
CATHERINE
ALCORN
State of Arizona
Exp. 12/31/2025
Catherine Alcorn

LAKE HAVASU CITY, ARIZONA
INCORPORATED 1978

**RUNWAY LIGHTS AND SIGNS
IMPROVEMENT PROJECT**

**LAKE HAVASU CITY MUNICIPAL AIRPORT
LAKE HAVASU CITY, AIRIZONA**


MARK	DATE	DESCRIPTION
REVISIONS		
PROJECT NO: K33004009		
DATE: MARCH 2025		
DRAWN BY: JBW		
DESIGNED BY: SW		
CHECKED BY: CA		

**AIRFIELD
ELECTRICAL
DEMOLITION
PLAN**

ED-105

11 of 31



Mar 17, 2025 - 4:36pm
Q:\PROJECTS\24000\24016 Lake Havasu Airport MIRLS, RELS, RDRs\CAD\CAD SHEETS\24016 ED-101-ED-XXX DEMOLITION SHEETS.dwg

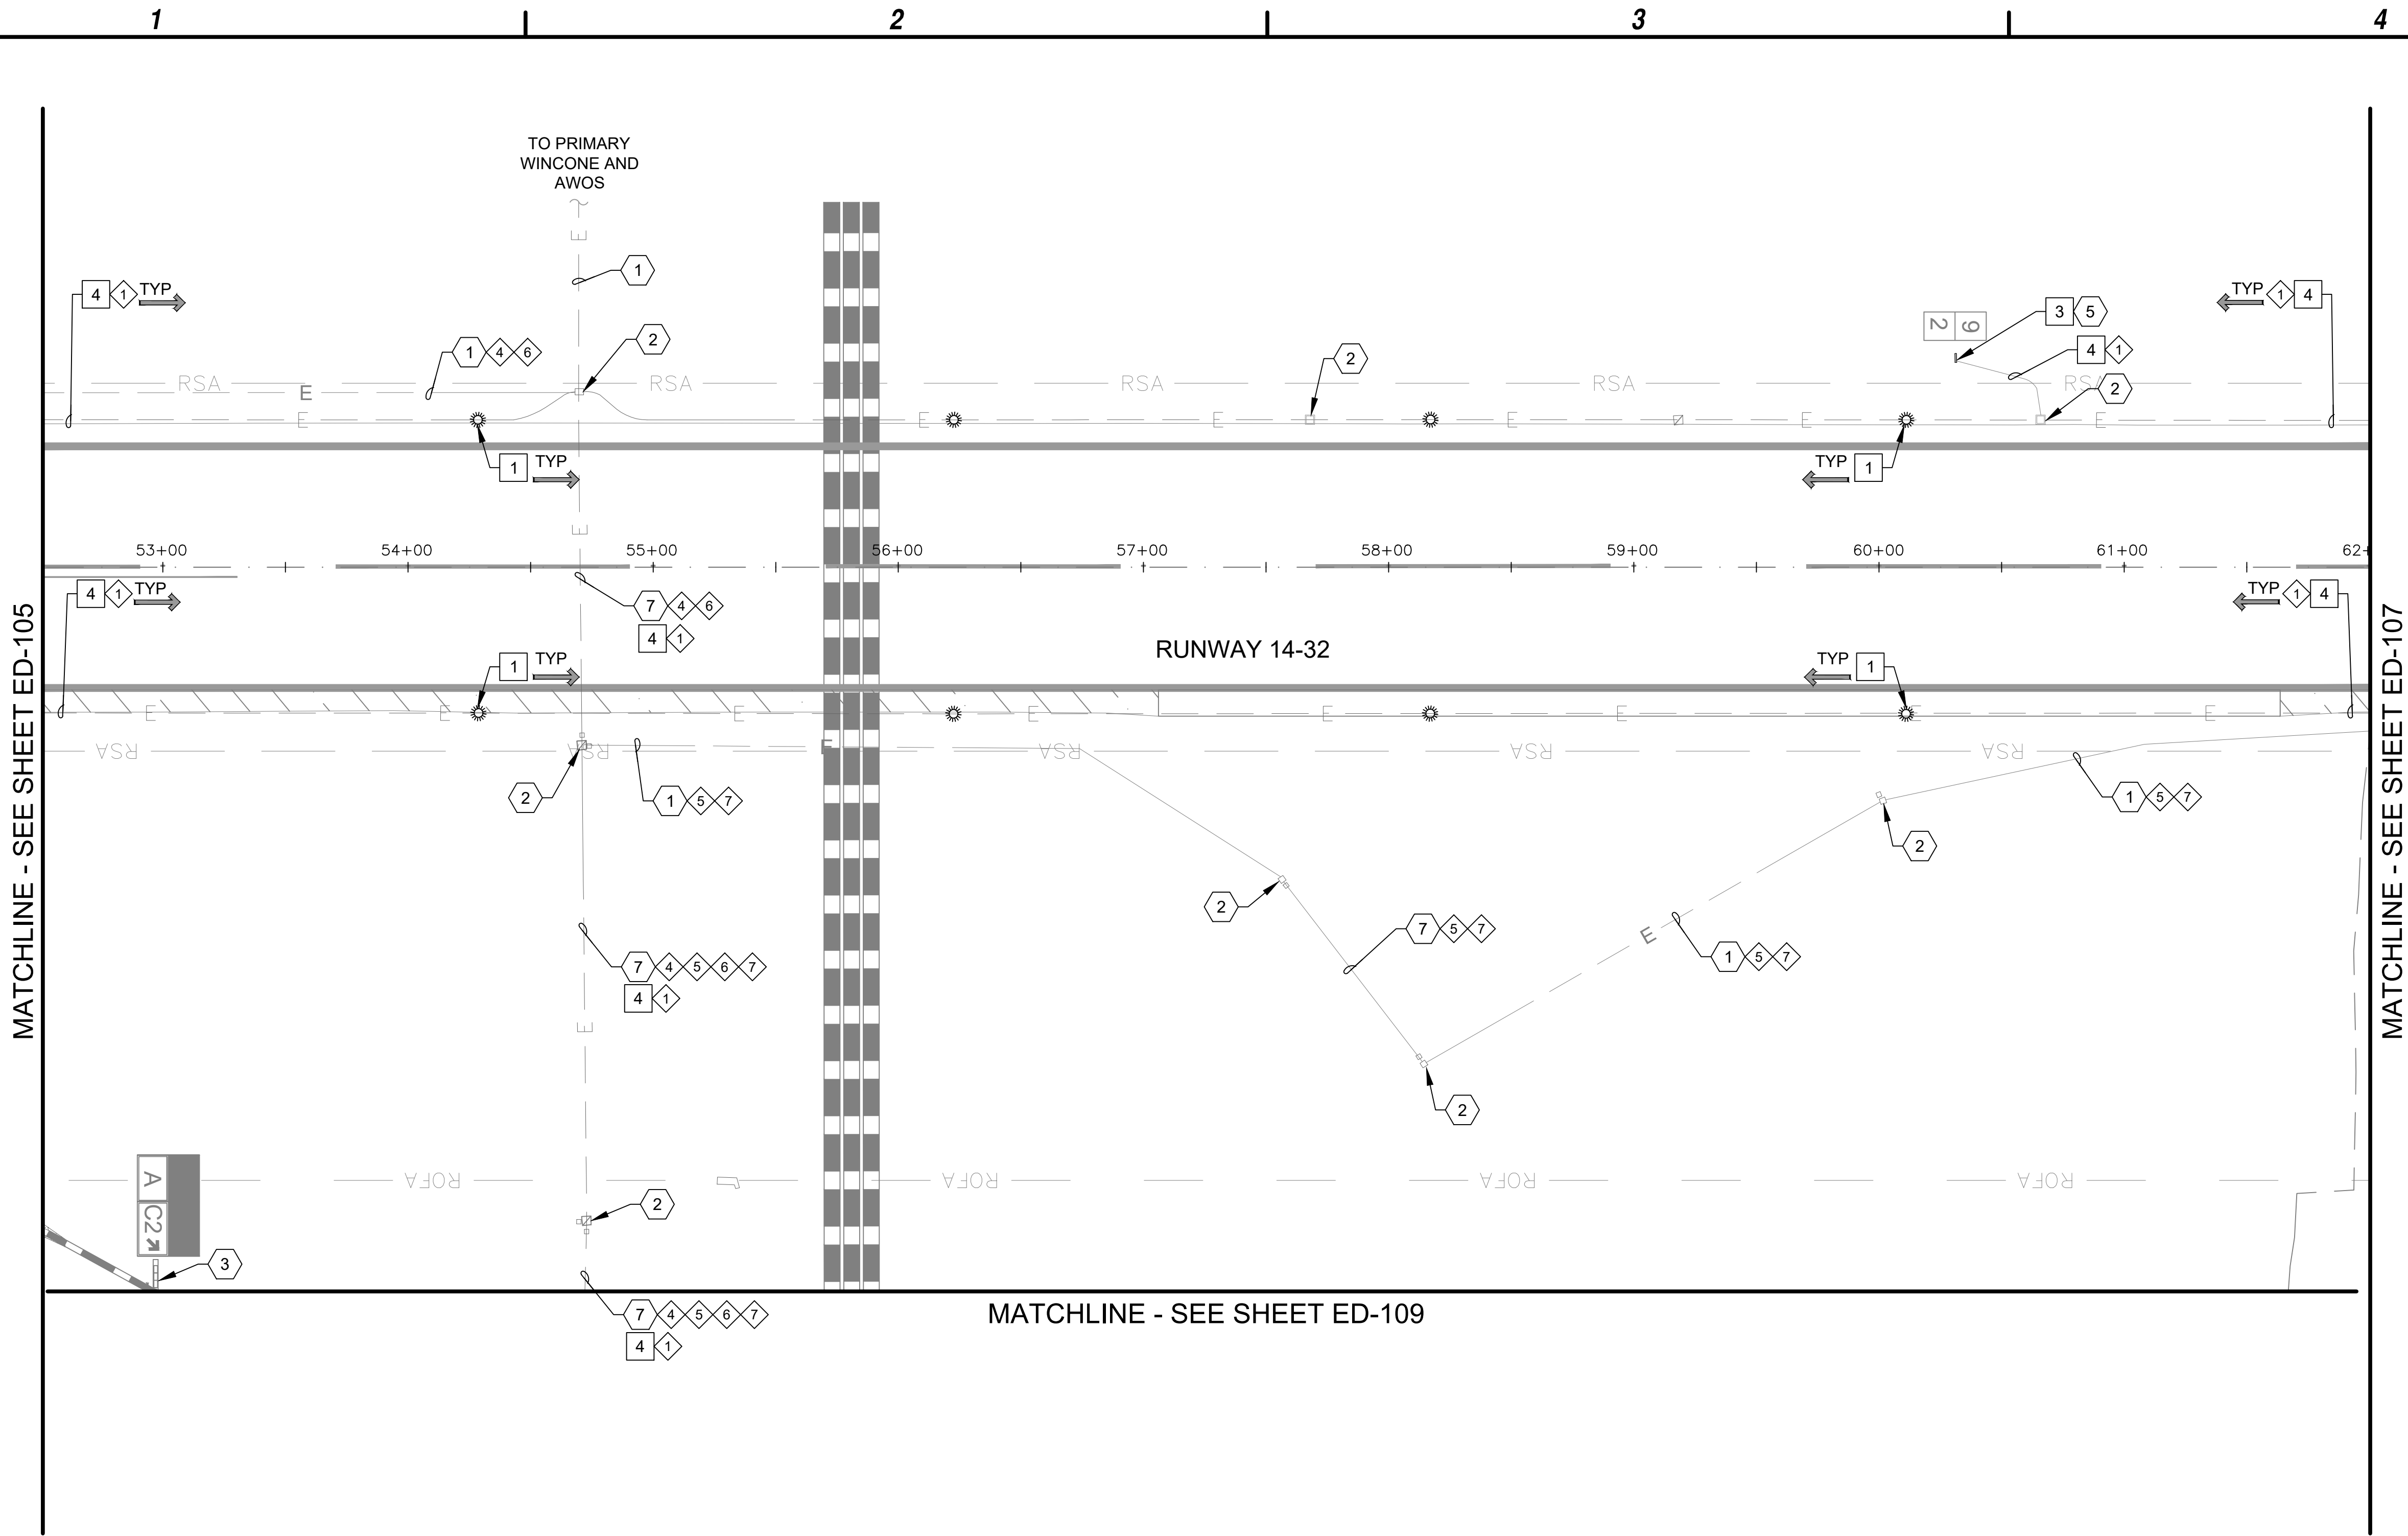

- | REMOVAL NOTE |
|--|
| 1 REMOVE AND SALVAGE RUNWAY EDGE LIGHT AND ISOLATION TRANSFORMER. BASE CAN TO REMAIN. (8 TOTAL) |
| 3 REMOVE EXISTING RUNWAY DISTANCE REMAINING SIGN AND ISOLATION TRANSFORMER. REMOVE CONCRETE SIGN BASE. (1 TOTAL) |
| 4 REMOVE EXISTING CONDUCTOR - CONDUIT TO REMAIN. (2,325 LF) |
| 5 REMOVE EXISTING CONDUIT AND CONDUCTOR. (10 LF) |

- | REFERENCE NOTE |
|--|
| 1 EXISTING CONDUIT AND CONDUCTOR TO REMAIN - PROTECT IN PLACE. |
| 2 EXISTING HANDHOLE / PULLBOX TO REMAIN - PROTECT IN PLACE. |
| 3 EXISTING AIRFIELD GUIDANCE SIGN TO REMAIN - PROTECT IN PLACE. |
| 5 APPROXIMATE SPLICE POINT OF EXISTING CONDUIT AND COUNTERPOISE. |
| 7 EXISTING DUCTBANK TO REMAIN - PROTECT IN PLACE. |

- | CIRCUIT IDENTIFICATION |
|------------------------|
| 1 RUNWAY 14/32 CIRCUIT |
| 4 PAPI 14 CIRCUIT |
| 5 PAPI 32 CIRCUIT |
| 6 REIL 14 CIRCUIT |
| 7 REIL 32 CIRCUIT |

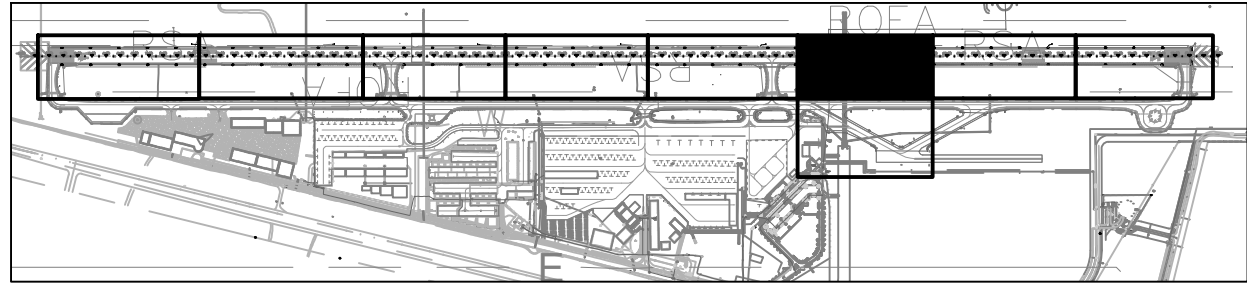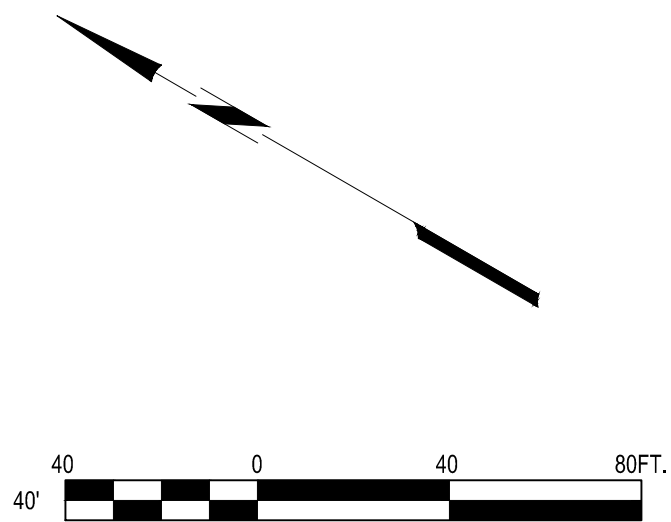

KEY MAP
NTS

C&S
COMPANIES

C&S Engineers, Inc.

CR
engineers

16719 East Palmdale Blvd.,
Suite 302
Fountain Hills, AZ 85268
Phone: (480) 816-5541
Fax: (480) 816-5540
www.creng.com

36696
CATHERINE
ALCORN
Professional Engineer
No. 36696
State of Arizona
Catherine Alcorn

LAKE HAVASU CITY, ARIZONA
INCORPORATED 1978

**RUNWAY LIGHTS AND SIGNS
IMPROVEMENT PROJECT**

**LAKE HAVASU CITY MUNICIPAL AIRPORT
LAKE HAVASU CITY, AIRIZONA**

MARK	DATE	DESCRIPTION
REVISIONS		
PROJECT NO: K33004009		
DATE: MARCH 2025		
DRAWN BY: JBW		
DESIGNED BY: SW		
CHECKED BY: CA		

**AIRFIELD
ELECTRICAL
DEMOLITION
PLAN**


ED-106

12 of 31

Mar 17, 2025 - 4:36pm
Q:\PROJECTS\24000\24016 Lake Havasu Airport MIRLS, REELS, RDRs\CAD\CAD SHEETS\24016 ED-101-ED-XXX DEMOLITION SHEETS.dwg

MATCHLINE - SEE SHEET ED-106



MATCHLINE - SEE SHEET ED-108

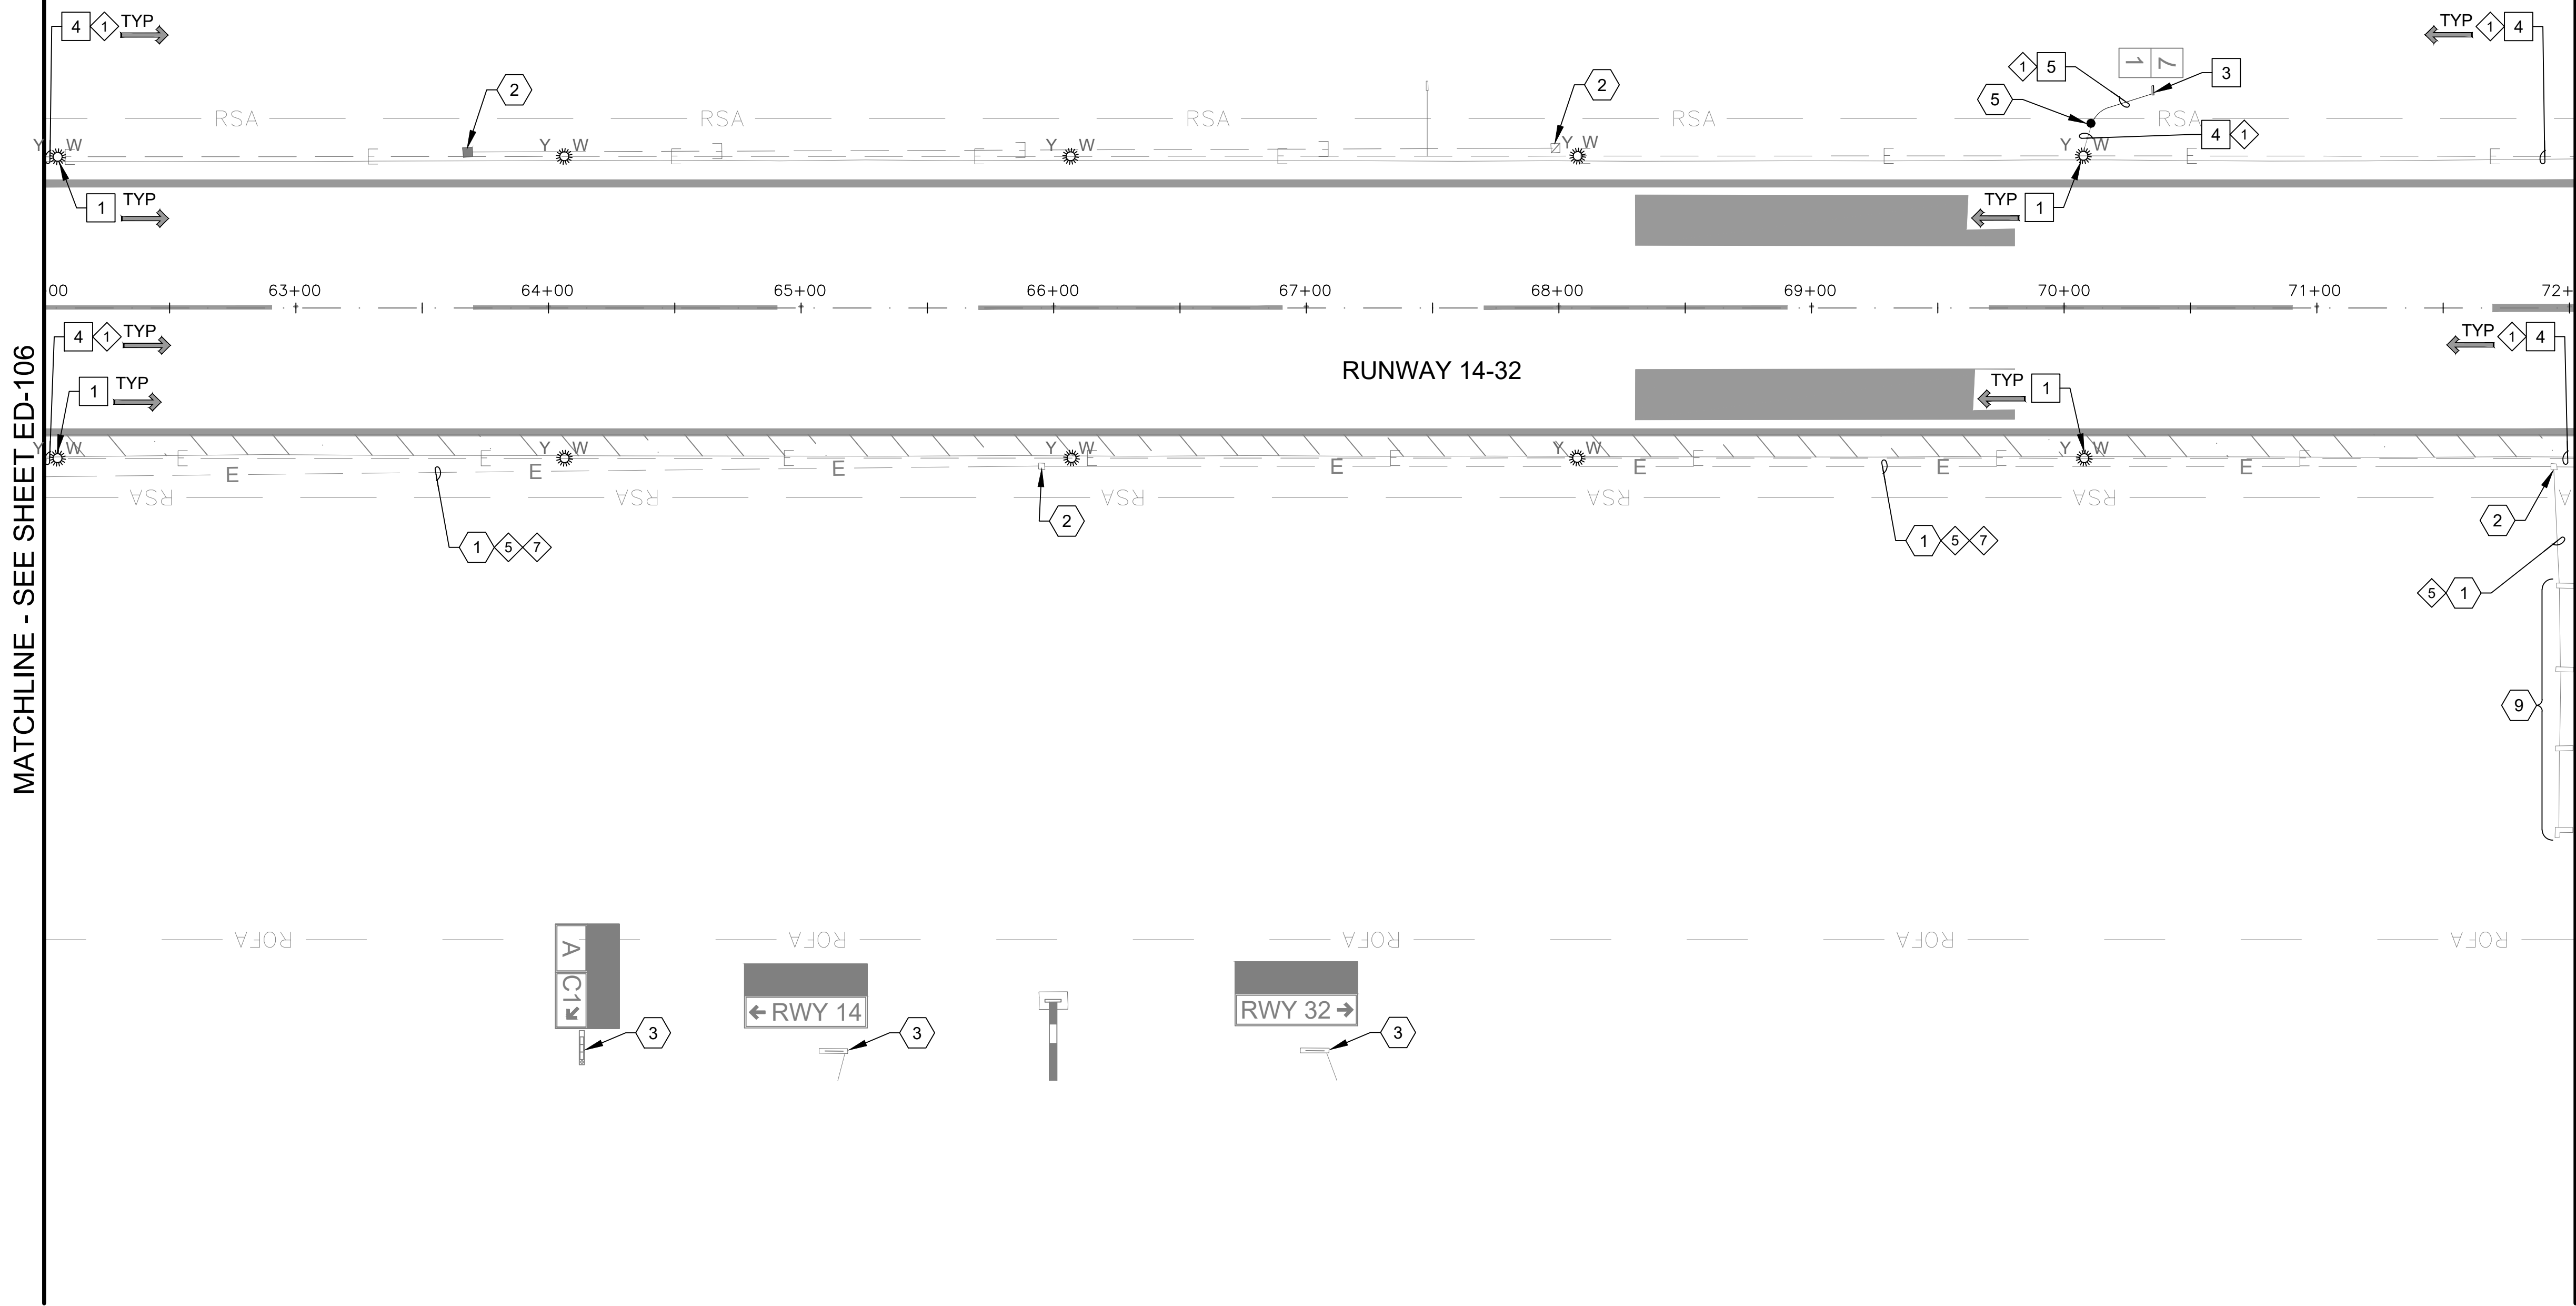

- | REMOVAL NOTE |
|--|
| 1 REMOVE AND SALVAGE RUNWAY EDGE LIGHT AND ISOLATION TRANSFORMER. BASE CAN TO REMAIN. (10 TOTAL) |
| 3 REMOVE EXISTING RUNWAY DISTANCE REMAINING SIGN AND ISOLATION TRANSFORMER. REMOVE CONCRETE SIGN BASE. (1 TOTAL) |
| 4 REMOVE EXISTING CONDUCTOR - CONDUIT TO REMAIN. (2,040 LF) |
| 5 REMOVE EXISTING CONDUIT AND CONDUCTOR. (10 LF) |

- | REFERENCE NOTE |
|--|
| 1 EXISTING CONDUIT AND CONDUCTOR TO REMAIN - PROTECT IN PLACE. |
| 2 EXISTING HANDHOLE / PULLBOX TO REMAIN - PROTECT IN PLACE. |
| 3 EXISTING AIRFIELD GUIDANCE SIGN TO REMAIN - PROTECT IN PLACE. |
| 5 APPROXIMATE SPLICE POINT OF EXISTING CONDUIT AND COUNTERPOISE. |
| 9 EXISTING PAPI TO REMAIN - PROTECT IN PLACE. |


- | CIRCUIT IDENTIFICATION |
|------------------------|
| 1 RUNWAY 14/32 CIRCUIT |
| 5 PAPI 32 CIRCUIT |
| 7 REIL 32 CIRCUIT |

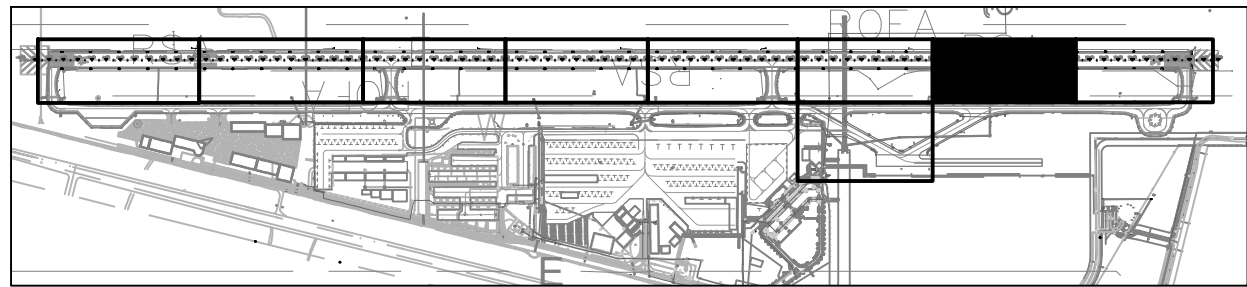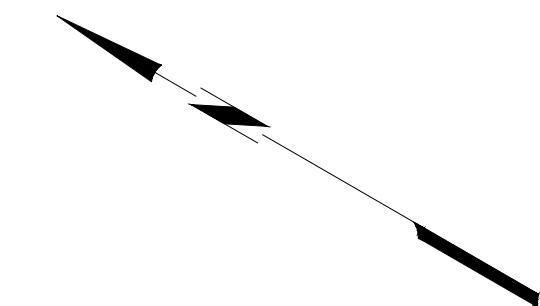

KEY MAP
NTS



C&S Engineers, Inc.

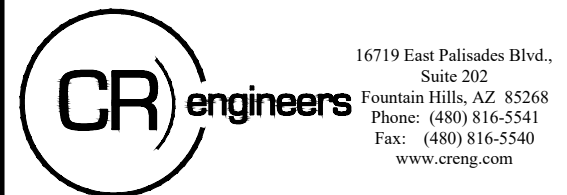


**RUNWAY LIGHTS AND SIGNS
IMPROVEMENT PROJECT**

**LAKE HAVASU CITY MUNICIPAL AIRPORT
LAKE HAVASU CITY, AIRIZONA**

MARK	DATE	DESCRIPTION
REVISIONS		
PROJECT NO: K33004009		
DATE: MARCH 2025		
DRAWN BY: JBW		
DESIGNED BY: SW		
CHECKED BY: CA		

**AIRFIELD
ELECTRICAL
DEMOLITION
PLAN**

ED-107


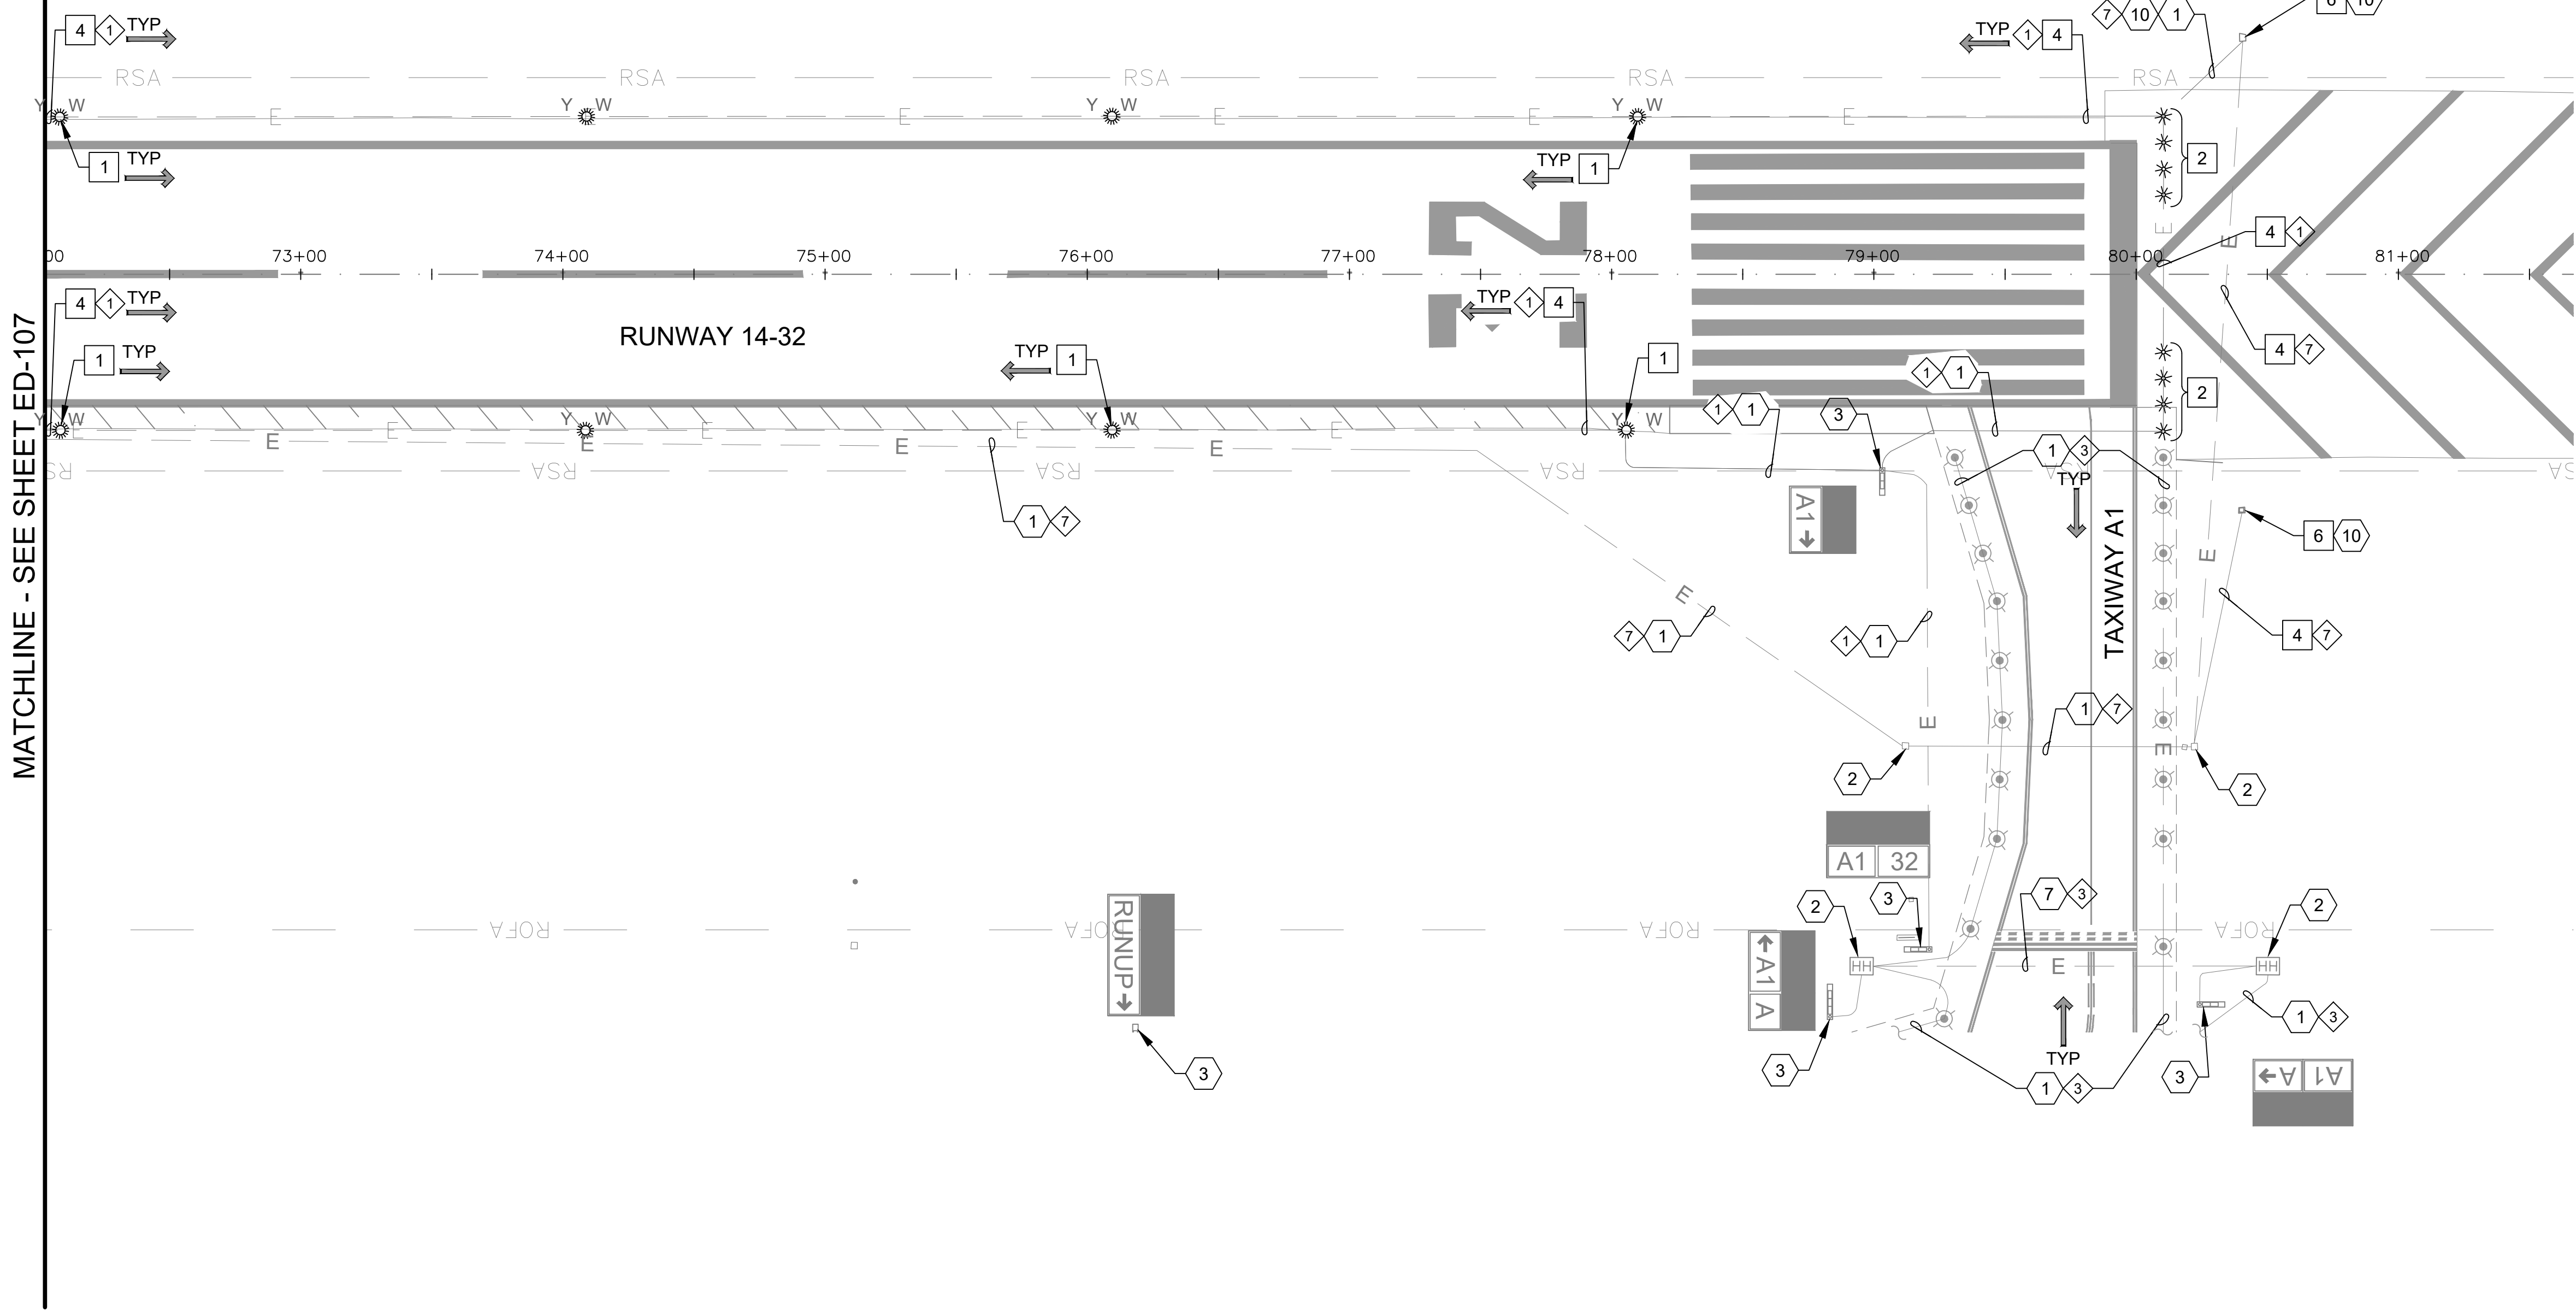


MATCHLINE - SEE SHEET ED-107

- | REMOVAL NOTE | |
|--------------|--|
| 1 | REMOVE AND SALVAGE RUNWAY EDGE LIGHT AND ISOLATION TRANSFORMER. BASE CAN TO REMAIN. (8 TOTAL) |
| 2 | REMOVE AND SALVAGE EXISTING RUNWAY THRESHOLD/END LIGHTS AND ISOLATION TRANSFORMER. BASE CAN TO REMAIN. (8 TOTAL) |
| 4 | REMOVE EXISTING CONDUCTOR - CONDUIT TO REMAIN. (1,930 LF) |
| 6 | REMOVE AND SALVAGE EXISTING REIL UNIT. CONCRETE BASE TO REMAIN. (1 PAIR) |

- | REFERENCE NOTE | |
|----------------|---|
| 1 | EXISTING CONDUIT AND CONDUCTOR TO REMAIN - PROTECT IN PLACE. |
| 2 | EXISTING HANDHOLE / PULLBOX TO REMAIN - PROTECT IN PLACE. |
| 3 | EXISTING AIRFIELD GUIDANCE SIGN TO REMAIN - PROTECT IN PLACE. |
| 7 | EXISTING DUCTBANK TO REMAIN - PROTECT IN PLACE. |
| 10 | EXISTING REIL RUNWAY INTERLOCK/CURRENT SENSING CONTROL CABLES TO REMAIN - PROTECT IN PLACE FOR RECONNECTION TO NEW REILs. |

- | CIRCUIT IDENTIFICATION | |
|------------------------|-------------------------|
| 1 | RUNWAY 14/32 CIRCUIT |
| 3 | TAXIWAY A SOUTH CIRCUIT |
| 5 | PAPI 32 CIRCUIT |
| 7 | REIL 32 CIRCUIT |

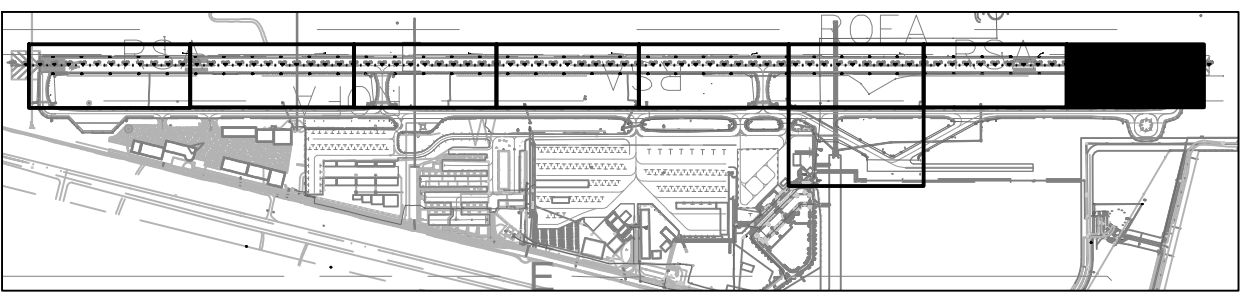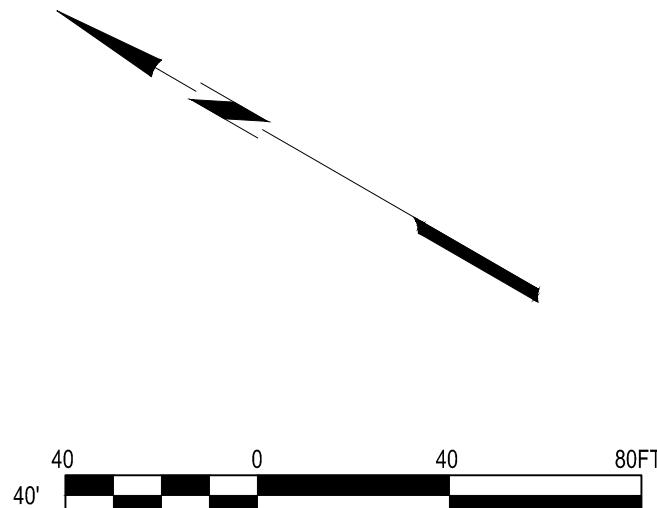

KEY MAP
NTS



C&S Engineers, Inc.




**RUNWAY LIGHTS AND SIGNS
IMPROVEMENT PROJECT**

LAKE HAVASU CITY MUNICIPAL AIRPORT
LAKE HAVASU CITY, AIRIZONA

MARK	DATE	DESCRIPTION
REVISIONS		
PROJECT NO: K33004009		
DATE: MARCH 2025		
DRAWN BY: JBW		
DESIGNED BY: SW		
CHECKED BY: CA		

**AIRFIELD
ELECTRICAL
DEMOLITION
PLAN**


ED-108

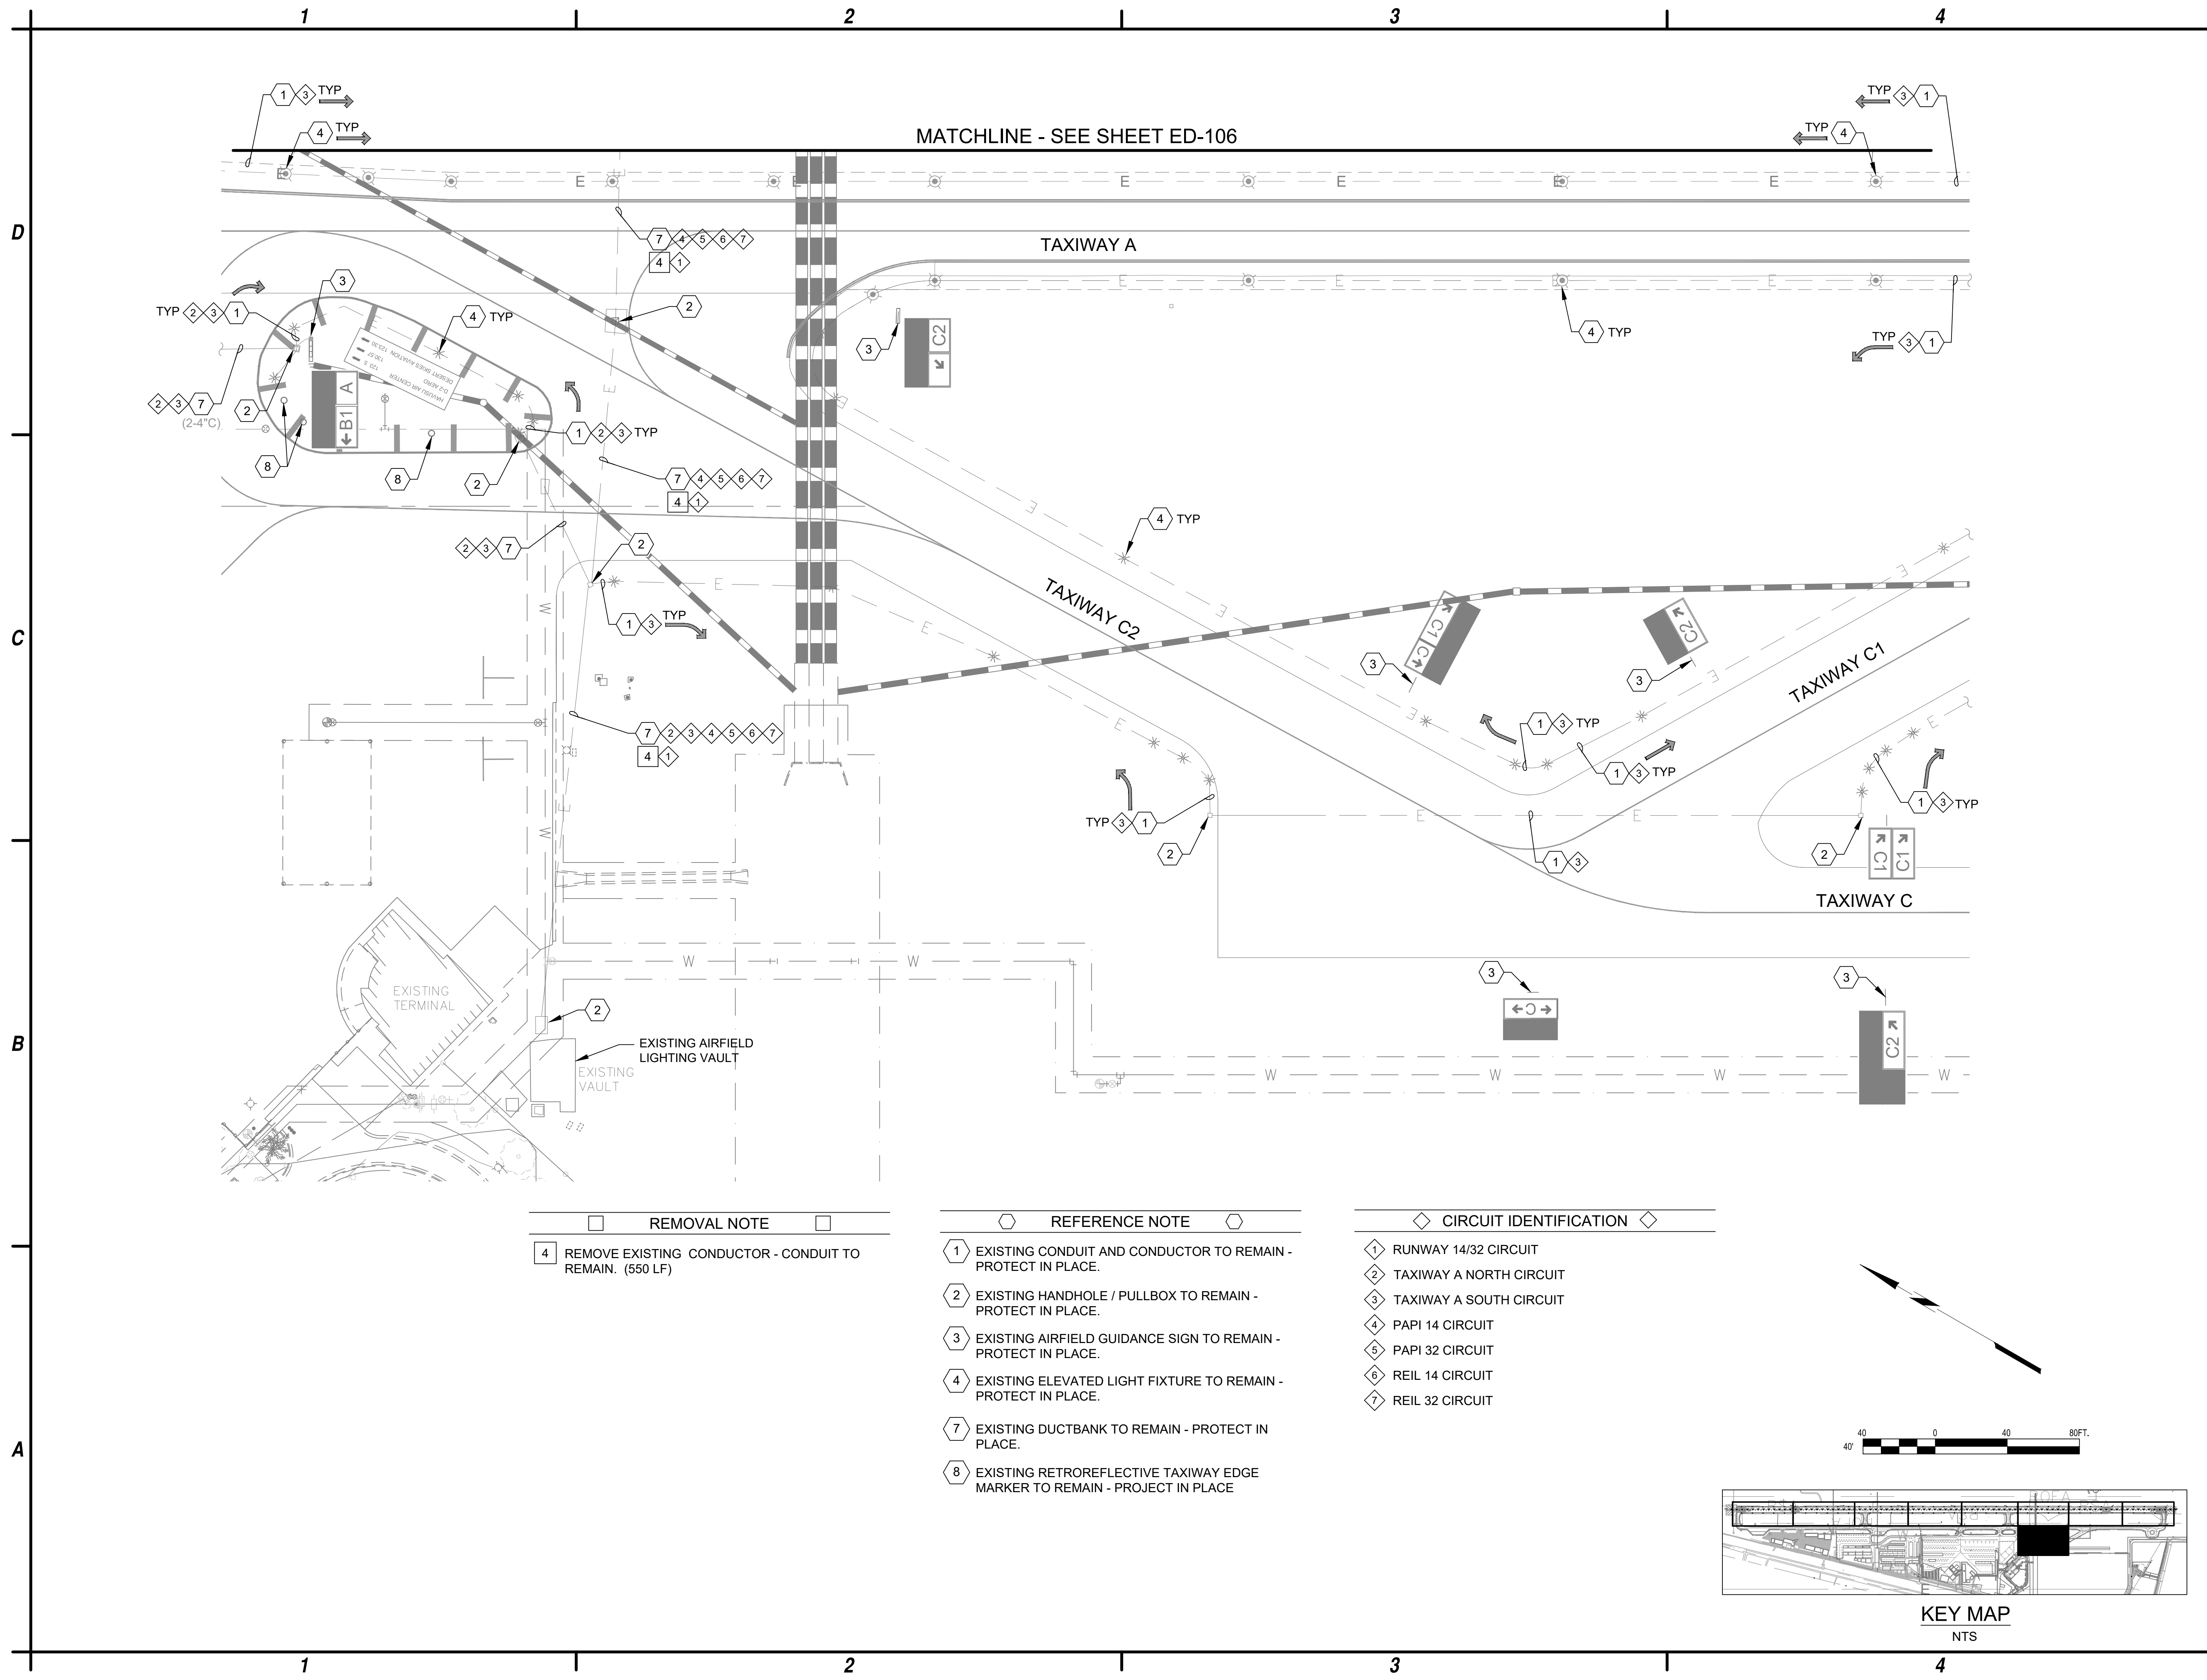

REMOVAL NOTE	
4	REMOVE EXISTING CONDUCTOR - CONDUIT TO REMAIN. (550 LF)

REFERENCE NOTE	
1	EXISTING CONDUIT AND CONDUCTOR TO REMAIN - PROTECT IN PLACE.
2	EXISTING HANDHOLE / PULLBOX TO REMAIN - PROTECT IN PLACE.
3	EXISTING AIRFIELD GUIDANCE SIGN TO REMAIN - PROTECT IN PLACE.
4	EXISTING ELEVATED LIGHT FIXTURE TO REMAIN - PROTECT IN PLACE.
7	EXISTING DUCTBANK TO REMAIN - PROTECT IN PLACE.
8	EXISTING RETROREFLECTIVE TAXIWAY EDGE MARKER TO REMAIN - PROJECT IN PLACE


CIRCUIT IDENTIFICATION	
1	RUNWAY 14/32 CIRCUIT
2	TAXIWAY A NORTH CIRCUIT
3	TAXIWAY A SOUTH CIRCUIT
4	PAPI 14 CIRCUIT
5	PAPI 32 CIRCUIT
6	REIL 14 CIRCUIT
7	REIL 32 CIRCUIT

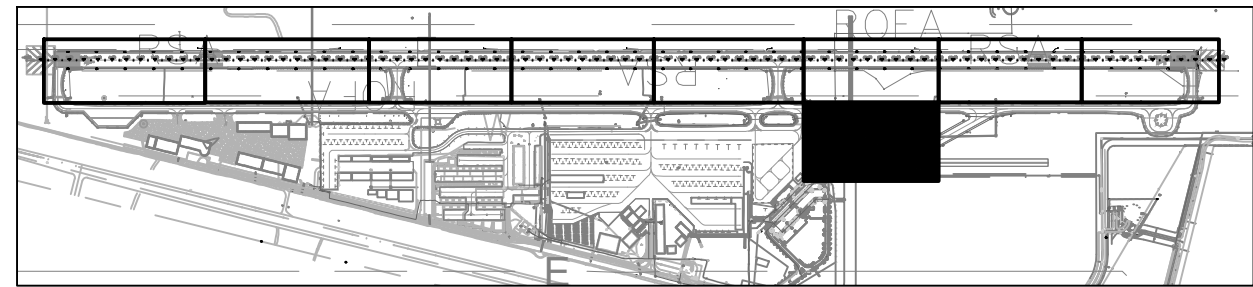

KEY MAP
NTS



C&S Engineers, Inc.

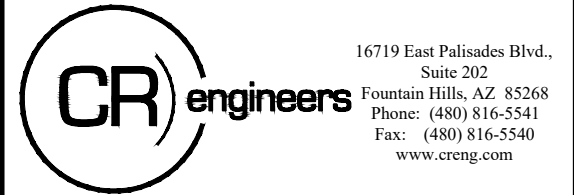

**RUNWAY LIGHTS AND SIGNS
IMPROVEMENT PROJECT**


**LAKE HAVASU CITY MUNICIPAL AIRPORT
LAKE HAVASU CITY, AIRIZONA**

MARK	DATE	DESCRIPTION
REVISIONS		
PROJECT NO: K33004009		
DATE: MARCH 2025		
DRAWN BY: JBW		
DESIGNED BY: SW		
CHECKED BY: CA		

**AIRFIELD
ELECTRICAL
DEMOLITION
PLAN**

ED-109

15 of 31


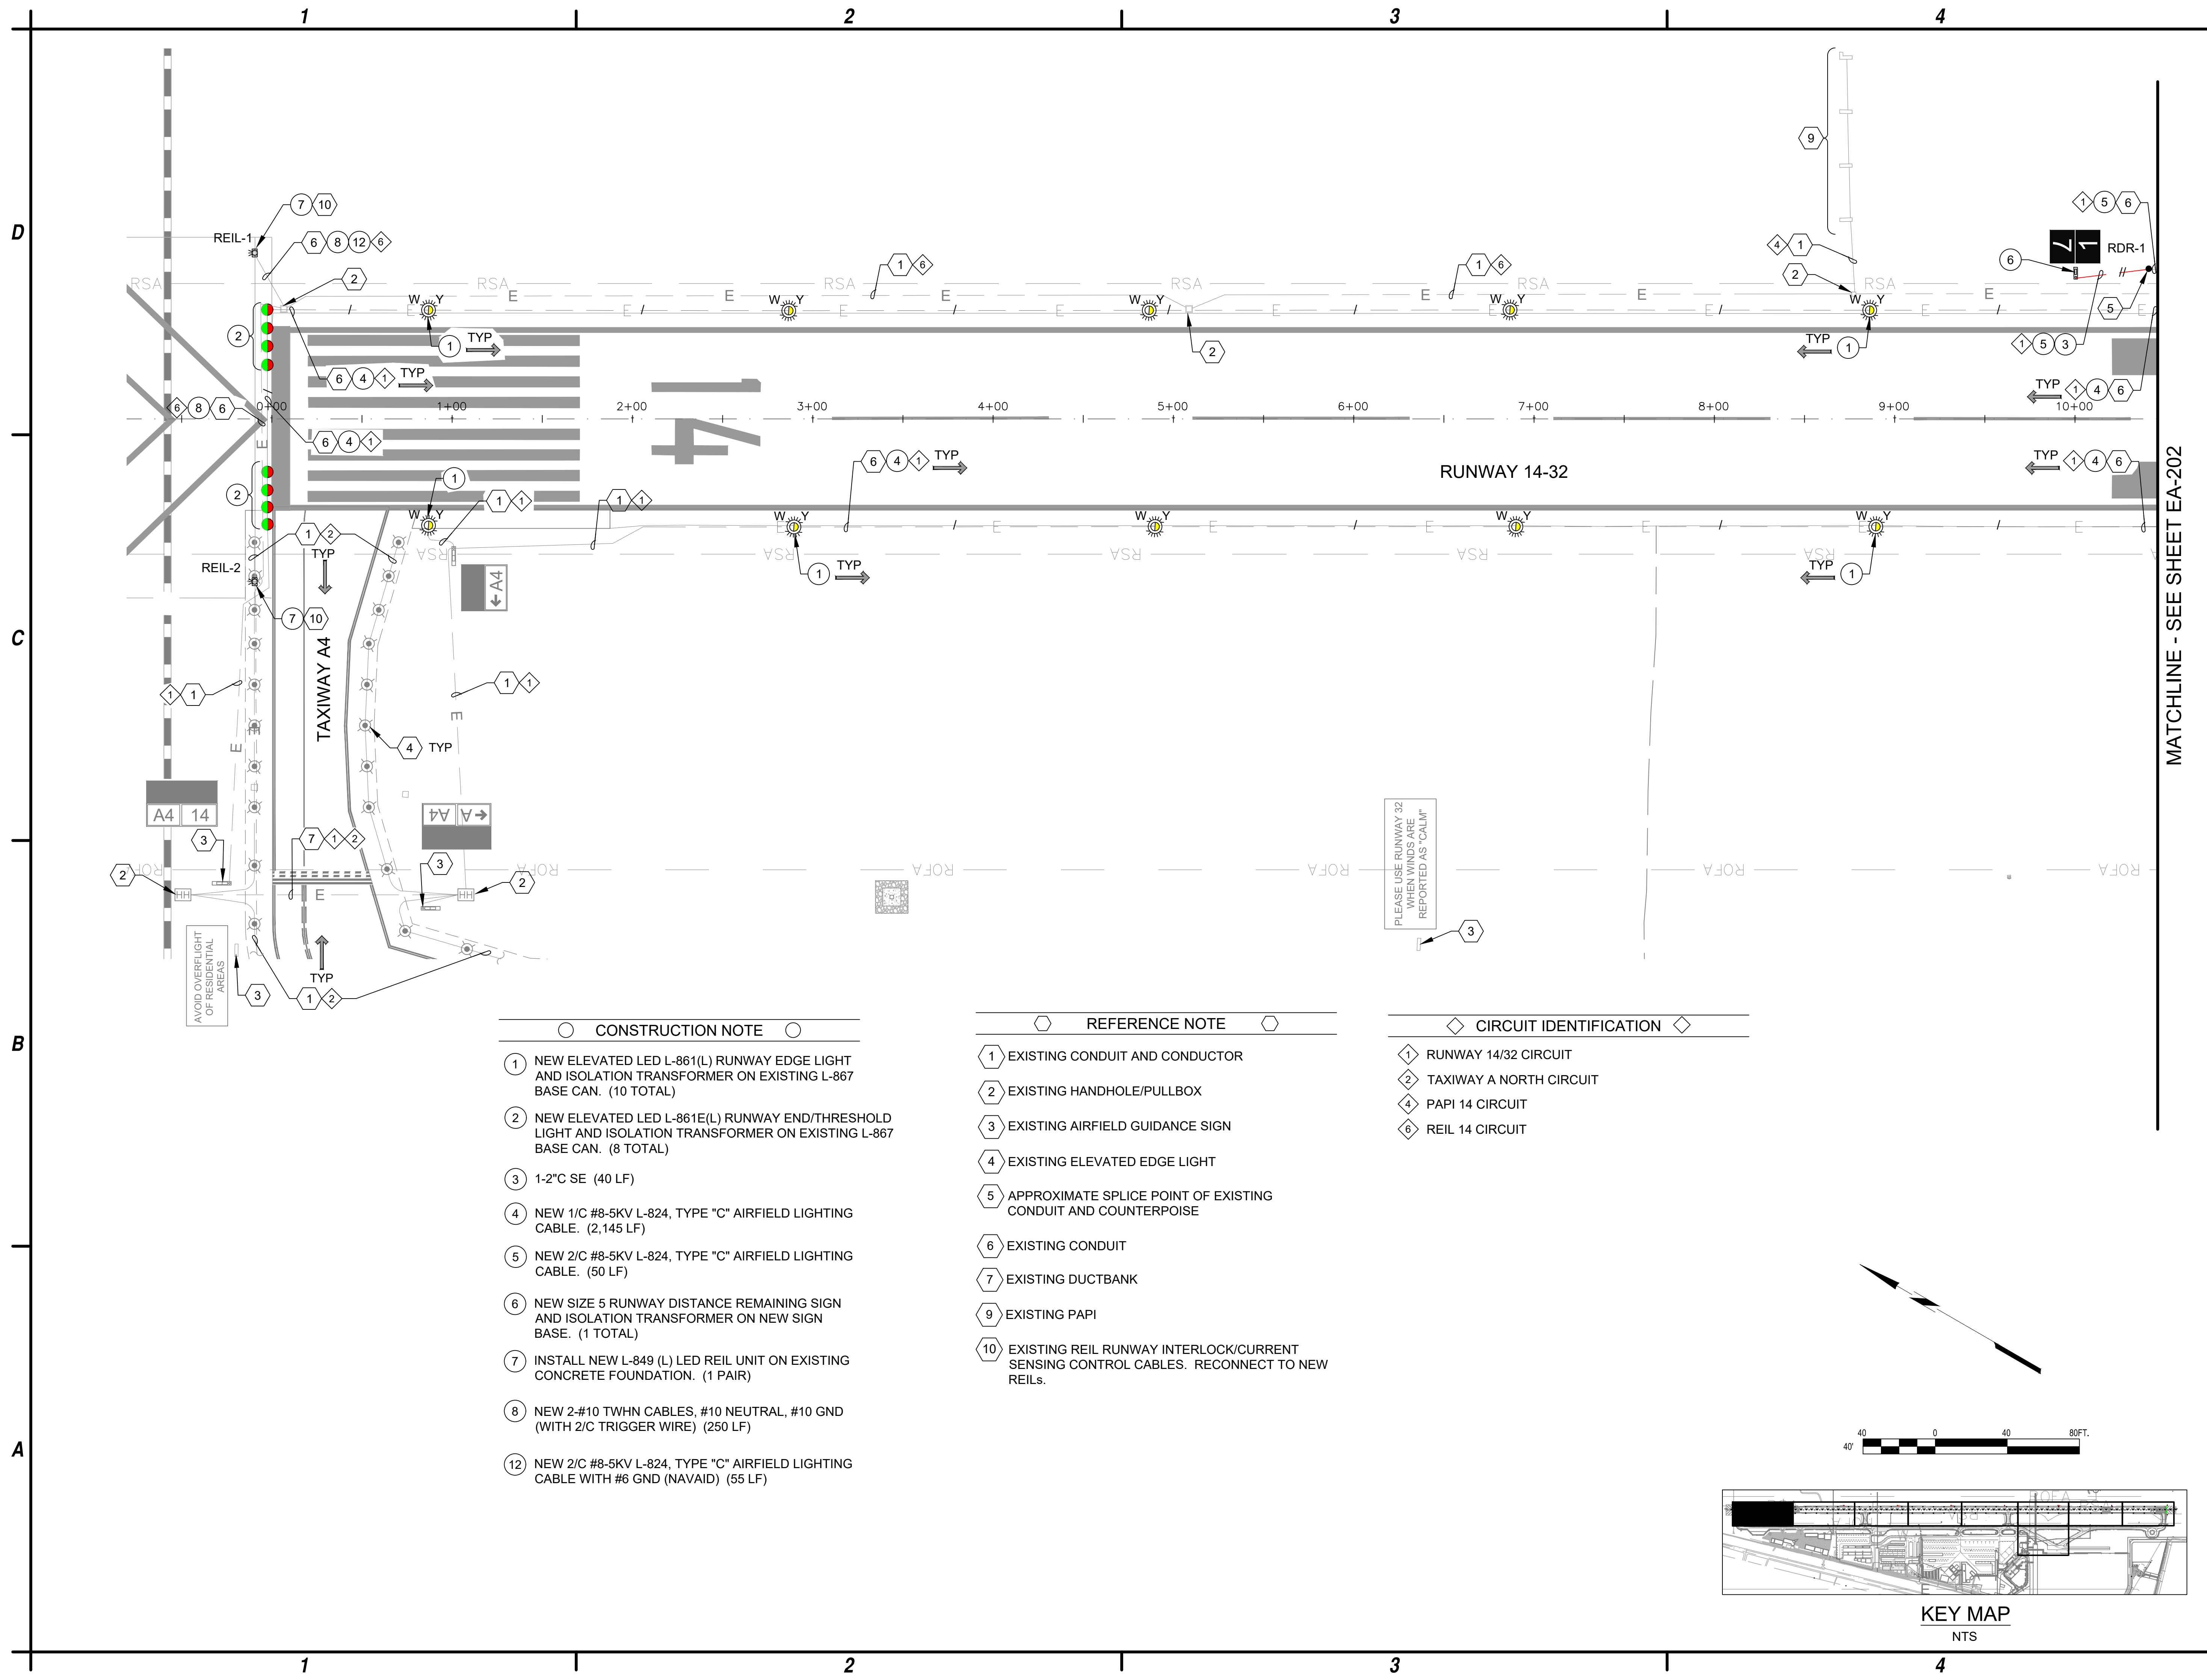


- CONSTRUCTION NOTE ○
- 1 NEW ELEVATED LED L-861(L) RUNWAY EDGE LIGHT AND ISOLATION TRANSFORMER ON EXISTING L-867 BASE CAN. (10 TOTAL)
 - 2 NEW ELEVATED LED L-861E(L) RUNWAY END/THRESHOLD LIGHT AND ISOLATION TRANSFORMER ON EXISTING L-867 BASE CAN. (8 TOTAL)
 - 3 1-2" C SE (40 LF)
 - 4 NEW 1/C #8-5KV L-824, TYPE "C" AIRFIELD LIGHTING CABLE. (2,145 LF)
 - 5 NEW 2/C #8-5KV L-824, TYPE "C" AIRFIELD LIGHTING CABLE. (50 LF)
 - 6 NEW SIZE 5 RUNWAY DISTANCE REMAINING SIGN AND ISOLATION TRANSFORMER ON NEW SIGN BASE. (1 TOTAL)
 - 7 INSTALL NEW L-849 (L) LED REIL UNIT ON EXISTING CONCRETE FOUNDATION. (1 PAIR)
 - 8 NEW 2-#10 TWHN CABLES, #10 NEUTRAL, #10 GND (WITH 2/C TRIGGER WIRE) (250 LF)
 - 12 NEW 2/C #8-5KV L-824, TYPE "C" AIRFIELD LIGHTING CABLE WITH #6 GND (NAVAID) (55 LF)

- REFERENCE NOTE ○
- 1 EXISTING CONDUIT AND CONDUCTOR
 - 2 EXISTING HANDHOLE/PULLBOX
 - 3 EXISTING AIRFIELD GUIDANCE SIGN
 - 4 EXISTING ELEVATED EDGE LIGHT
 - 5 APPROXIMATE SPLICE POINT OF EXISTING CONDUIT AND COUNTERPOISE
 - 6 EXISTING CONDUIT
 - 7 EXISTING DUCTBANK
 - 9 EXISTING PAPI
 - 10 EXISTING REIL RUNWAY INTERLOCK/CURRENT SENSING CONTROL CABLES. RECONNECT TO NEW REILs.

- ◇ CIRCUIT IDENTIFICATION ◇
- 1 RUNWAY 14/32 CIRCUIT
 - 2 TAXIWAY A NORTH CIRCUIT
 - 4 PAPI 14 CIRCUIT
 - 6 REIL 14 CIRCUIT

PLEASE USE RUNWAY 32 WHEN WINDS ARE REPORTED AS "CALM"

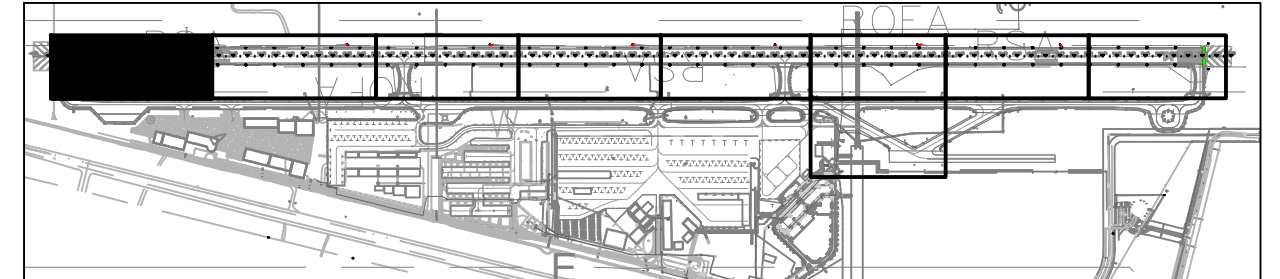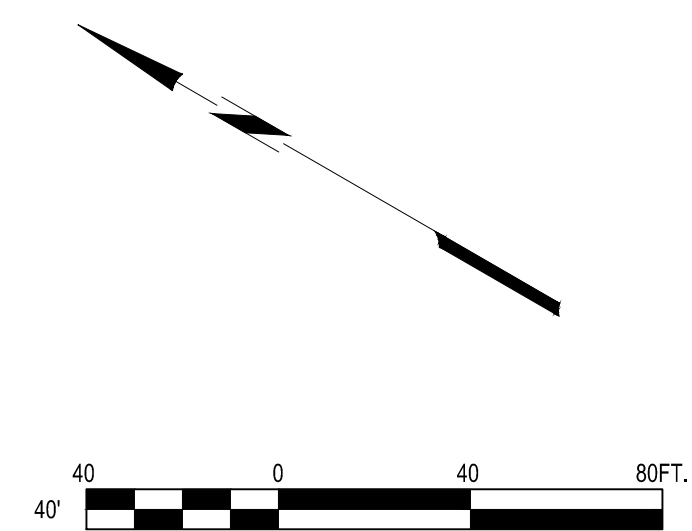

KEY MAP
NTS

MATCHLINE - SEE SHEET EA-202

C&S Engineers, Inc.

16719 East Palmdale Blvd., Suite 302
Fountain Hills, AZ 85268
Phone: (480) 816-5541
Fax: (480) 816-5540
www.creng.com

16719 East Palmdale Blvd., Suite 302
Fountain Hills, AZ 85268
Phone: (480) 816-5541
Fax: (480) 816-5540
www.creng.com

Catherine Alcorn

LAKE HAVASU CITY, ARIZONA
INCORPORATED 1978

**RUNWAY LIGHTS AND SIGNS
IMPROVEMENT PROJECT**

**LAKE HAVASU CITY MUNICIPAL AIRPORT
LAKE HAVASU CITY, AIRIZONA**


MARK	DATE	DESCRIPTION
REVISIONS		
PROJECT NO: K33004009		
DATE: MARCH 2025		
DRAWN BY: JBW		
DESIGNED BY: SW		
CHECKED BY: CA		

**AIRFIELD
ELECTRICAL
PLAN**

EA-201

16 of 31

Mar 17, 2025 - 4:37pm
Q:\PROJECTS\24000\24016 Lake Havasu Airport MIRLS, REILs, RDRs\CAD\CAD SHEETS\24016 EA-201-EA-209 CONSTRUCTION SHEETS.dwg

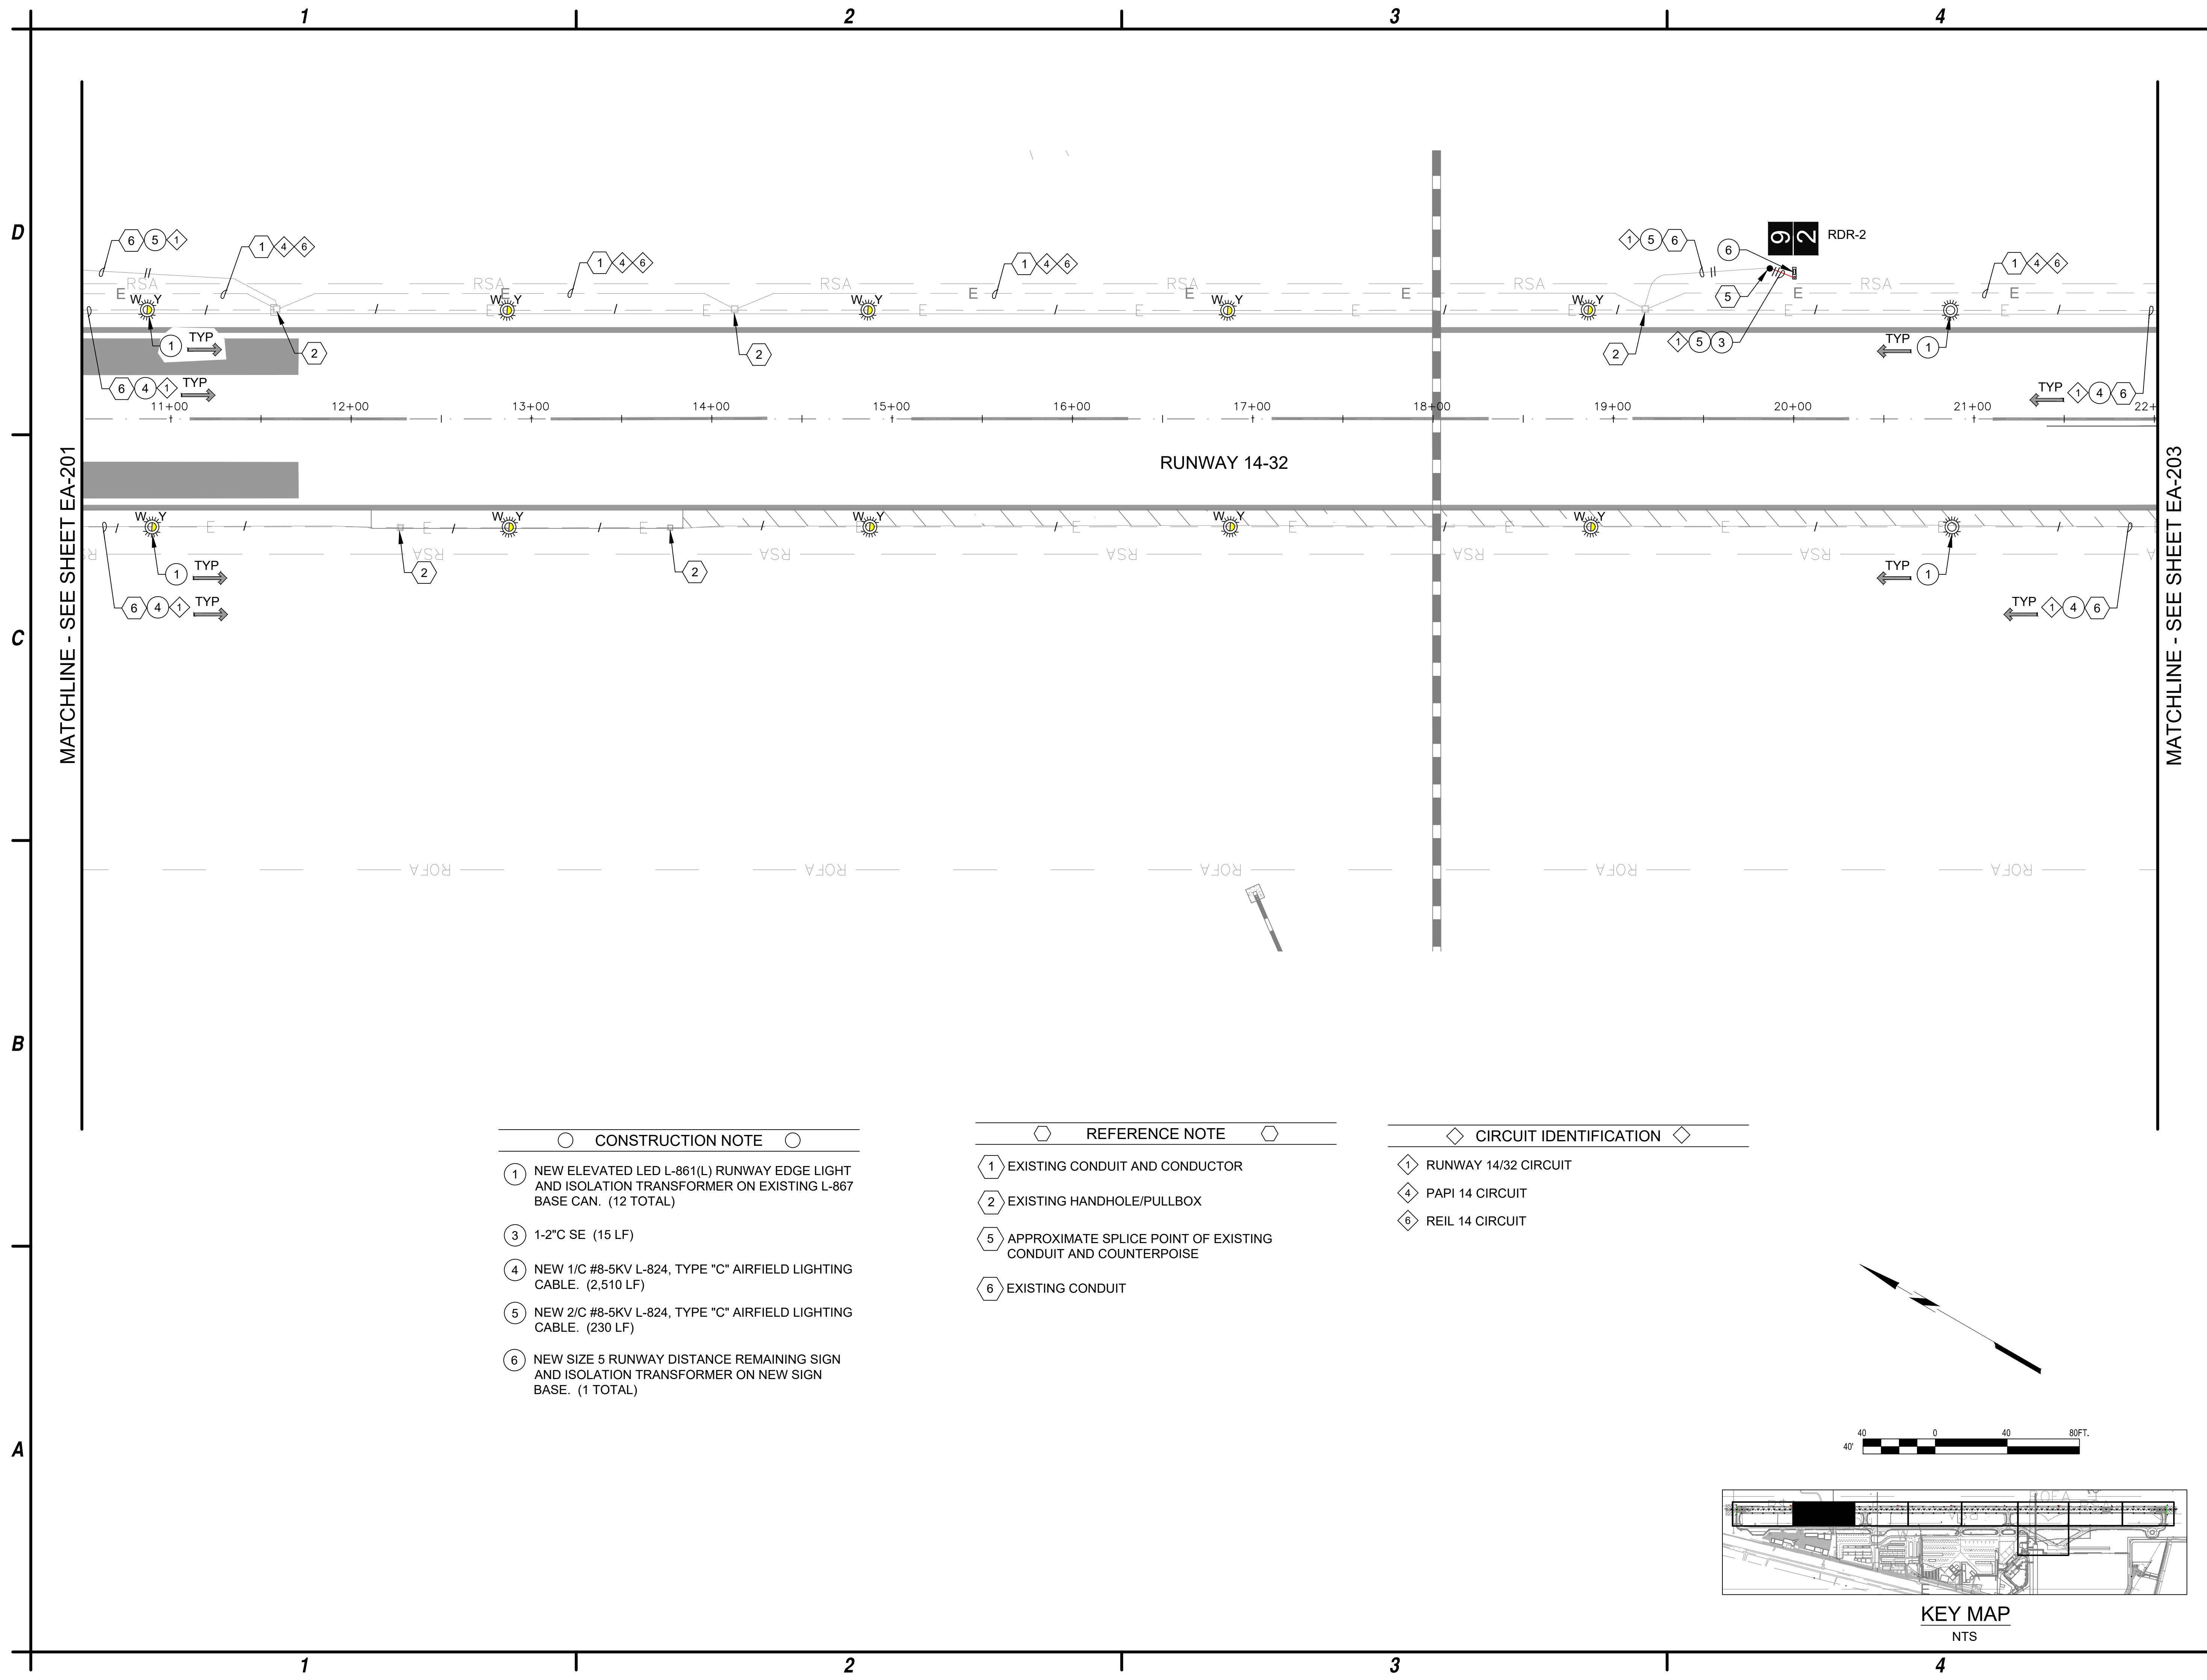



MATCHLINE - SEE SHEET EA-201

MATCHLINE - SEE SHEET EA-203

- CONSTRUCTION NOTE ○
- 1 NEW ELEVATED LED L-861(L) RUNWAY EDGE LIGHT AND ISOLATION TRANSFORMER ON EXISTING L-867 BASE CAN. (12 TOTAL)
 - 3 1-2" C SE (15 LF)
 - 4 NEW 1/C #8-5KV L-824, TYPE "C" AIRFIELD LIGHTING CABLE. (2,510 LF)
 - 5 NEW 2/C #8-5KV L-824, TYPE "C" AIRFIELD LIGHTING CABLE. (230 LF)
 - 6 NEW SIZE 5 RUNWAY DISTANCE REMAINING SIGN AND ISOLATION TRANSFORMER ON NEW SIGN BASE. (1 TOTAL)

- REFERENCE NOTE ○
- 1 EXISTING CONDUIT AND CONDUCTOR
 - 2 EXISTING HANDHOLE/PULLBOX
 - 5 APPROXIMATE SPLICE POINT OF EXISTING CONDUIT AND COUNTERPOISE
 - 6 EXISTING CONDUIT

- ◇ CIRCUIT IDENTIFICATION ◇
- 1 RUNWAY 14/32 CIRCUIT
 - 4 PAPI 14 CIRCUIT
 - 6 REIL 14 CIRCUIT

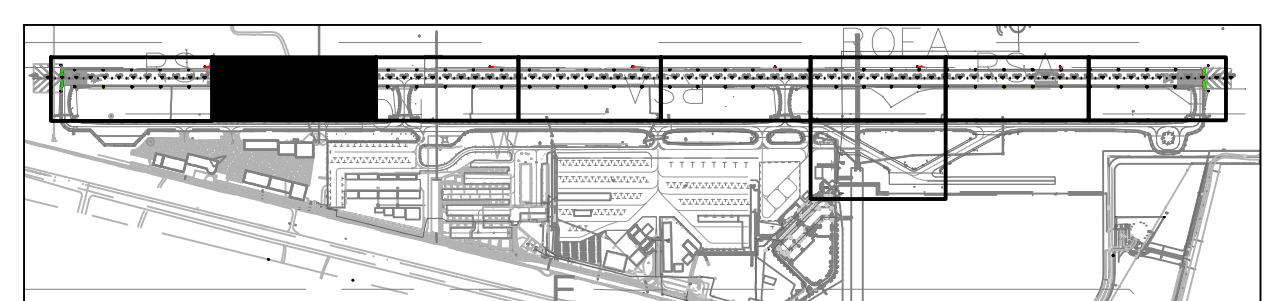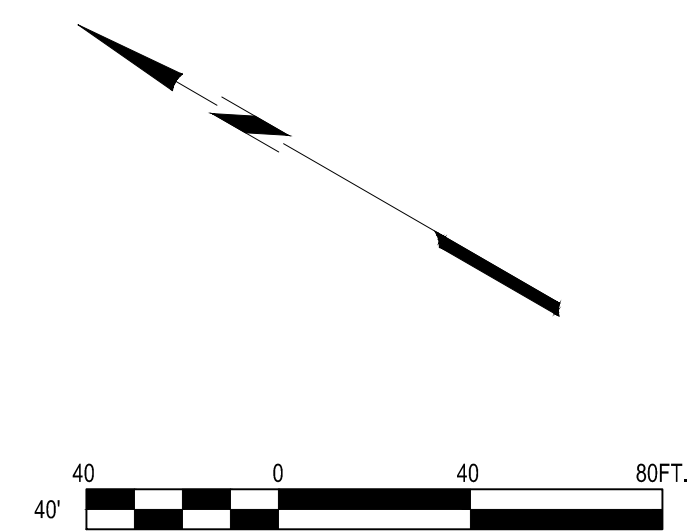

KEY MAP
NTS

C&S
COMPANIES

C&S Engineers, Inc.

CR
engineers

16719 East Palmdale Blvd.,
Fountain Hills, AZ 85268
Phone: (480) 816-5541
Fax: (480) 816-5540
www.creng.com

Professional Engineer (Qualified)
36696
CATHERINE
ALCORN
Exp. 12/31/25
ARIZONA, U.S.A.

LAKE HAVASU CITY, ARIZONA
INCORPORATED 1978

**RUNWAY LIGHTS AND SIGNS
IMPROVEMENT PROJECT**

**LAKE HAVASU CITY MUNICIPAL AIRPORT
LAKE HAVASU CITY, AIRIZONA**


MARK	DATE	DESCRIPTION
REVISIONS		
PROJECT NO: K33004009		
DATE: MARCH 2025		
DRAWN BY: JBW		
DESIGNED BY: SW		
CHECKED BY: CA		

**AIRFIELD
ELECTRICAL
PLAN**

EA-202

17 of 31

Mar 17, 2025 - 4:38pm
Q:\PROJECTS\24000\24016 Lake Havasu Airport MIRLS, REILS, RDRs\CAD\CAD SHEETS\24016 EA-201-EA-209 CONSTRUCTION SHEETS.dwg

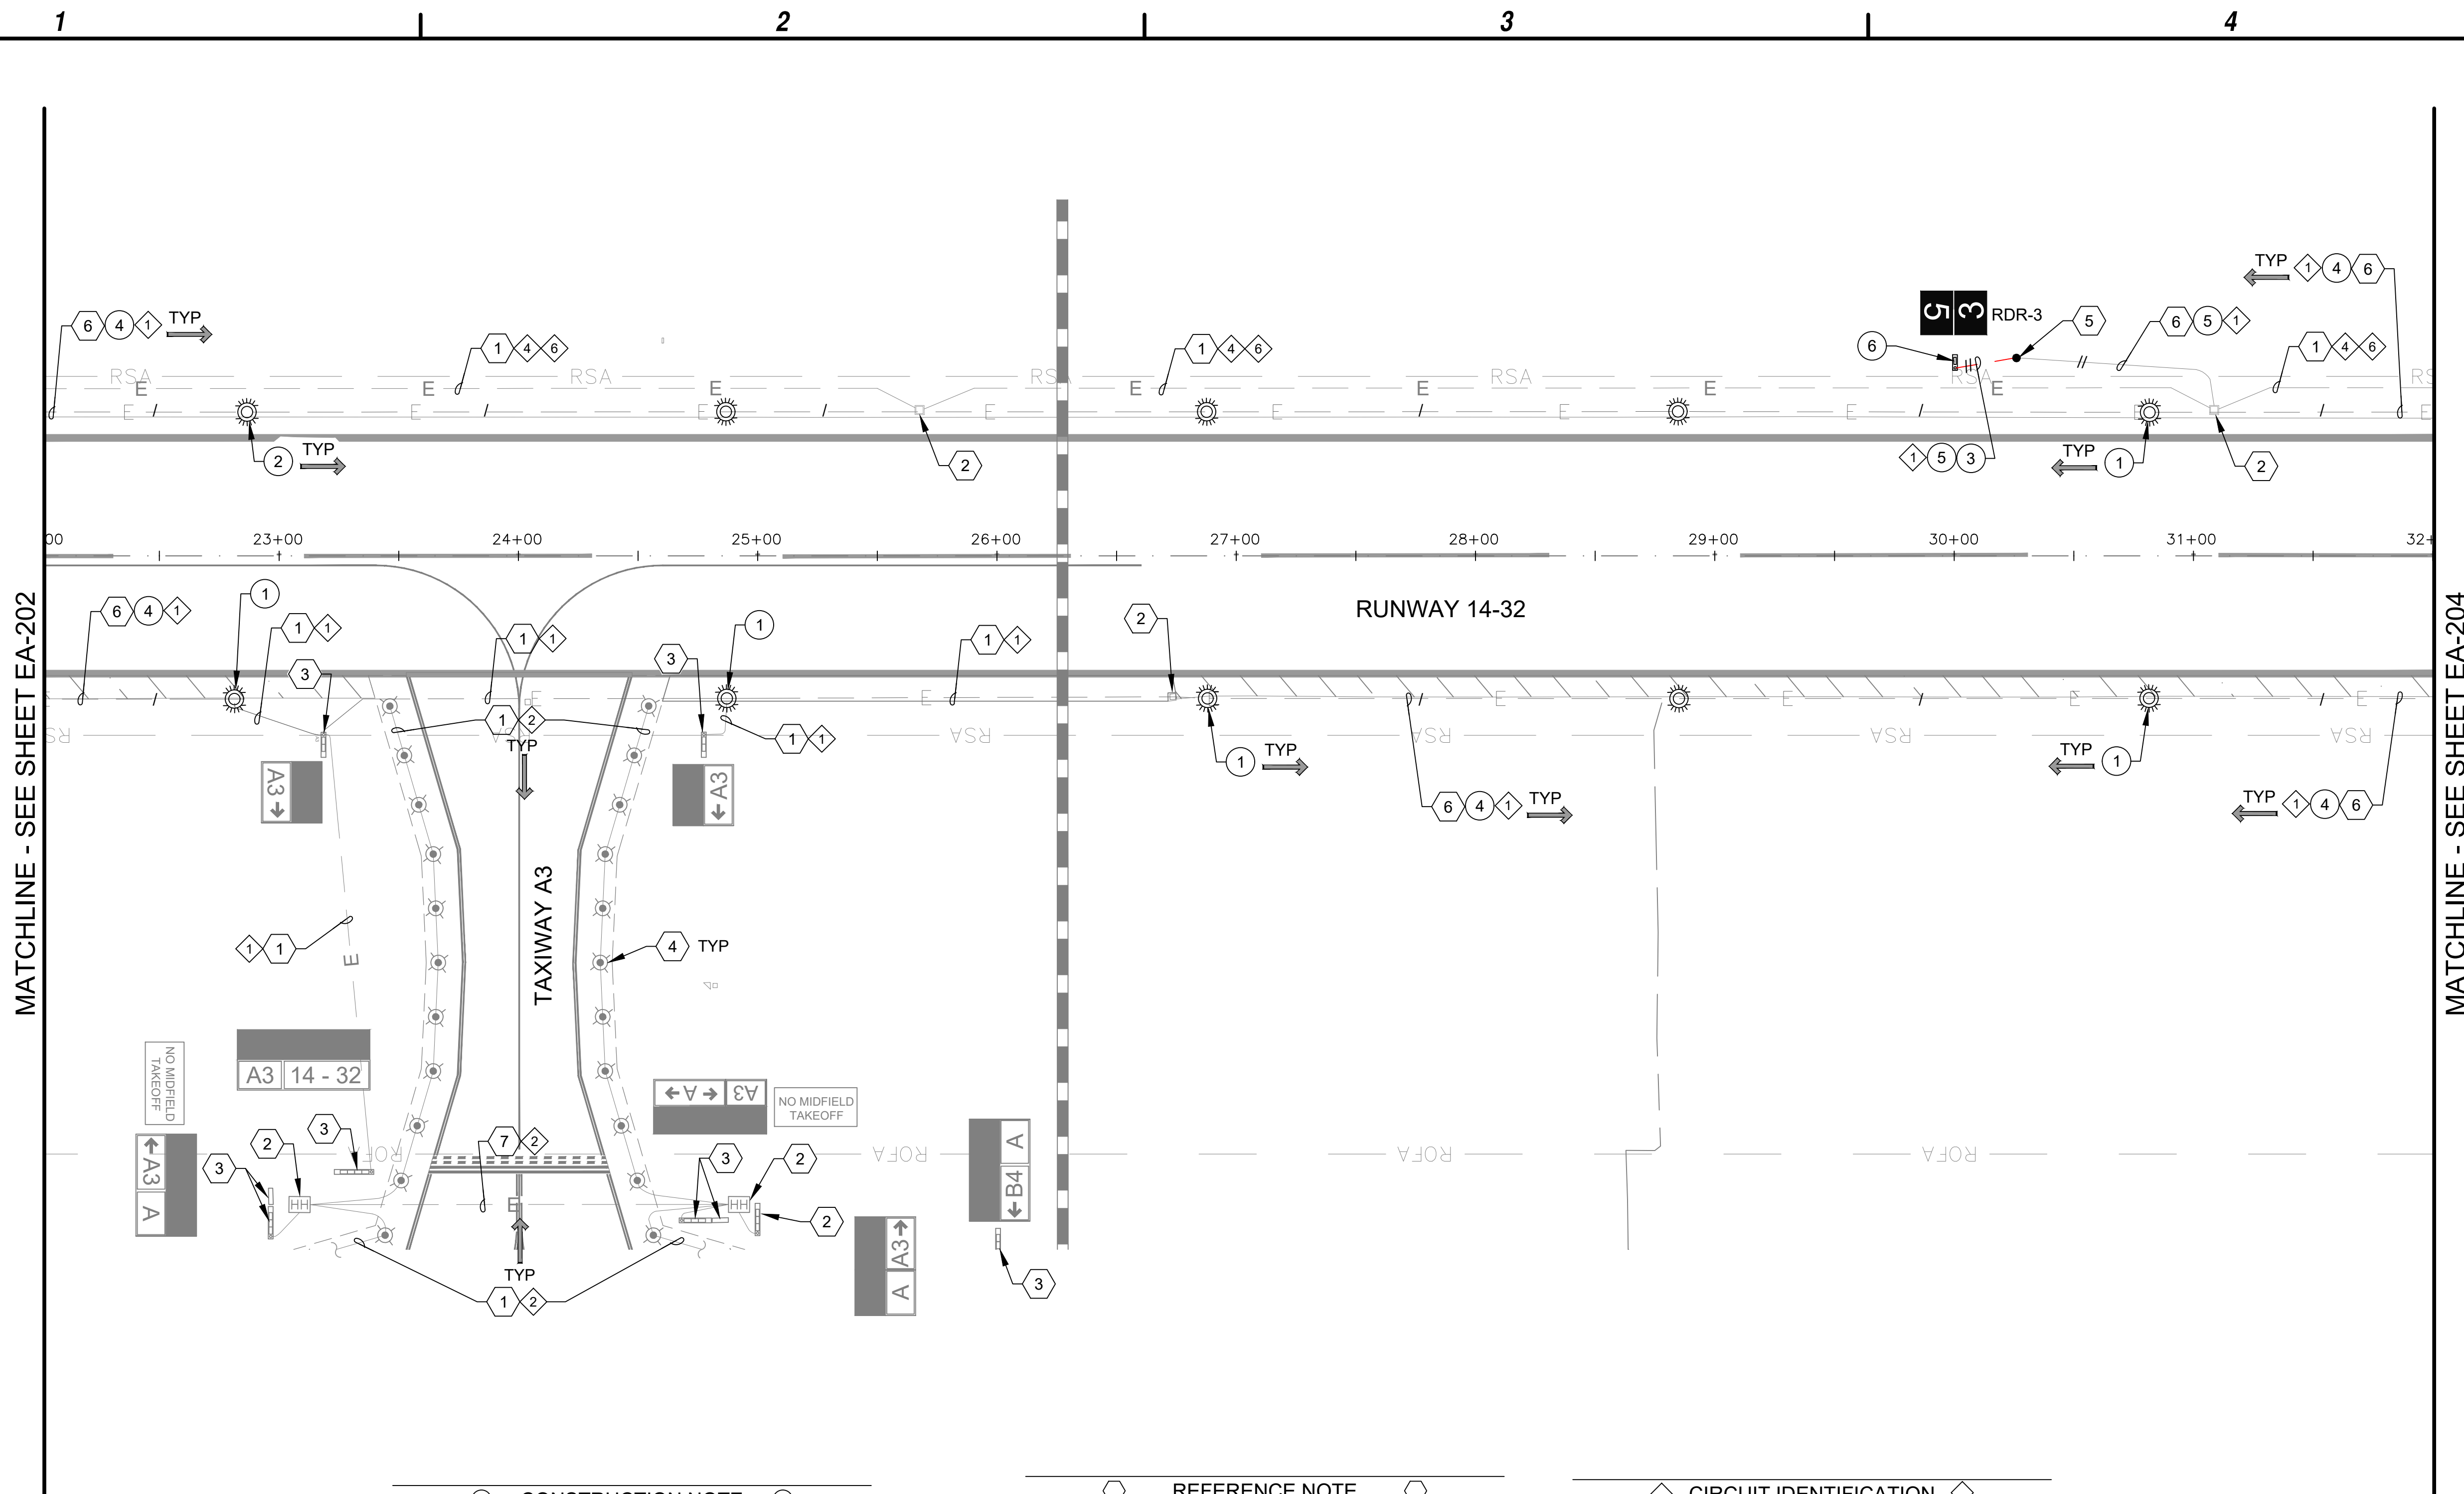



MATCHLINE - SEE SHEET EA-202

MATCHLINE - SEE SHEET EA-204

- CONSTRUCTION NOTE**
- 1 NEW ELEVATED LED L-861(L) RUNWAY EDGE LIGHT AND ISOLATION TRANSFORMER ON EXISTING L-867 BASE CAN. (10 TOTAL)
 - 3 1-2" C SE (25 LF)
 - 4 NEW 1/C #8-5KV L-824, TYPE "C" AIRFIELD LIGHTING CABLE. (1,730 LF)
 - 5 NEW 2/C #8-5KV L-824, TYPE "C" AIRFIELD LIGHTING CABLE. (130 LF)
 - 6 NEW SIZE 5 RUNWAY DISTANCE REMAINING SIGN AND ISOLATION TRANSFORMER ON NEW SIGN BASE. (1 TOTAL)

- REFERENCE NOTE**
- 1 EXISTING CONDUIT AND CONDUCTOR
 - 2 EXISTING HANDHOLE/PULLBOX
 - 3 EXISTING AIRFIELD GUIDANCE SIGN
 - 4 EXISTING ELEVATED EDGE LIGHT
 - 5 APPROXIMATE SPLICE POINT OF EXISTING CONDUIT AND COUNTERPOISE
 - 6 EXISTING CONDUIT
 - 7 EXISTING DUCTBANK


- CIRCUIT IDENTIFICATION**
- 1 RUNWAY 14/32 CIRCUIT
 - 2 TAXIWAY A NORTH CIRCUIT
 - 4 PAPI 14 CIRCUIT
 - 6 REIL 14 CIRCUIT

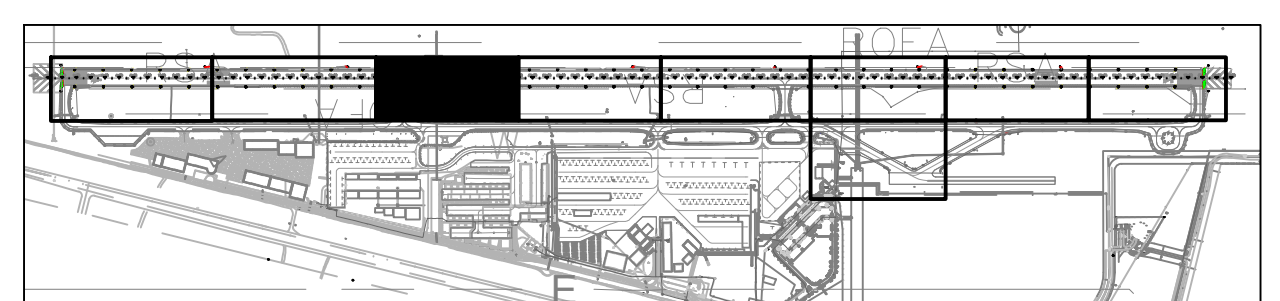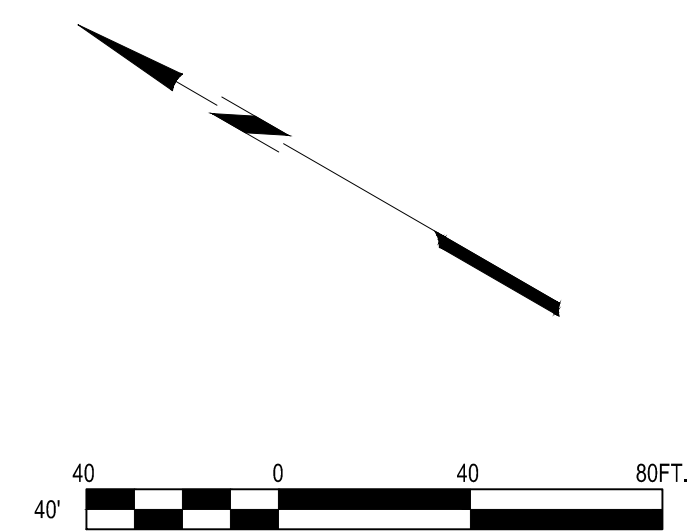

KEY MAP
NTS



C&S Engineers, Inc.

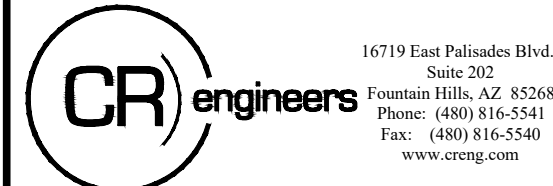

16719 East Palmdale Blvd.,
Suite 302
Fountain Hills, AZ 85268
Phone: (480) 816-5541
Fax: (480) 816-5540
www.creng.com



**RUNWAY LIGHTS AND SIGNS
IMPROVEMENT PROJECT**


LAKE HAVASU CITY MUNICIPAL AIRPORT

LAKE HAVASU CITY, AIRIZONA

MARK	DATE	DESCRIPTION
REVISIONS		
PROJECT NO: K33004009		
DATE: MARCH 2025		
DRAWN BY: JBW		
DESIGNED BY: SW		
CHECKED BY: CA		

**AIRFIELD
ELECTRICAL
PLAN**



EA-203

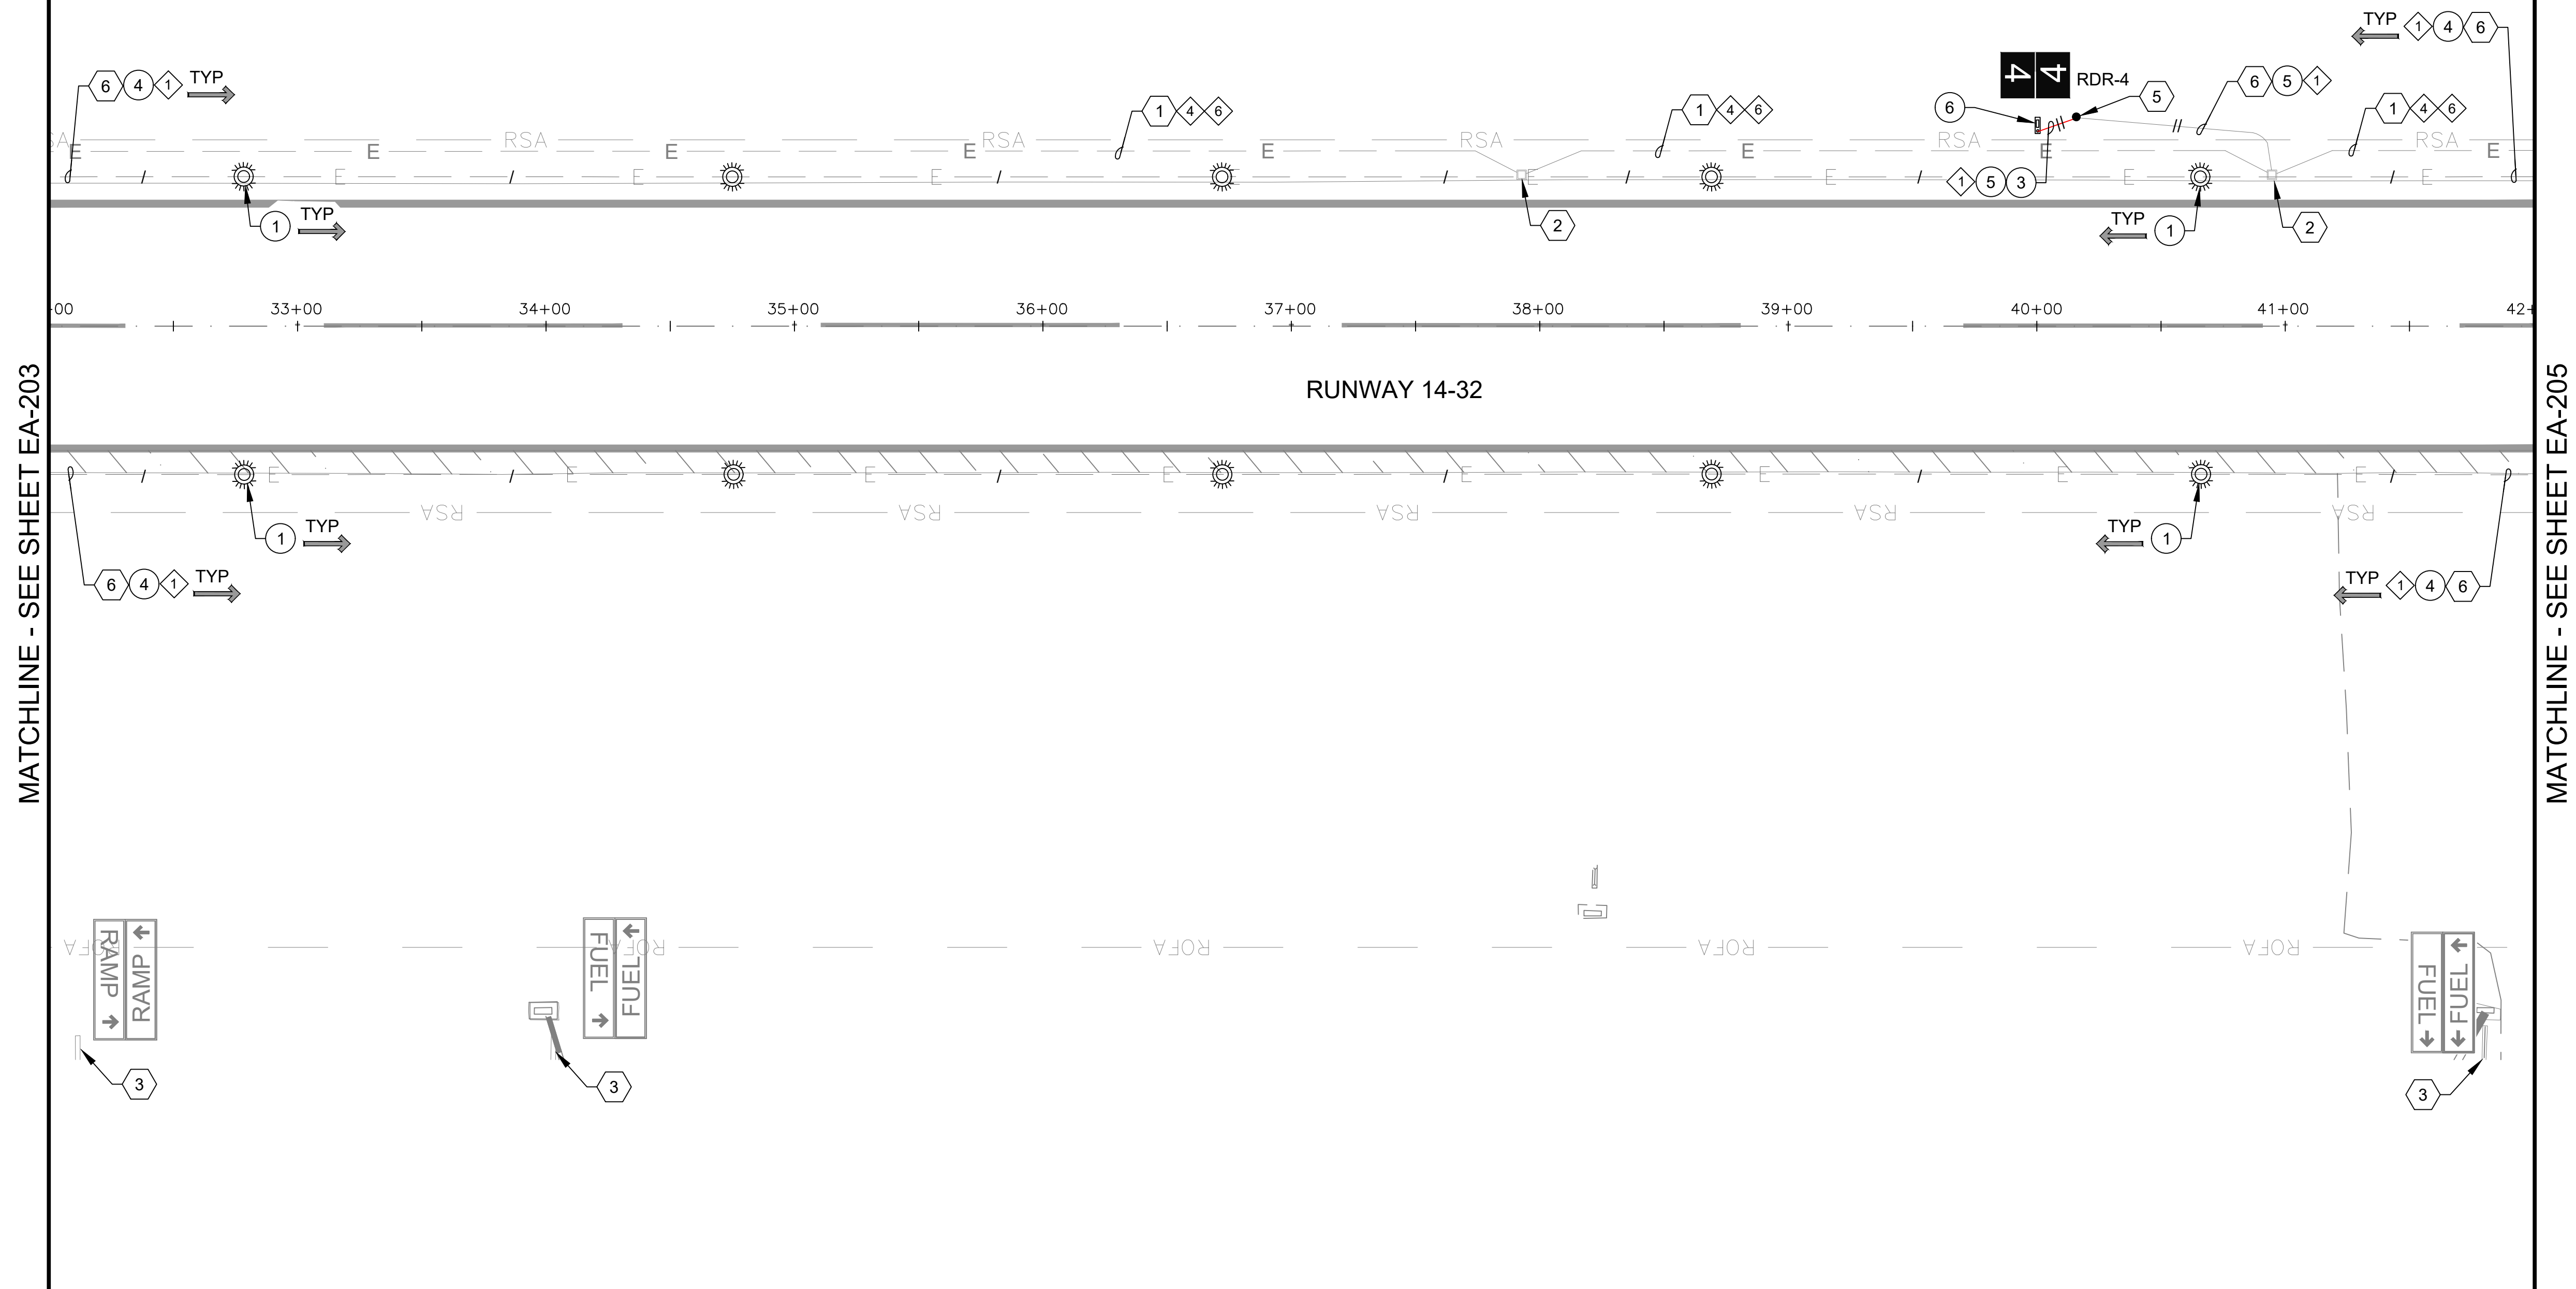

- CONSTRUCTION NOTE
- 1 NEW ELEVATED LED L-861(L) RUNWAY EDGE LIGHT AND ISOLATION TRANSFORMER ON EXISTING L-867 BASE CAN. (10 TOTAL)
 - 3 1-2" C SE (20 LF)
 - 4 NEW 1/C #8-5KV L-824, TYPE "C" AIRFIELD LIGHTING CABLE. (2,160 LF)
 - 5 NEW 2/C #8-5KV L-824, TYPE "C" AIRFIELD LIGHTING CABLE. (115 LF)
 - 6 NEW SIZE 5 RUNWAY DISTANCE REMAINING SIGN AND ISOLATION TRANSFORMER ON NEW SIGN BASE. (1 TOTAL)

- REFERENCE NOTE
- 1 EXISTING CONDUIT AND CONDUCTOR
 - 3 EXISTING AIRFIELD GUIDANCE SIGN
 - 5 APPROXIMATE SPLICE POINT OF EXISTING CONDUIT AND COUNTERPOISE
 - 6 EXISTING CONDUIT

- CIRCUIT IDENTIFICATION
- 1 RUNWAY 14/32 CIRCUIT
 - 4 PAPI 14 CIRCUIT
 - 6 REIL 14 CIRCUIT

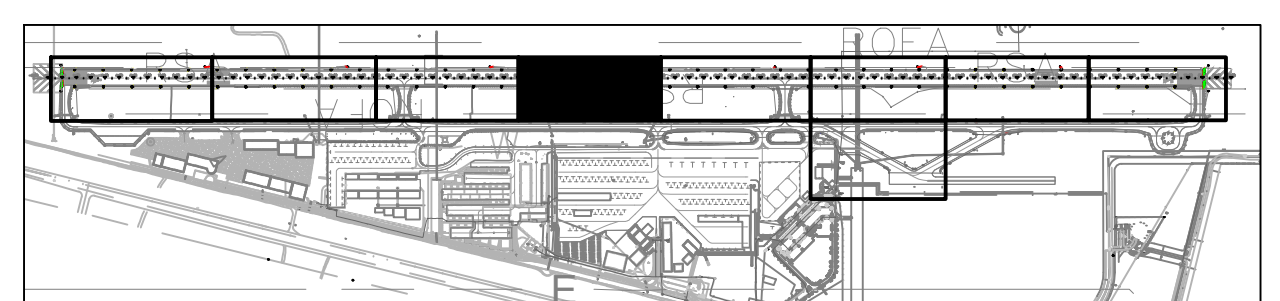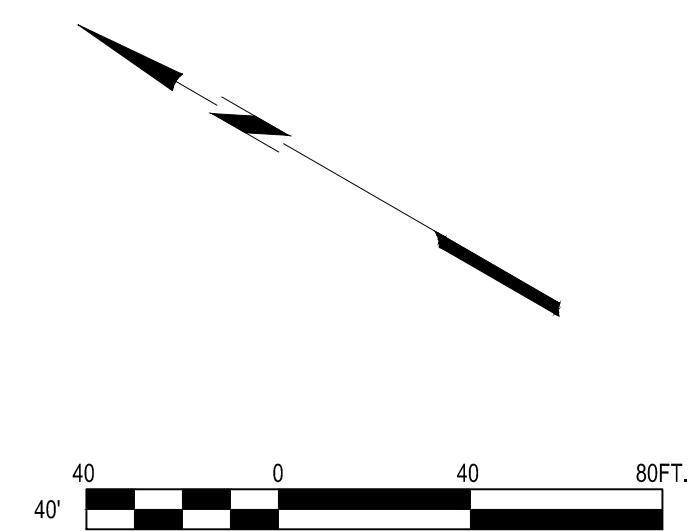

KEY MAP
NTS

C&S Engineers, Inc.

CR engineers

16719 East Palmdale Blvd., Suite 202
Fountain Hills, AZ 85268
Phone: (480) 816-5541
Fax: (480) 816-5540
www.creng.com

Professional Engineer (Qualified)
36696
CATHERINE
ALCORN
State of Arizona, U.S.A.
Catherine Alcorn

LAKE HAVASU CITY, ARIZONA
INCORPORATED 1978

**RUNWAY LIGHTS AND SIGNS
IMPROVEMENT PROJECT**

**LAKE HAVASU CITY MUNICIPAL AIRPORT
LAKE HAVASU CITY, AIRIZONA**


MARK	DATE	DESCRIPTION
REVISIONS		
PROJECT NO: K33004009		
DATE: MARCH 2025		
DRAWN BY: JBW		
DESIGNED BY: SW		
CHECKED BY: CA		

**AIRFIELD
ELECTRICAL
PLAN**

EA-204

19 of 31



Mar 17, 2025 - 4:38pm
Q:\PROJECTS\24000\24016 Lake Havasu Airport_MIRLS, RDRs\CAD\CAD SHEETS\24016 EA-201-EA-209 CONSTRUCTION SHEETS.dwg

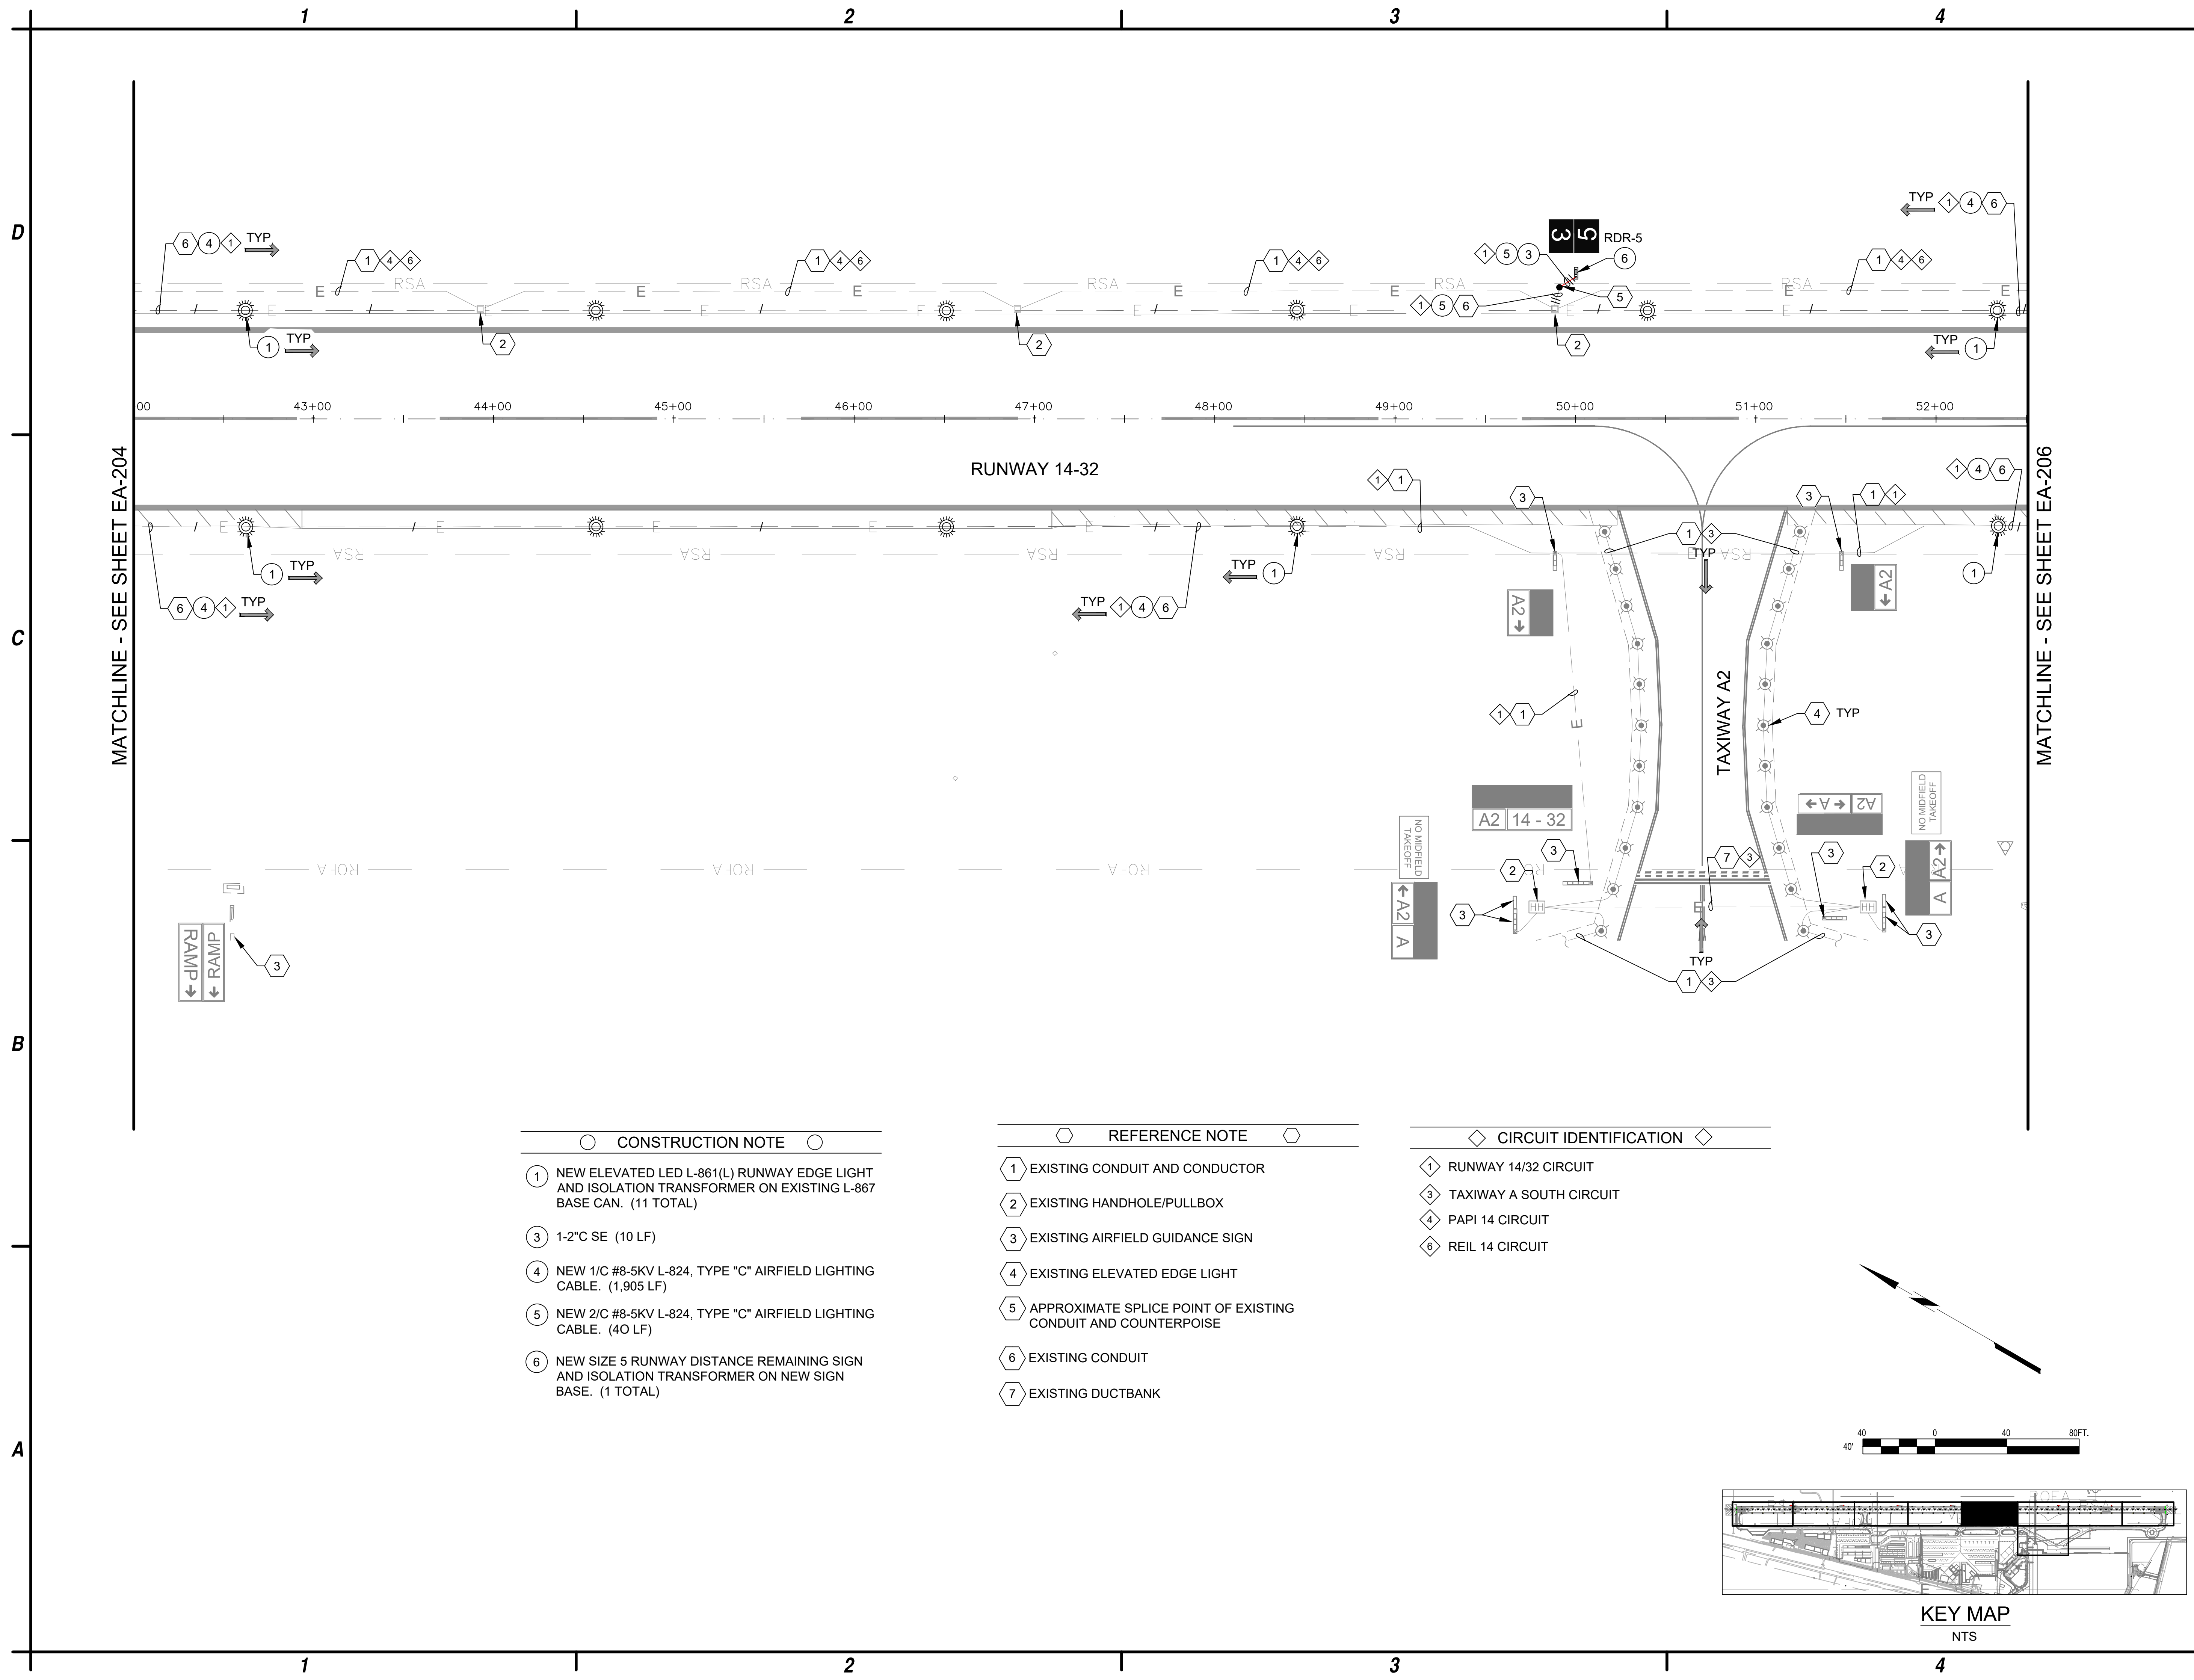

- CONSTRUCTION NOTE ○
- ① NEW ELEVATED LED L-861(L) RUNWAY EDGE LIGHT AND ISOLATION TRANSFORMER ON EXISTING L-867 BASE CAN. (11 TOTAL)
 - ③ 1-2" C SE (10 LF)
 - ④ NEW 1/C #8-5KV L-824, TYPE "C" AIRFIELD LIGHTING CABLE. (1,905 LF)
 - ⑤ NEW 2/C #8-5KV L-824, TYPE "C" AIRFIELD LIGHTING CABLE. (40 LF)
 - ⑥ NEW SIZE 5 RUNWAY DISTANCE REMAINING SIGN AND ISOLATION TRANSFORMER ON NEW SIGN BASE. (1 TOTAL)

- ◇ REFERENCE NOTE ◇
- ① EXISTING CONDUIT AND CONDUCTOR
 - ② EXISTING HANDHOLE/PULLBOX
 - ③ EXISTING AIRFIELD GUIDANCE SIGN
 - ④ EXISTING ELEVATED EDGE LIGHT
 - ⑤ APPROXIMATE SPLICE POINT OF EXISTING CONDUIT AND COUNTERPOISE
 - ⑥ EXISTING CONDUIT
 - ⑦ EXISTING DUCTBANK

- ◇ CIRCUIT IDENTIFICATION ◇
- ① RUNWAY 14/32 CIRCUIT
 - ③ TAXIWAY A SOUTH CIRCUIT
 - ④ PAPI 14 CIRCUIT
 - ⑥ REIL 14 CIRCUIT

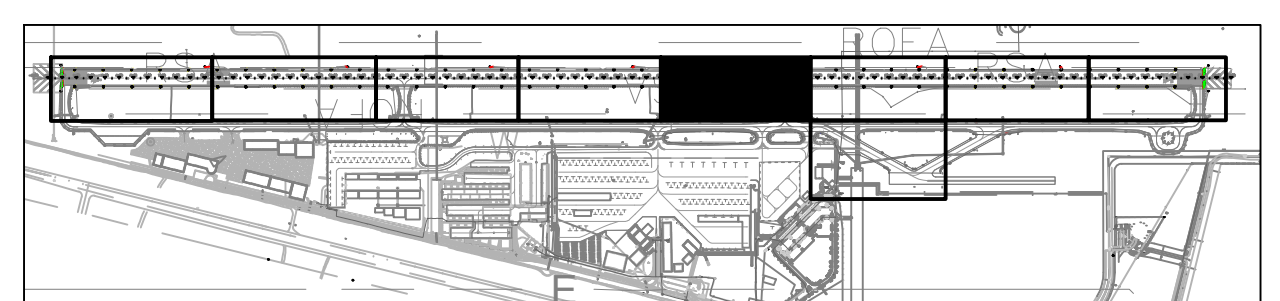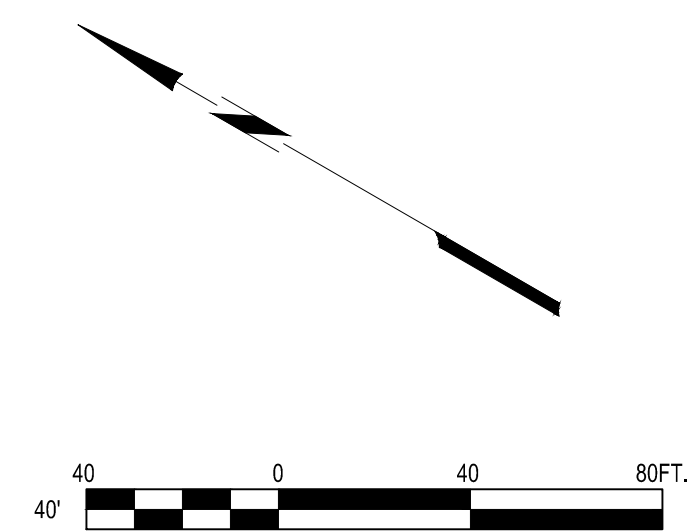

KEY MAP
NTS

C&S
COMPANIES

C&S Engineers, Inc.

CR
engineers

16719 East Palmdale Blvd.,
Suite 302
Fountain Hills, AZ 85268
Phone: (480) 816-5541
Fax: (480) 816-5540
www.creng.com

Professional Engineer (Qualified)
36696
CATHERINE
ALCORN
State of Arizona
Exp. 12/31/2025
Catherine Alcorn

LAKE HAVASU CITY, ARIZONA
INCORPORATED 1978

**RUNWAY LIGHTS AND SIGNS
IMPROVEMENT PROJECT**

**LAKE HAVASU CITY MUNICIPAL AIRPORT
LAKE HAVASU CITY, AIRIZONA**


MARK	DATE	DESCRIPTION
REVISIONS		
PROJECT NO: K33004009		
DATE: MARCH 2025		
DRAWN BY: JBW		
DESIGNED BY: SW		
CHECKED BY: CA		

**AIRFIELD
ELECTRICAL
PLAN**

EA-205

20 of 31



Mar 17, 2025 - 4:38pm
Q:\PROJECTS\24000\24016 Lake Havasu Airport MIRLS, RELS, RDRS\CAD\CAD SHEETS\24016 EA-201-EA-209 CONSTRUCTION SHEETS.dwg

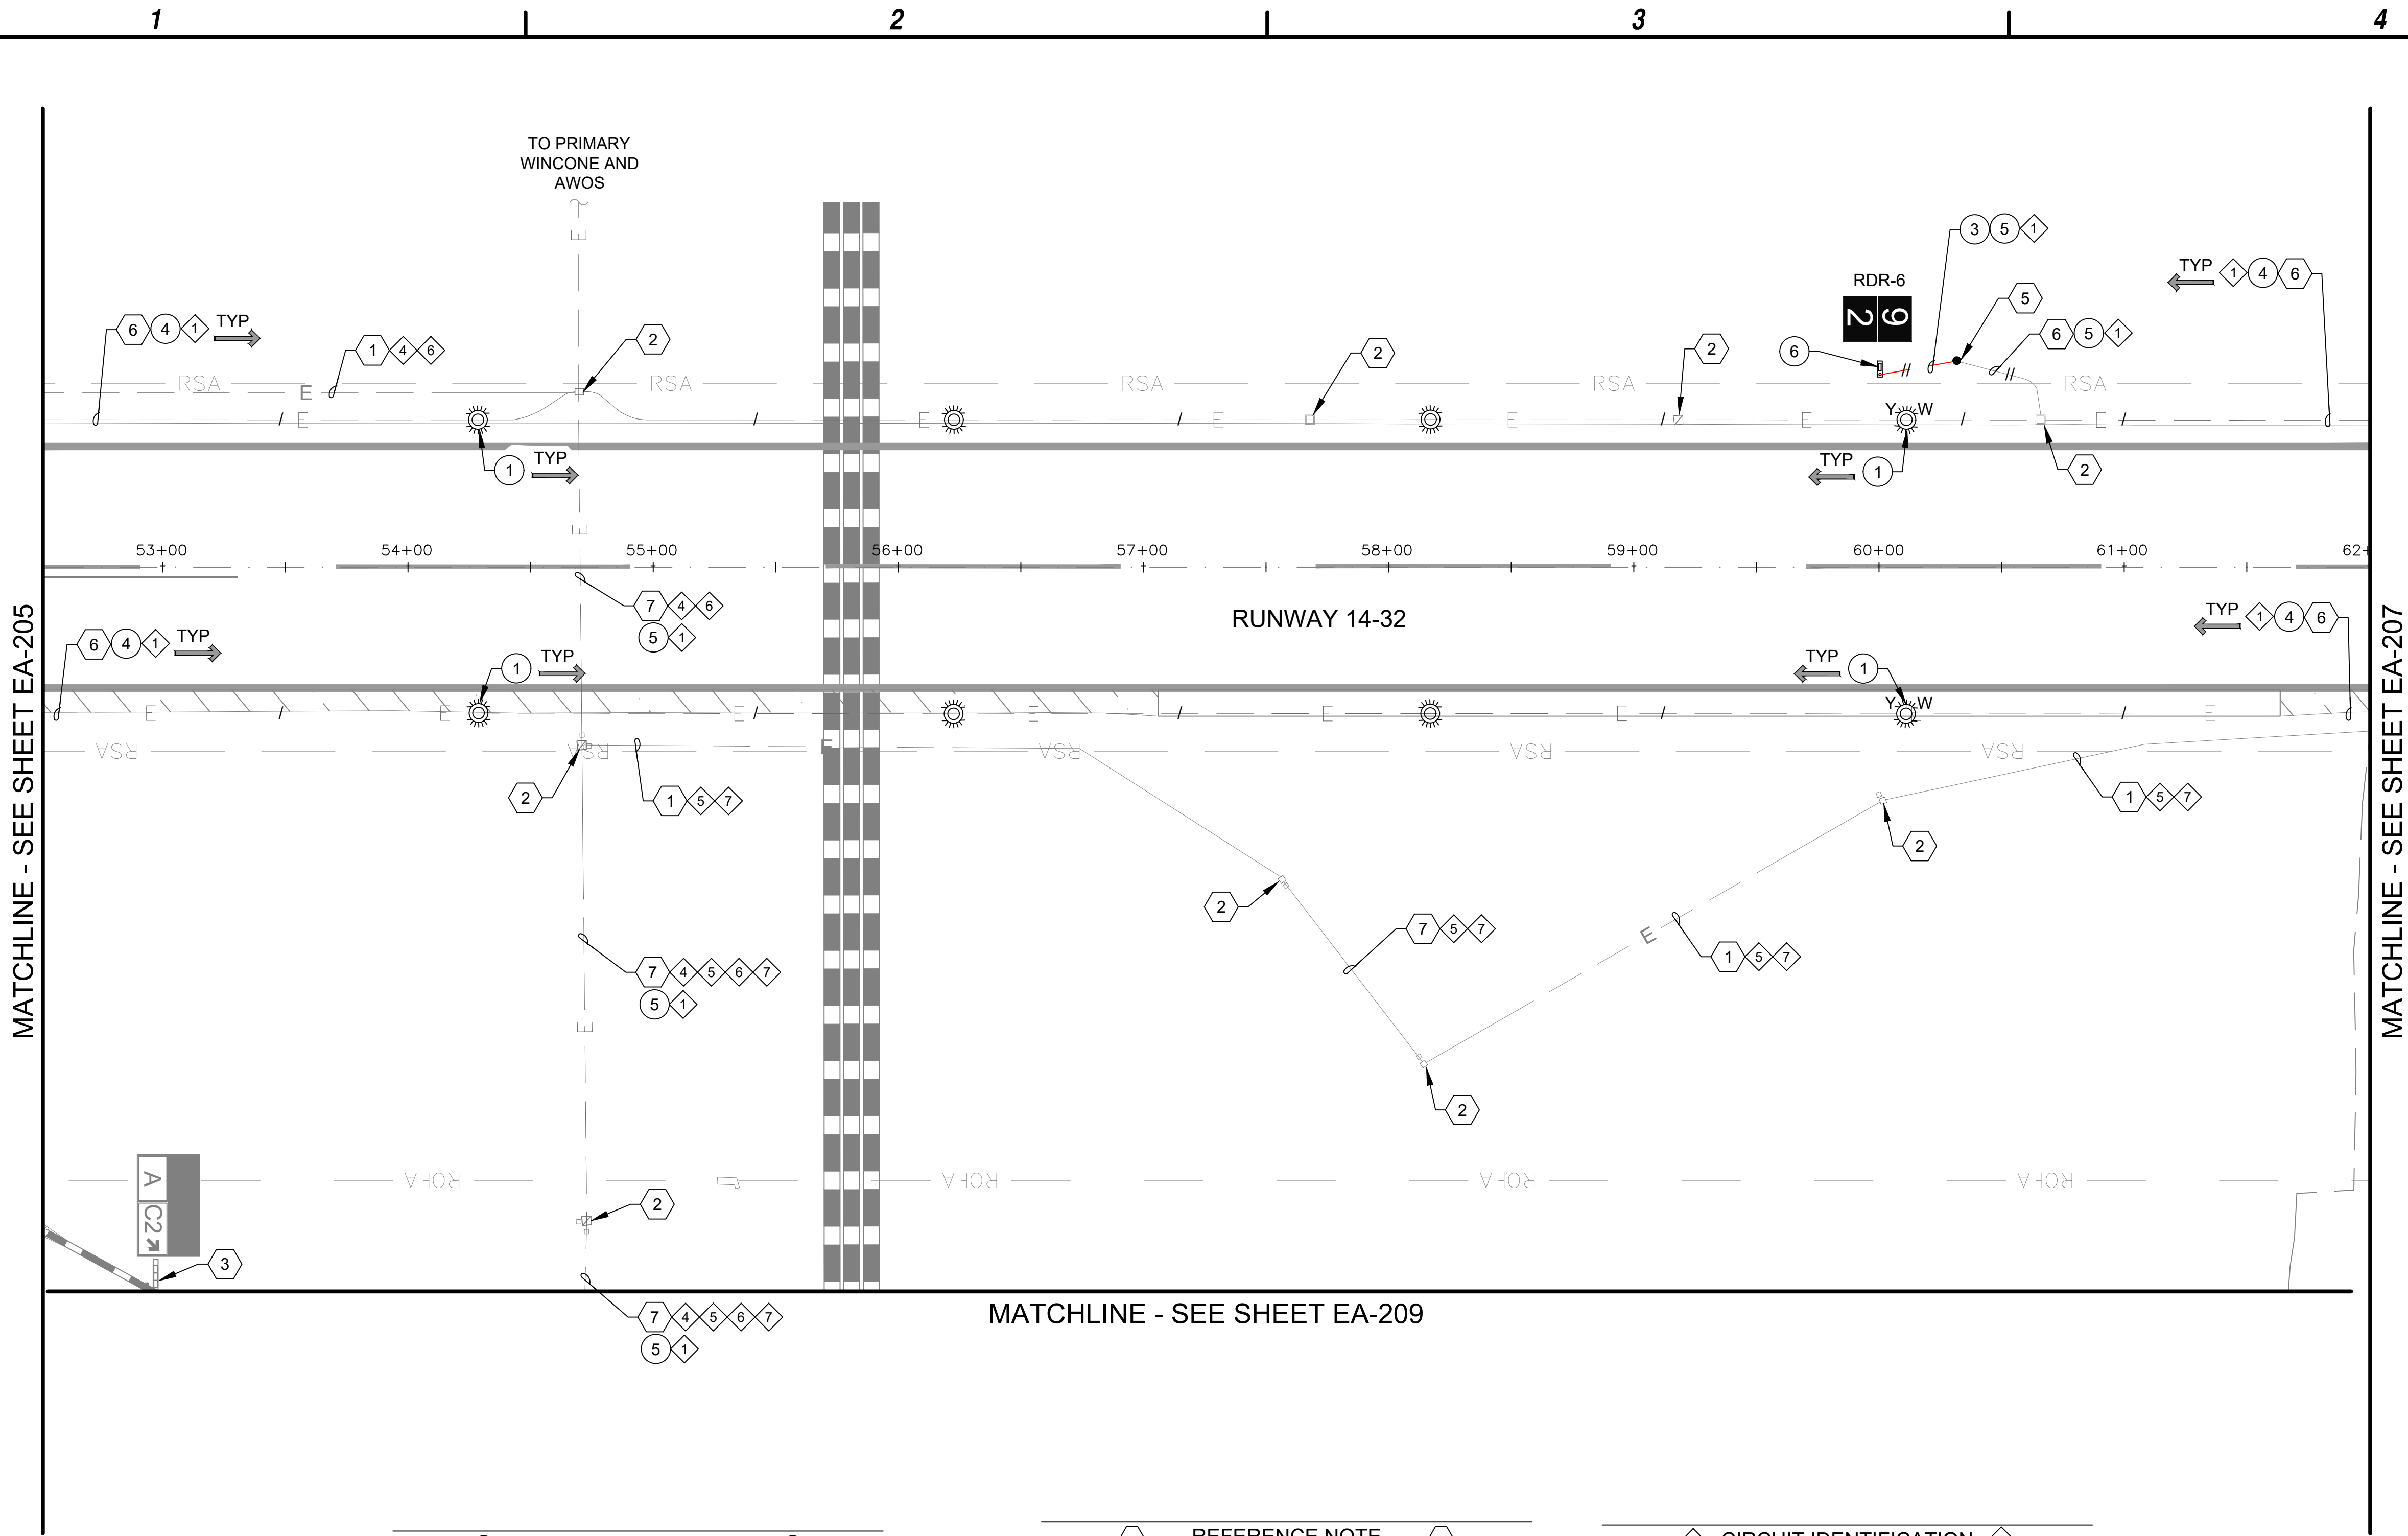

- CONSTRUCTION NOTE ○
- 1 NEW ELEVATED LED L-861(L) RUNWAY EDGE LIGHT AND ISOLATION TRANSFORMER ON EXISTING L-867 BASE CAN. (8 TOTAL)
 - 3 1-2" C SE (35 LF)
 - 4 NEW 1/C #8-5KV L-824, TYPE "C" AIRFIELD LIGHTING CABLE. (2,100 LF)
 - 5 NEW 2/C #8-5KV L-824, TYPE "C" AIRFIELD LIGHTING CABLE. (540 LF)
 - 6 NEW SIZE 5 RUNWAY DISTANCE REMAINING SIGN AND ISOLATION TRANSFORMER ON NEW SIGN BASE. (1 TOTAL)

- REFERENCE NOTE ○
- 1 EXISTING CONDUIT AND CONDUCTOR
 - 2 EXISTING HANDHOLE/PULLBOX
 - 3 EXISTING AIRFIELD GUIDANCE SIGN
 - 5 APPROXIMATE SPLICE POINT OF EXISTING CONDUIT AND COUNTERPOISE
 - 6 EXISTING CONDUIT
 - 7 EXISTING DUCTBANK


- ◇ CIRCUIT IDENTIFICATION ◇
- 1 RUNWAY 14/32 CIRCUIT
 - 4 PAPI 14 CIRCUIT
 - 5 PAPI 32 CIRCUIT
 - 6 REIL 14 CIRCUIT
 - 7 REIL 32 CIRCUIT

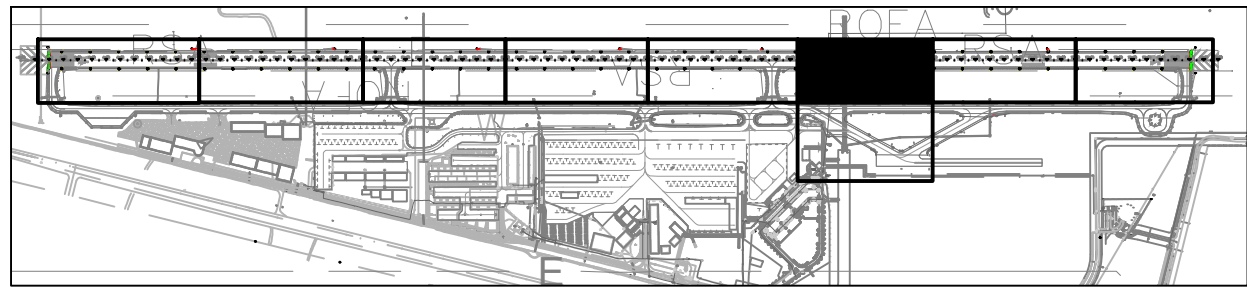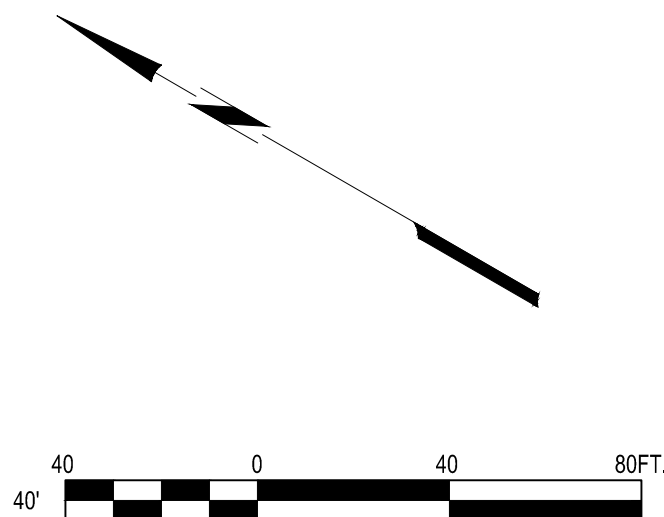

KEY MAP
NTS



C&S Engineers, Inc.

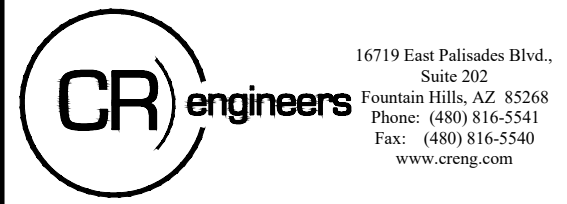

**RUNWAY LIGHTS AND SIGNS
IMPROVEMENT PROJECT**

LAKE HAVASU CITY MUNICIPAL AIRPORT

LAKE HAVASU CITY, AIRIZONA

MARK	DATE	DESCRIPTION
REVISIONS		
PROJECT NO: K33004009		
DATE: MARCH 2025		
DRAWN BY: JBW		
DESIGNED BY: SW		
CHECKED BY: CA		

**AIRFIELD
ELECTRICAL
PLAN**


MATCHLINE - SEE SHEET EA-206

MATCHLINE - SEE SHEET EA-208

- CONSTRUCTION NOTE ○
- ① NEW ELEVATED LED L-861(L) RUNWAY EDGE LIGHT AND ISOLATION TRANSFORMER ON EXISTING L-867 BASE CAN. (10 TOTAL)
 - ③ 1-2" C SE (15 LF)
 - ④ NEW 1/C #8-5KV L-824, TYPE "C" AIRFIELD LIGHTING CABLE. (2,130 LF)
 - ⑤ NEW 2/C #8-5KV L-824, TYPE "C" AIRFIELD LIGHTING CABLE. (40 LF)
 - ⑥ NEW SIZE 5 RUNWAY DISTANCE REMAINING SIGN AND ISOLATION TRANSFORMER ON NEW SIGN BASE. (1 TOTAL)

- ⬡ REFERENCE NOTE ⬡
- ① EXISTING CONDUIT AND CONDUCTOR
 - ② EXISTING HANDHOLE/PULLBOX
 - ③ EXISTING AIRFIELD GUIDANCE SIGN
 - ④ EXISTING ELEVATED EDGE LIGHT
 - ⑤ APPROXIMATE SPLICE POINT OF EXISTING CONDUIT AND COUNTERPOISE
 - ⑥ EXISTING CONDUIT
 - ⑨ EXISTING PAPI

- ◇ CIRCUIT IDENTIFICATION ◇
- ① RUNWAY 14/32 CIRCUIT
 - ⑤ PAPI 32 CIRCUIT
 - ⑦ REIL 32 CIRCUIT

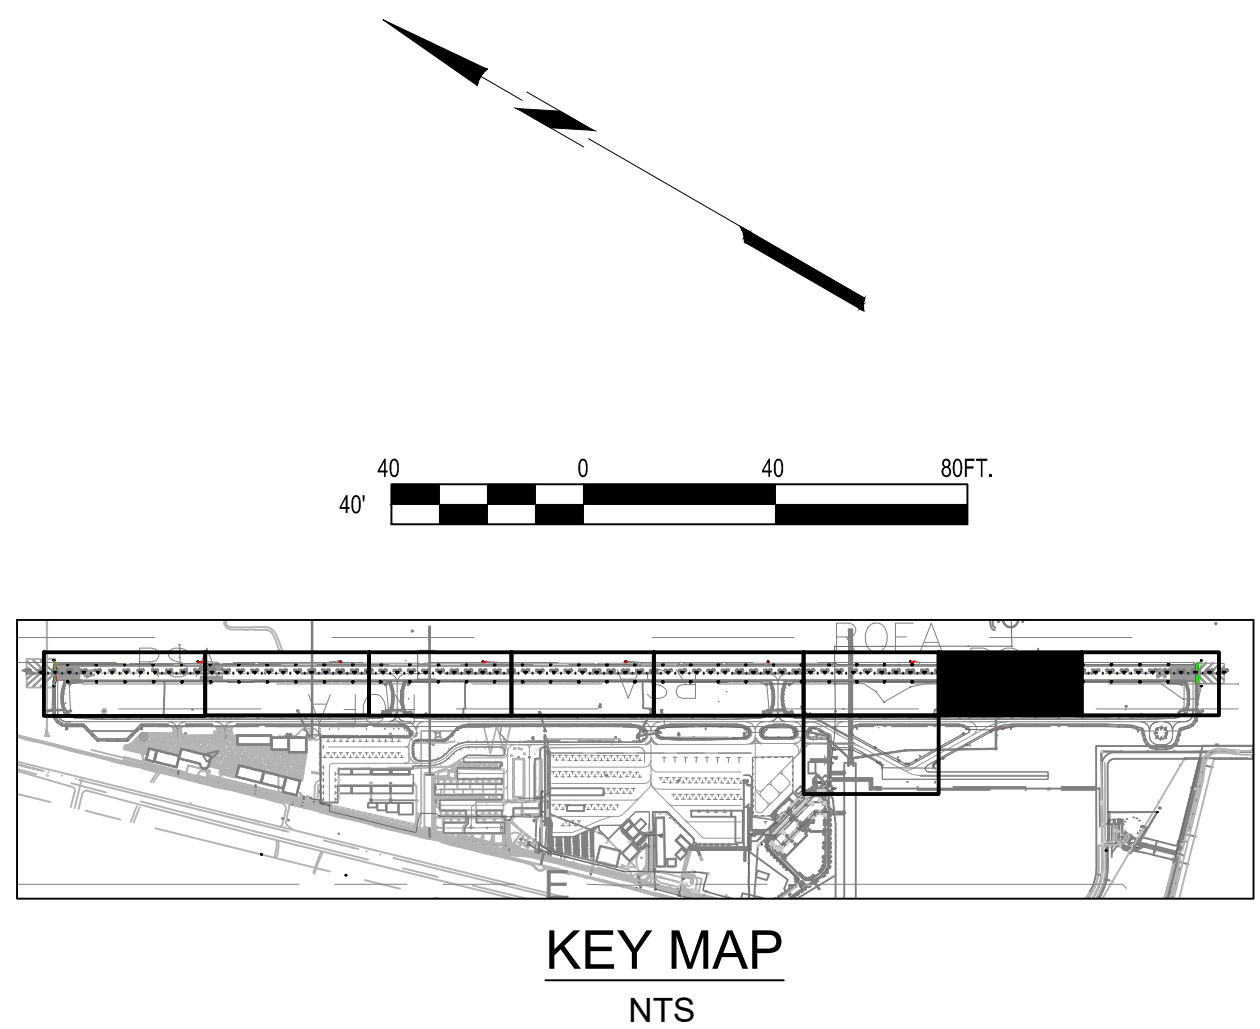

C&S Engineers, Inc.



**RUNWAY LIGHTS AND SIGNS
IMPROVEMENT PROJECT**

LAKE HAVASU CITY MUNICIPAL AIRPORT

LAKE HAVASU CITY, AIRIZONA


MARK	DATE	DESCRIPTION
REVISIONS		
PROJECT NO: K33004009		
DATE: MARCH 2025		
DRAWN BY: JBW		
DESIGNED BY: SW		
CHECKED BY: CA		

**AIRFIELD
ELECTRICAL
PLAN**

EA-207

22 of 31

MATCHLINE - SEE SHEET EA-207

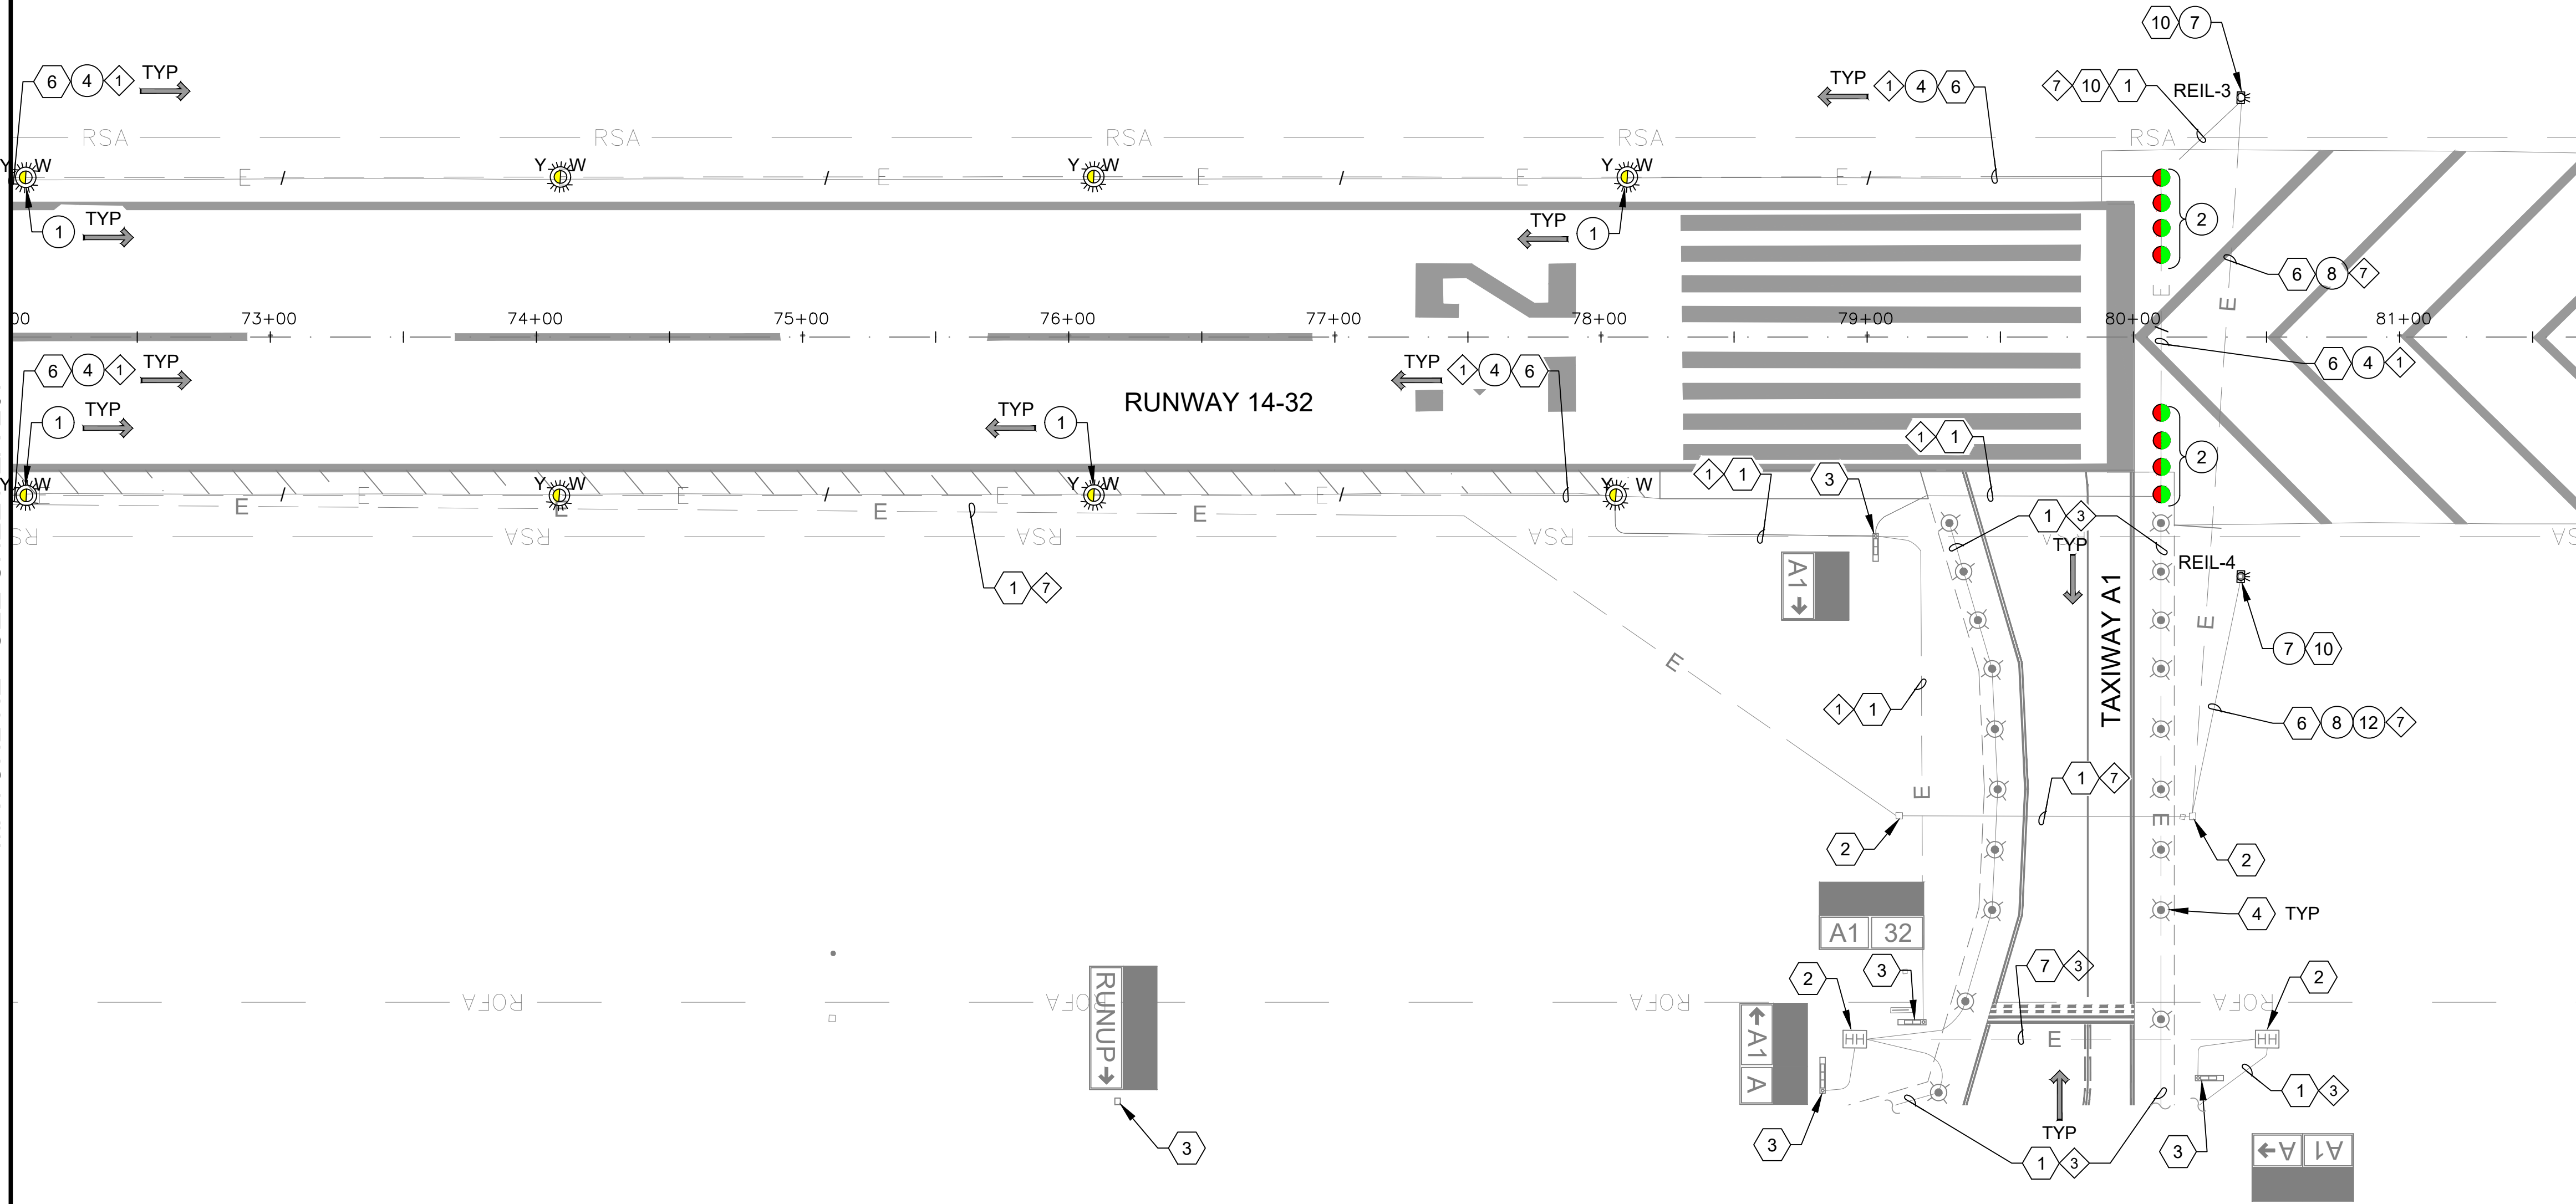

CONSTRUCTION NOTE



- NEW ELEVATED LED L-861(L) RUNWAY EDGE LIGHT AND ISOLATION TRANSFORMER ON EXISTING L-867 BASE CAN. (8 TOTAL)
- NEW ELEVATED LED L-861E(L) RUNWAY END/THRESHOLD LIGHT AND ISOLATION TRANSFORMER ON EXISTING L-867 BASE CAN. (8 TOTAL)
- NEW 1/C #8-5KV L-824, TYPE "C" AIRFIELD LIGHTING CABLE. (1,675 LF)
- INSTALL NEW L-849 (L) LED REIL UNIT ON EXISTING CONCRETE FOUNDATION. (1 PAIR)
- NEW 2-#10 TWHN CABLES, #10 NEUTRAL, #10 GND (WITH 2/C TRIGGER WIRE) (405 LF)
- NEW 2/C #8-5KV L-824, TYPE "C" AIRFIELD LIGHTING CABLE WITH #6 GND (NAVAID) (115 LF)

REFERENCE NOTE

- EXISTING CONDUIT AND CONDUCTOR
- EXISTING HANDHOLE/PULLBOX
- EXISTING AIRFIELD GUIDANCE SIGN
- EXISTING ELEVATED EDGE LIGHT
- EXISTING CONDUIT
- EXISTING DUCTBANK
- EXISTING REIL RUNWAY INTERLOCK/CURRENT SENSING CONTROL CABLES. RECONNECT TO NEW REILs.

CIRCUIT IDENTIFICATION

- RUNWAY 14/32 CIRCUIT
- TAXIWAY A SOUTH CIRCUIT
- PAPI 32 CIRCUIT
- REIL 32 CIRCUIT

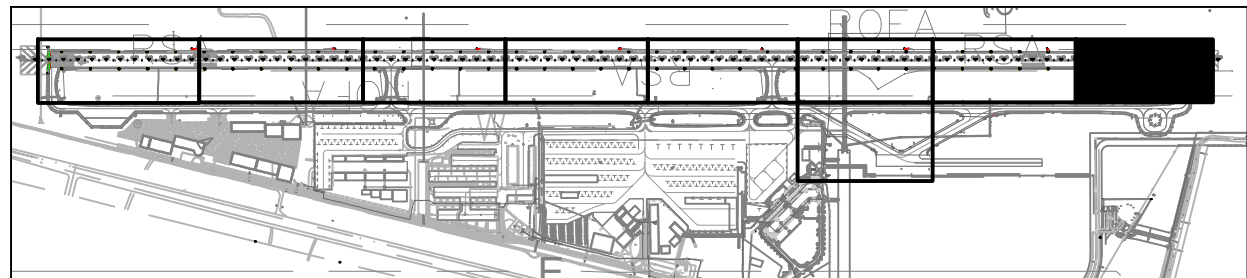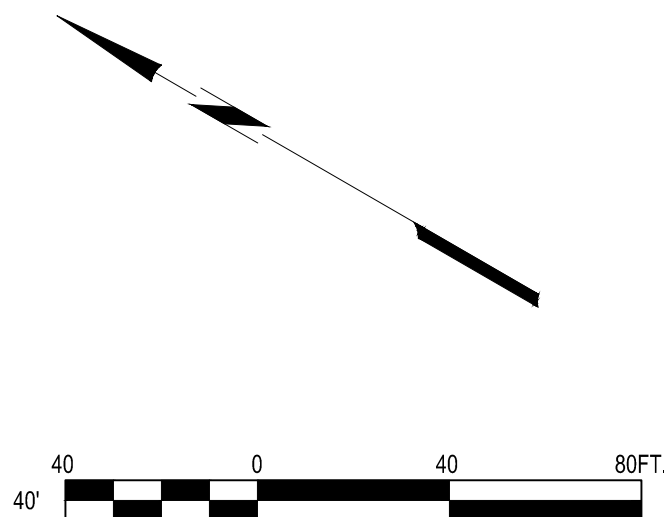



RUNWAY LIGHTS AND SIGNS
IMPROVEMENT PROJECT
LAKE HAVASU CITY MUNICIPAL AIRPORT
LAKE HAVASU CITY, AIRIZONA


MARK	DATE	DESCRIPTION
REVISIONS		
PROJECT NO: K33004009		
DATE: MARCH 2025		
DRAWN BY: JBW		
DESIGNED BY: SW		
CHECKED BY: CA		

AIRFIELD
ELECTRICAL
PLAN



C&S Engineers, Inc.

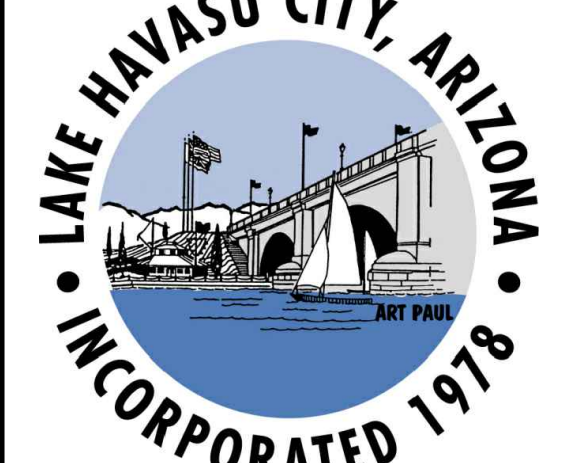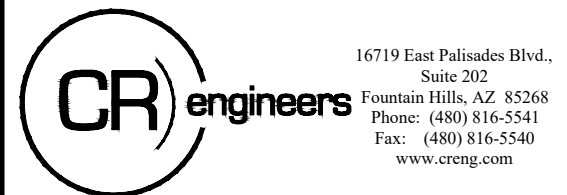


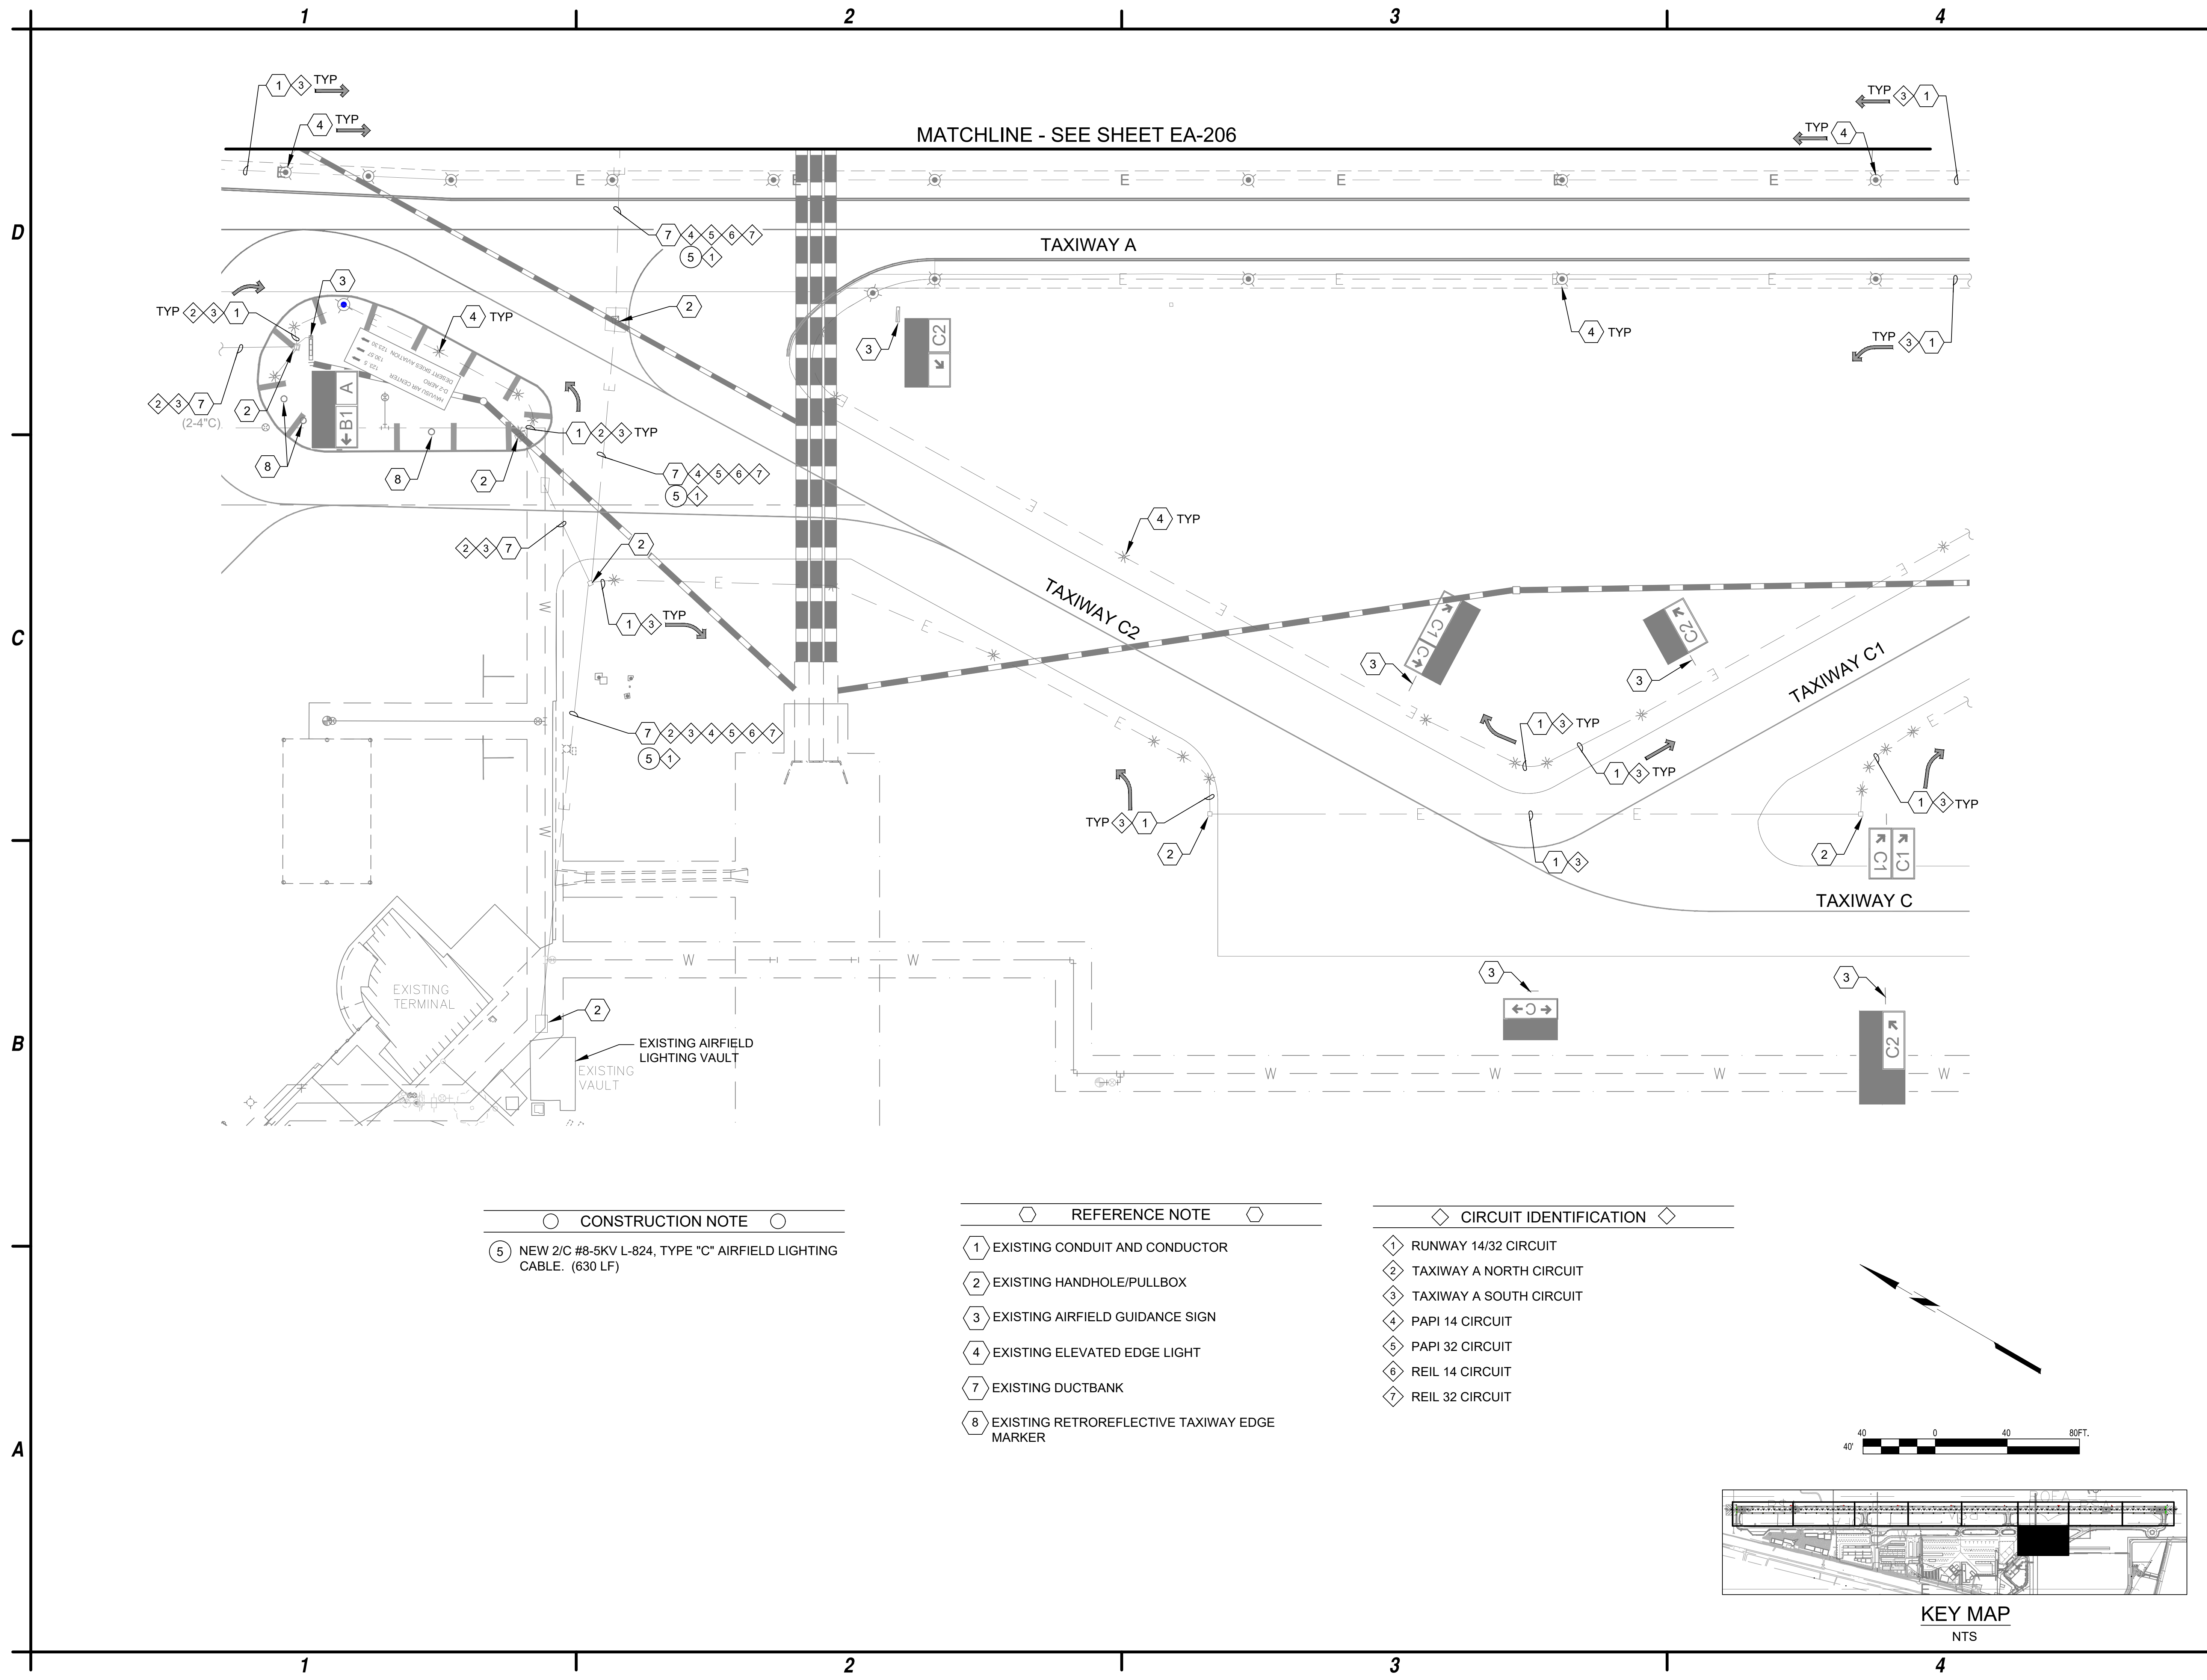

- CONSTRUCTION NOTE ○
- 5 NEW 2/C #8-5KV L-824, TYPE "C" AIRFIELD LIGHTING CABLE. (630 LF)

- REFERENCE NOTE ○
- 1 EXISTING CONDUIT AND CONDUCTOR
 - 2 EXISTING HANDHOLE/PULLBOX
 - 3 EXISTING AIRFIELD GUIDANCE SIGN
 - 4 EXISTING ELEVATED EDGE LIGHT
 - 7 EXISTING DUCTBANK
 - 8 EXISTING RETROREFLECTIVE TAXIWAY EDGE MARKER

- ◇ CIRCUIT IDENTIFICATION ◇
- 1 RUNWAY 14/32 CIRCUIT
 - 2 TAXIWAY A NORTH CIRCUIT
 - 3 TAXIWAY A SOUTH CIRCUIT
 - 4 PAPI 14 CIRCUIT
 - 5 PAPI 32 CIRCUIT
 - 6 REIL 14 CIRCUIT
 - 7 REIL 32 CIRCUIT

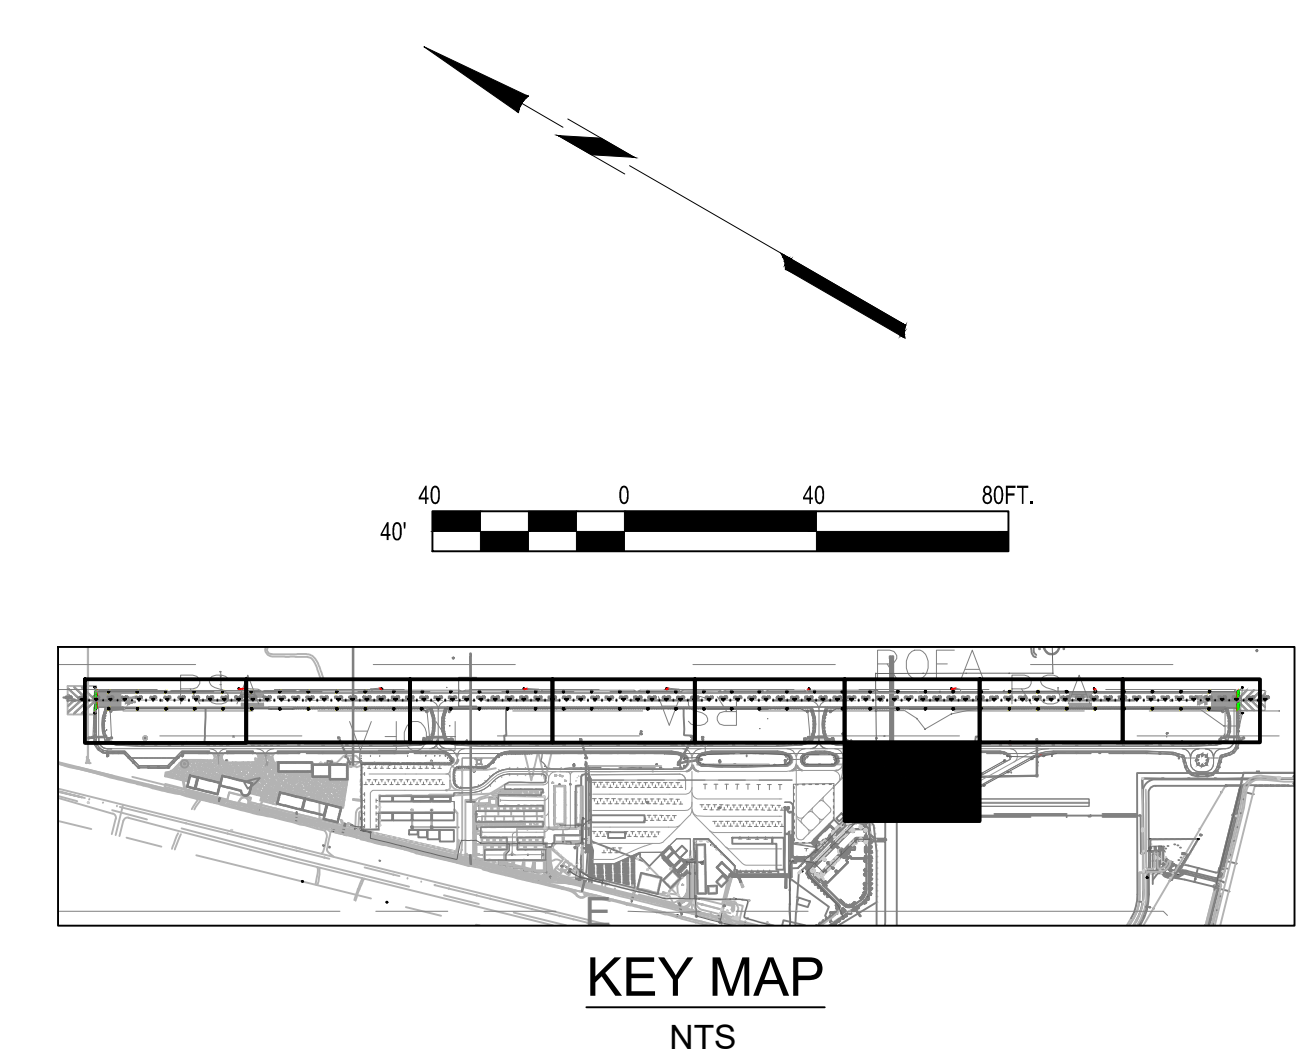

C&S Engineers, Inc.

16719 East Palmdale Blvd., Suite 302
Fountain Hills, AZ 85268
Phone: (480) 816-5541
Fax: (480) 816-5540
www.creng.com

16719 East Palmdale Blvd., Suite 302
Fountain Hills, AZ 85268
Phone: (480) 816-5541
Fax: (480) 816-5540
www.creng.com

Catherine Alcorn

LAKE HAVASU CITY, ARIZONA
INCORPORATED 1978

**RUNWAY LIGHTS AND SIGNS
IMPROVEMENT PROJECT**

**LAKE HAVASU CITY MUNICIPAL AIRPORT
LAKE HAVASU CITY, AIRIZONA**

MARK	DATE	DESCRIPTION
REVISIONS		
PROJECT NO: K33004009		
DATE: MARCH 2025		
DRAWN BY: JBW		
DESIGNED BY: SW		
CHECKED BY: CA		

**AIRFIELD
ELECTRICAL
PLAN**

EA-209

24 of 31

Mar 17, 2025 - 4:39pm
Q:\PROJECTS\24000\24016 Lake Havasu Airport MIRLS, REILS, RDRS\CAD\CAD SHEETS\24016 EA-201-EA-209 CONSTRUCTION SHEETS.dwg

D

C

B

A

LAKE HAVASU MUNICIPAL AIRPORT - RUNWAY 14-32 DISTANCE REMAINING SIGN SCHEDULE										
SIGN NUMBER	CIRCUIT	SIGN WITH FACE DESIGNATIONS	FACE A MESSAGE	FACE B MESSAGE	FACE A COLOR(S)	FACE B COLOR(S)	STYLE	SIZE	SHEET NUMBER	SCOPE OF WORK
					NUMBER/BACKGROUND	NUMBER/BACKGROUND				
RDR-1	RUNWAY 14/32	A  B	7	1	W/B	W/B	2	5	EA-201	NEW L-858B LED RUNWAY DISTANCE REMAINING SIGN AND ISOLATION TRANSFORMER ON NEW BASE
RDR-2	RUNWAY 14/32	A  B	6	2	W/B	W/B	2	5	EA-202	NEW L-858B LED RUNWAY DISTANCE REMAINING SIGN AND ISOLATION TRANSFORMER ON NEW BASE
RDR-3	RUNWAY 14/32	A  B	5	3	W/B	W/B	2	5	EA-203	NEW L-858B LED RUNWAY DISTANCE REMAINING SIGN AND ISOLATION TRANSFORMER ON NEW BASE
RDR-4	RUNWAY 14/32	A  B	4	4	W/B	W/B	2	5	EA-204	NEW L-858B LED RUNWAY DISTANCE REMAINING SIGN AND ISOLATION TRANSFORMER ON NEW BASE
RDR-5	RUNWAY 14/32	A  B	3	5	W/B	W/B	2	5	EA-205	NEW L-858B LED RUNWAY DISTANCE REMAINING SIGN AND ISOLATION TRANSFORMER ON NEW BASE
RDR-6	RUNWAY 14/32	A  B	2	6	W/B	W/B	2	5	EA-206	NEW L-858B LED RUNWAY DISTANCE REMAINING SIGN AND ISOLATION TRANSFORMER ON NEW BASE
RDR-7	RUNWAY 14/32	A  B	1	7	W/B	W/B	2	5	EA-207	NEW L-858B LED RUNWAY DISTANCE REMAINING SIGN AND ISOLATION TRANSFORMER ON NEW BASE

RUNWAY DISTANCE REMAINING SIGN DATA TABLE


NUMBER	NORTHING	EASTING
RDR-1	1302447.90	515454.09
RDR-2	1301582.01	515954.33
RDR-3	1300716.12	516454.57
RDR-4	1299850.24	516954.81
RDR-5	1298984.35	517455.05
RDR-6	1298118.46	517955.29
RDR-7	1297252.58	518455.53

EQUIPMENT LOCATION STANDARDS TABLE
(PROVIDED FOR REFERENCE ONLY)

EQUIPMENT TYPE	LOCATION STANDARD	NOTES
SIZE 5 RUNWAY DISTANCE REMAINING SIGN	20' - 35' (SEE NOTE 2)	MEASURE TO SIGN EDGE CLOSEST TO DEFINED RUNWAY EDGE/OUTER EDGE MARKING (SEE FAA AC 1505340-18)

GENERAL NOTES


- EQUIPMENT NUMBERS SHOWN ARE FOR CONSTRUCTION REFERENCE ONLY. COORDINATE WITH AIRPORT MAINTENANCE FOR LABELING OF ALL EQUIPMENT.
- CONTRACTOR TO ENSURE RUNWAY DISTANCE REMAINING SIGN LOCATIONS FALL WITHIN FAA SPECIFICATIONS. CONTRACTOR SHALL CONFIRM ANY DIFFERENCES OF MEASUREMENTS/DISCREPANCIES, WHEN SURVEY OF RUNWAY DISTANCE REMAINING SIGN AND BASE IS BEING PERFORMED, WITH ENGINEER BEFORE SIGN BASE IS INSTALLED.

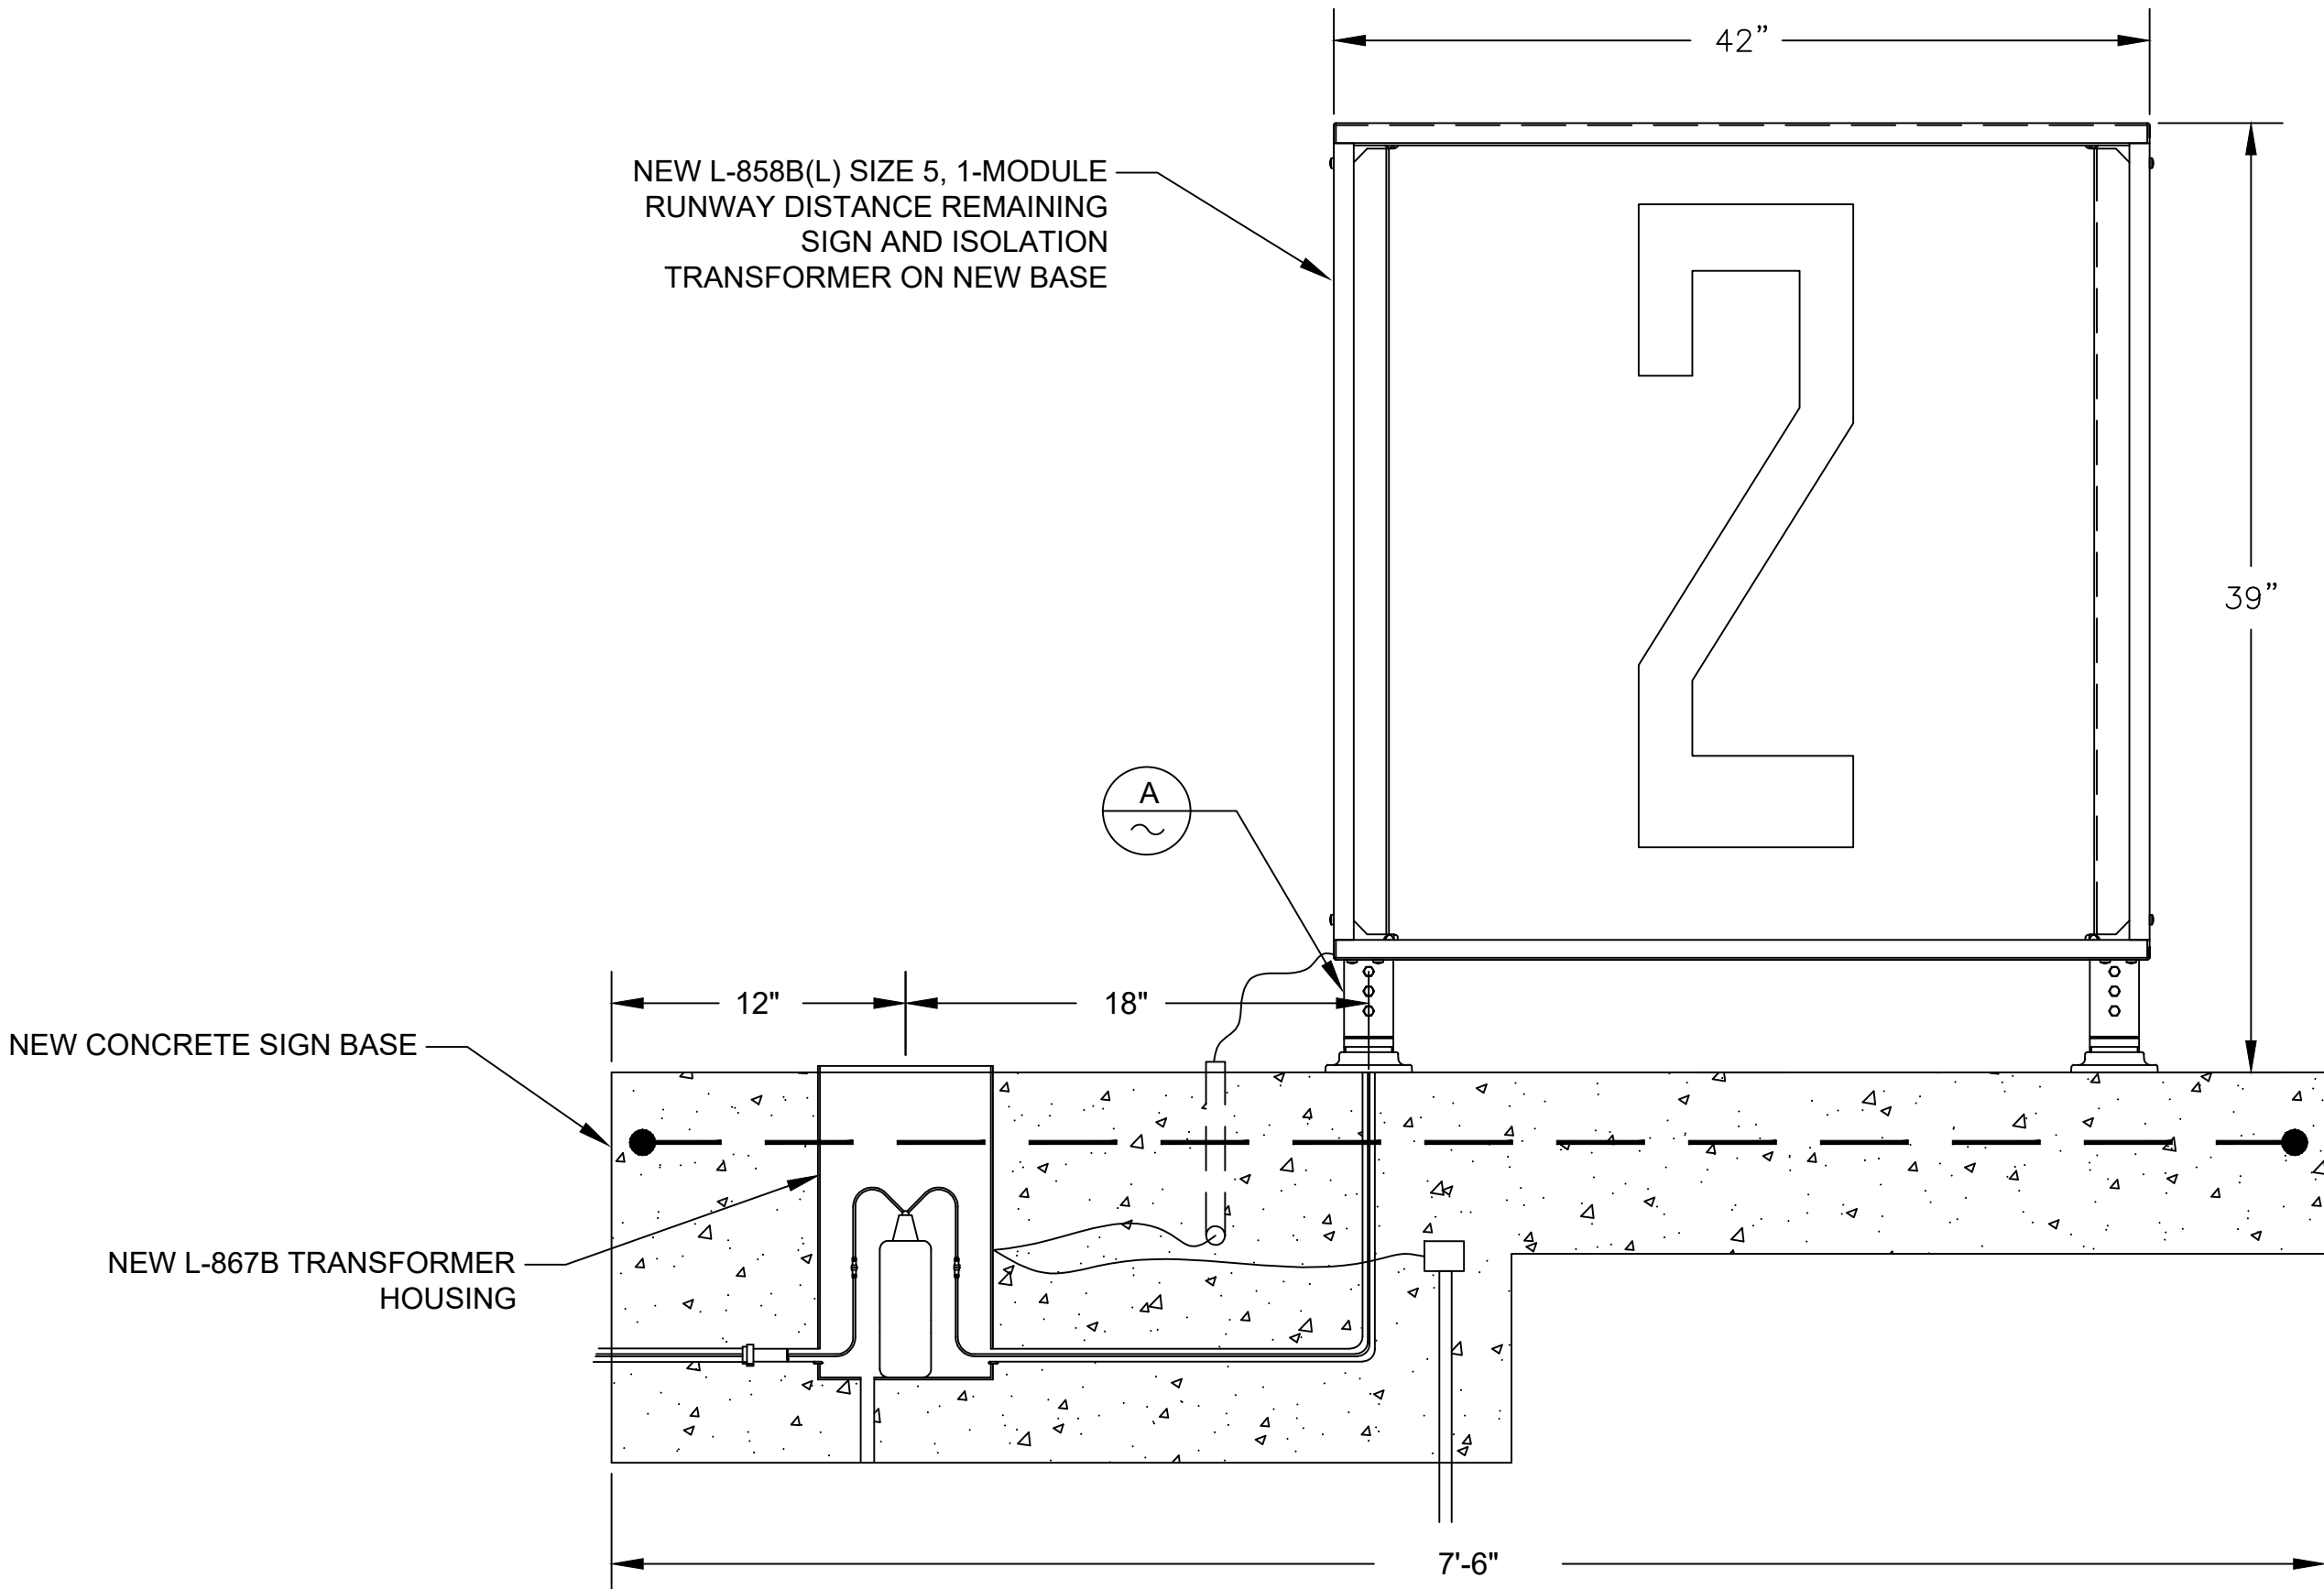

918 RUNWAY DISTANCE REMAINING SIGN
TYP NTS

NOTES:

- ALL NEW RUNWAY DISTANCE REMAINING SIGNS SHALL BE FURNISHED WITH AN EXTERNAL ON/OFF SWITCH.
- ALL DIMENSIONS SHOWN ARE APPROXIMATE AND TYPICAL. REFER TO MANUFACTURER AND EXISTING FIELD CONDITIONS.

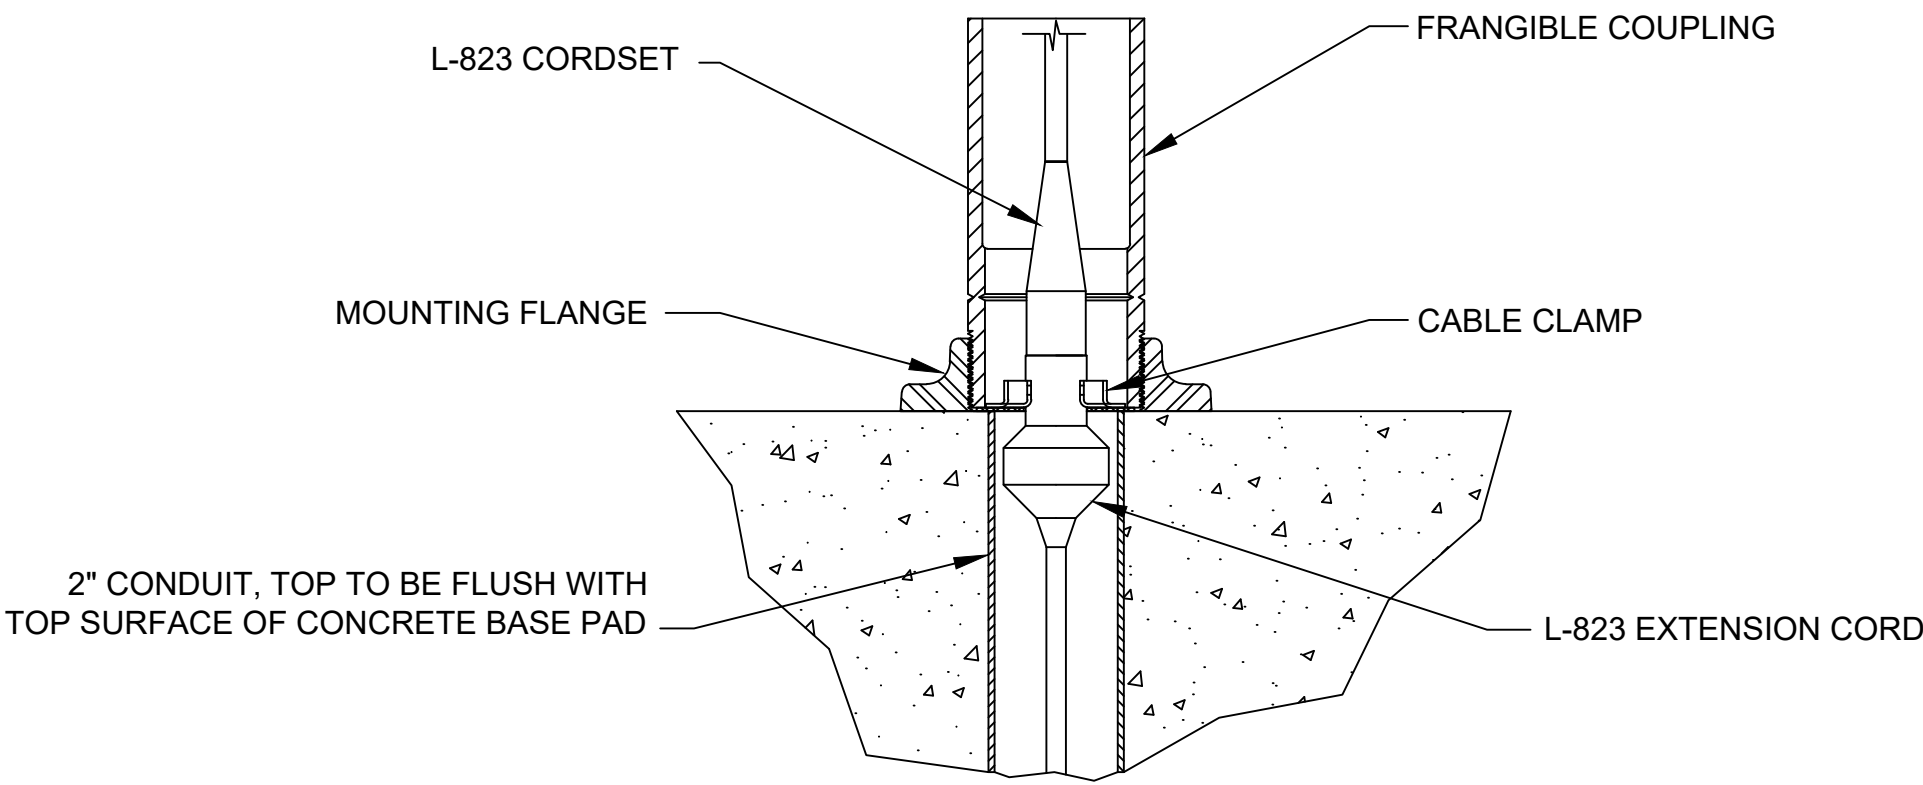


A REMOTE MOUNT DETAIL
NTS

Mar 17, 2025 - 4:39pm
Q:\PROJECTS\24000\24016 Lake Havasu Airport - RDRs\CAD\CAD SHEETS\24016 EA-301 RDR DETAIL AND RDR SIGN SCHEDULE.dwg



C&S Engineers, Inc.

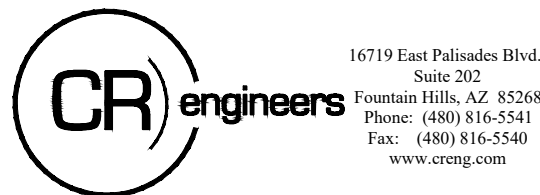

RUNWAY LIGHTS AND SIGNS
IMPROVEMENT PROJECT

LAKE HAVASU CITY MUNICIPAL AIRPORT
LAKE HAVASU CITY, AIRIZONA

MARK	DATE	DESCRIPTION
REVISIONS		
PROJECT NO: K33004009		
DATE: MARCH 2025		
DRAWN BY: JBW		
DESIGNED BY: SW		
CHECKED BY: CA		

RUNWAY
DISTANCE
REMAINING SIGN
SCHEDULE



EA-301

D

C

B

A

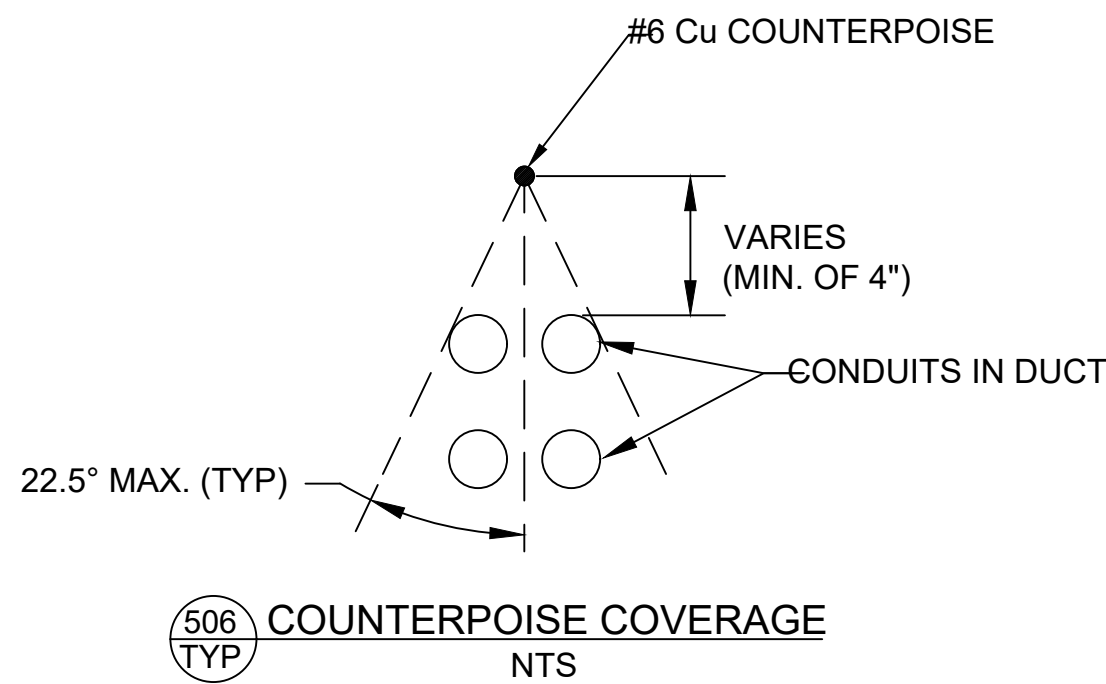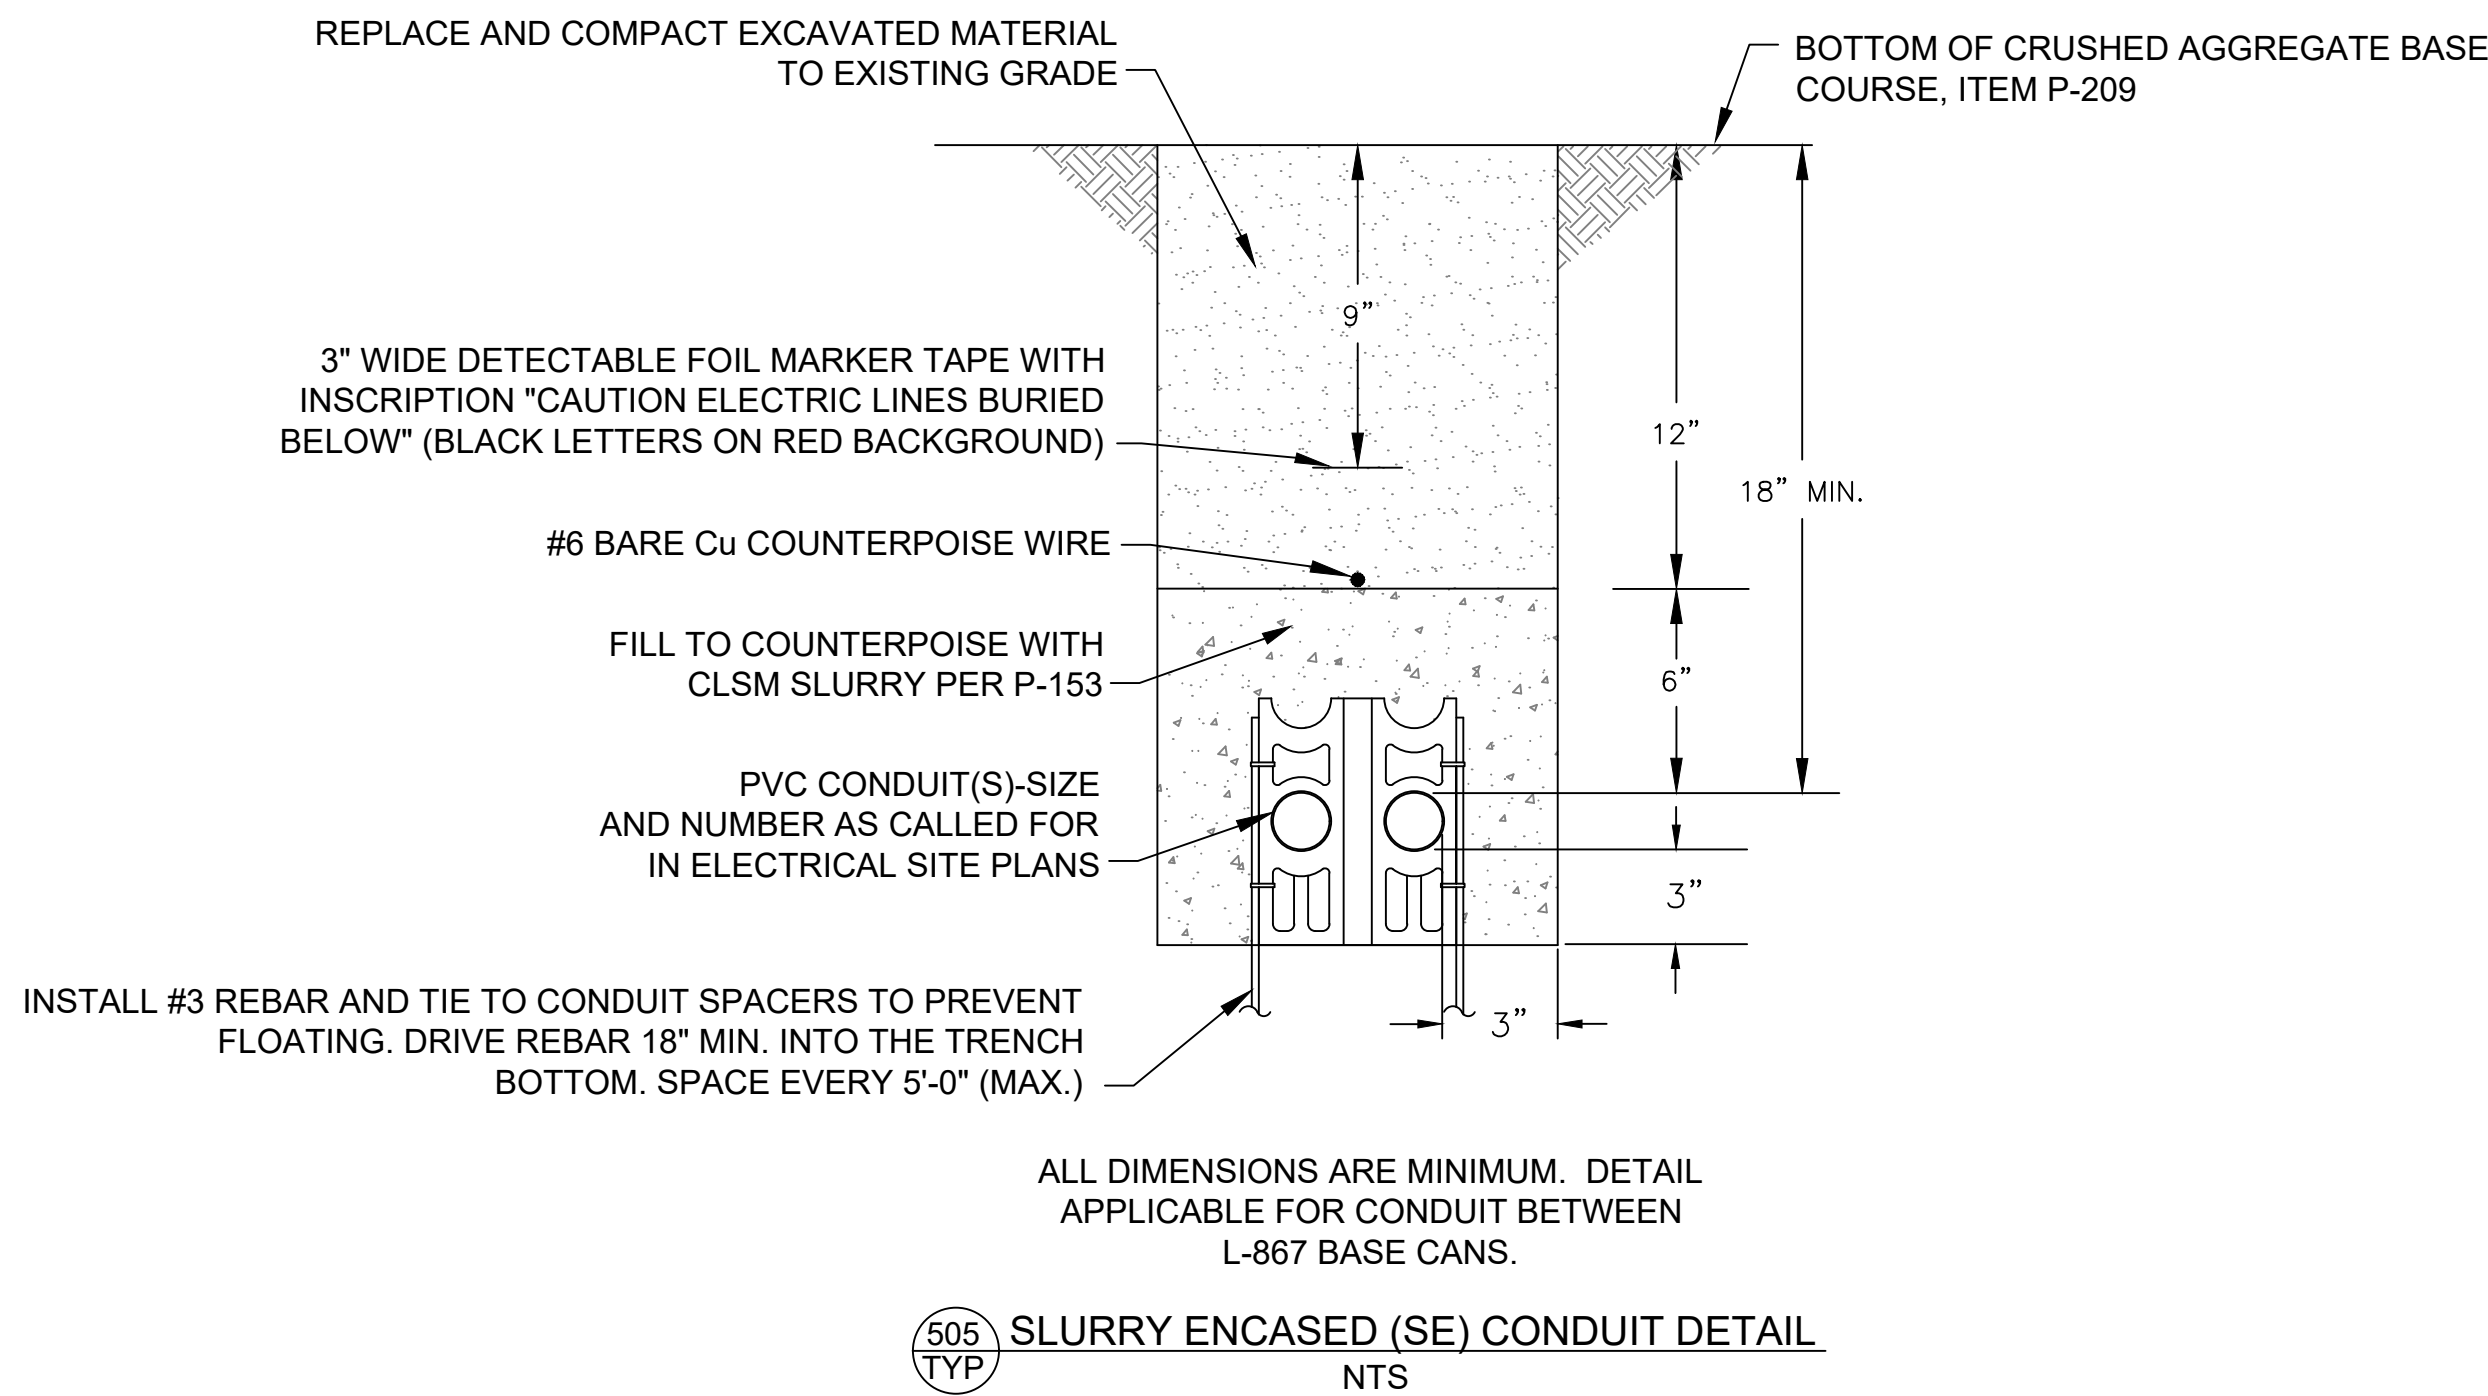

1. ADJUST COUNTERPOISE OFFSET ABOVE CONDUIT/DUCT (MIN. OF 4") TO PROVIDE A CONE OF PROTECTION (MAX. OF 22.5° EACH SIDE OF VERTICAL) ABOVE ALL CONDUITS.

GENERAL NOTES FOR CONDUIT INSTALLATION

1. PROVIDE PULL STRING IN ALL (NEW) UNUSED CONDUITS. PLUG ENDS IN HANDHOLES AND JUNCTION CANS (NPI).
2. INSTALL A #6 BARE SOLID COPPER (Cu) COUNTERPOISE ABOVE EACH DUCT ASSEMBLY FROM HANDHOLE-TO-HANDHOLE AND EXOTHERMICALLY WELD TO GROUND RODS AT EACH HANDHOLE/JUNCTION CAN.
3. INSTALL LIGHTING SERIES CIRCUITS AS FOLLOWS:
 - A. ONE CIRCUIT (1 OR 2 CONDUCTORS) PER 2"C. LIMIT 4"C TO NO MORE THAN (8) CONDUCTORS.
 - B. START INSTALLATION IN BOTTOM CONDUITS OF DUCT ARRAY, LEAVING THE UPPER CONDUITS EMPTY.
4. ALL UNDERGROUND CONDUITS SHALL MAINTAIN A 12" (MIN.) SEPARATION FROM ALL OTHER (EXISTING OR NEW) UNDERGROUND FACILITIES (I.E. WATER, SEWER, AND GAS LINES, INCLUDING BOTH PUBLIC AND PRIVATE), UNLESS NOTED OTHERWISE ON DRAWINGS
5. CONDUIT IN DUCTBANK(S) ARE TO BE STACKED NO MORE THAN FOUR (4) CONDUITS. IF MORE CONDUITS ARE NEEDED, THE WIDTH OF THE TRENCH IS TO BE INCREASED
6. CONDUIT IN DUCTBANK(S) ARE TO BE STACKED NO MORE THAN FOUR (4) CONDUITS. IF MORE CONDUITS ARE NEEDED, THE WIDTH OF THE TRENCH IS TO BE INCREASED.
7. ADJUST DEPTH TO 18-24" TOTAL FOR CONDUIT INSTALLATION BETWEEN OR INTO L-867/868 BASE CAN. INSTALL COUNTERPOISE AT 12" BELOW GRADE FOR THESE SECTIONS

D

C

B

A



C&S Engineers, Inc.



RUNWAY LIGHTS AND SIGNS
IMPROVEMENT PROJECT

LAKE HAVASU CITY MUNICIPAL AIRPORT
LAKE HAVASU CITY, AIRIZONA

MARK	DATE	DESCRIPTION
REVISIONS		
PROJECT NO: K33004009		
DATE: MARCH 2025		
DRAWN BY: JBW		
DESIGNED BY: SW		
CHECKED BY: CA		

DUCTBANK
DETAILS




EA-401

D

C

B

A

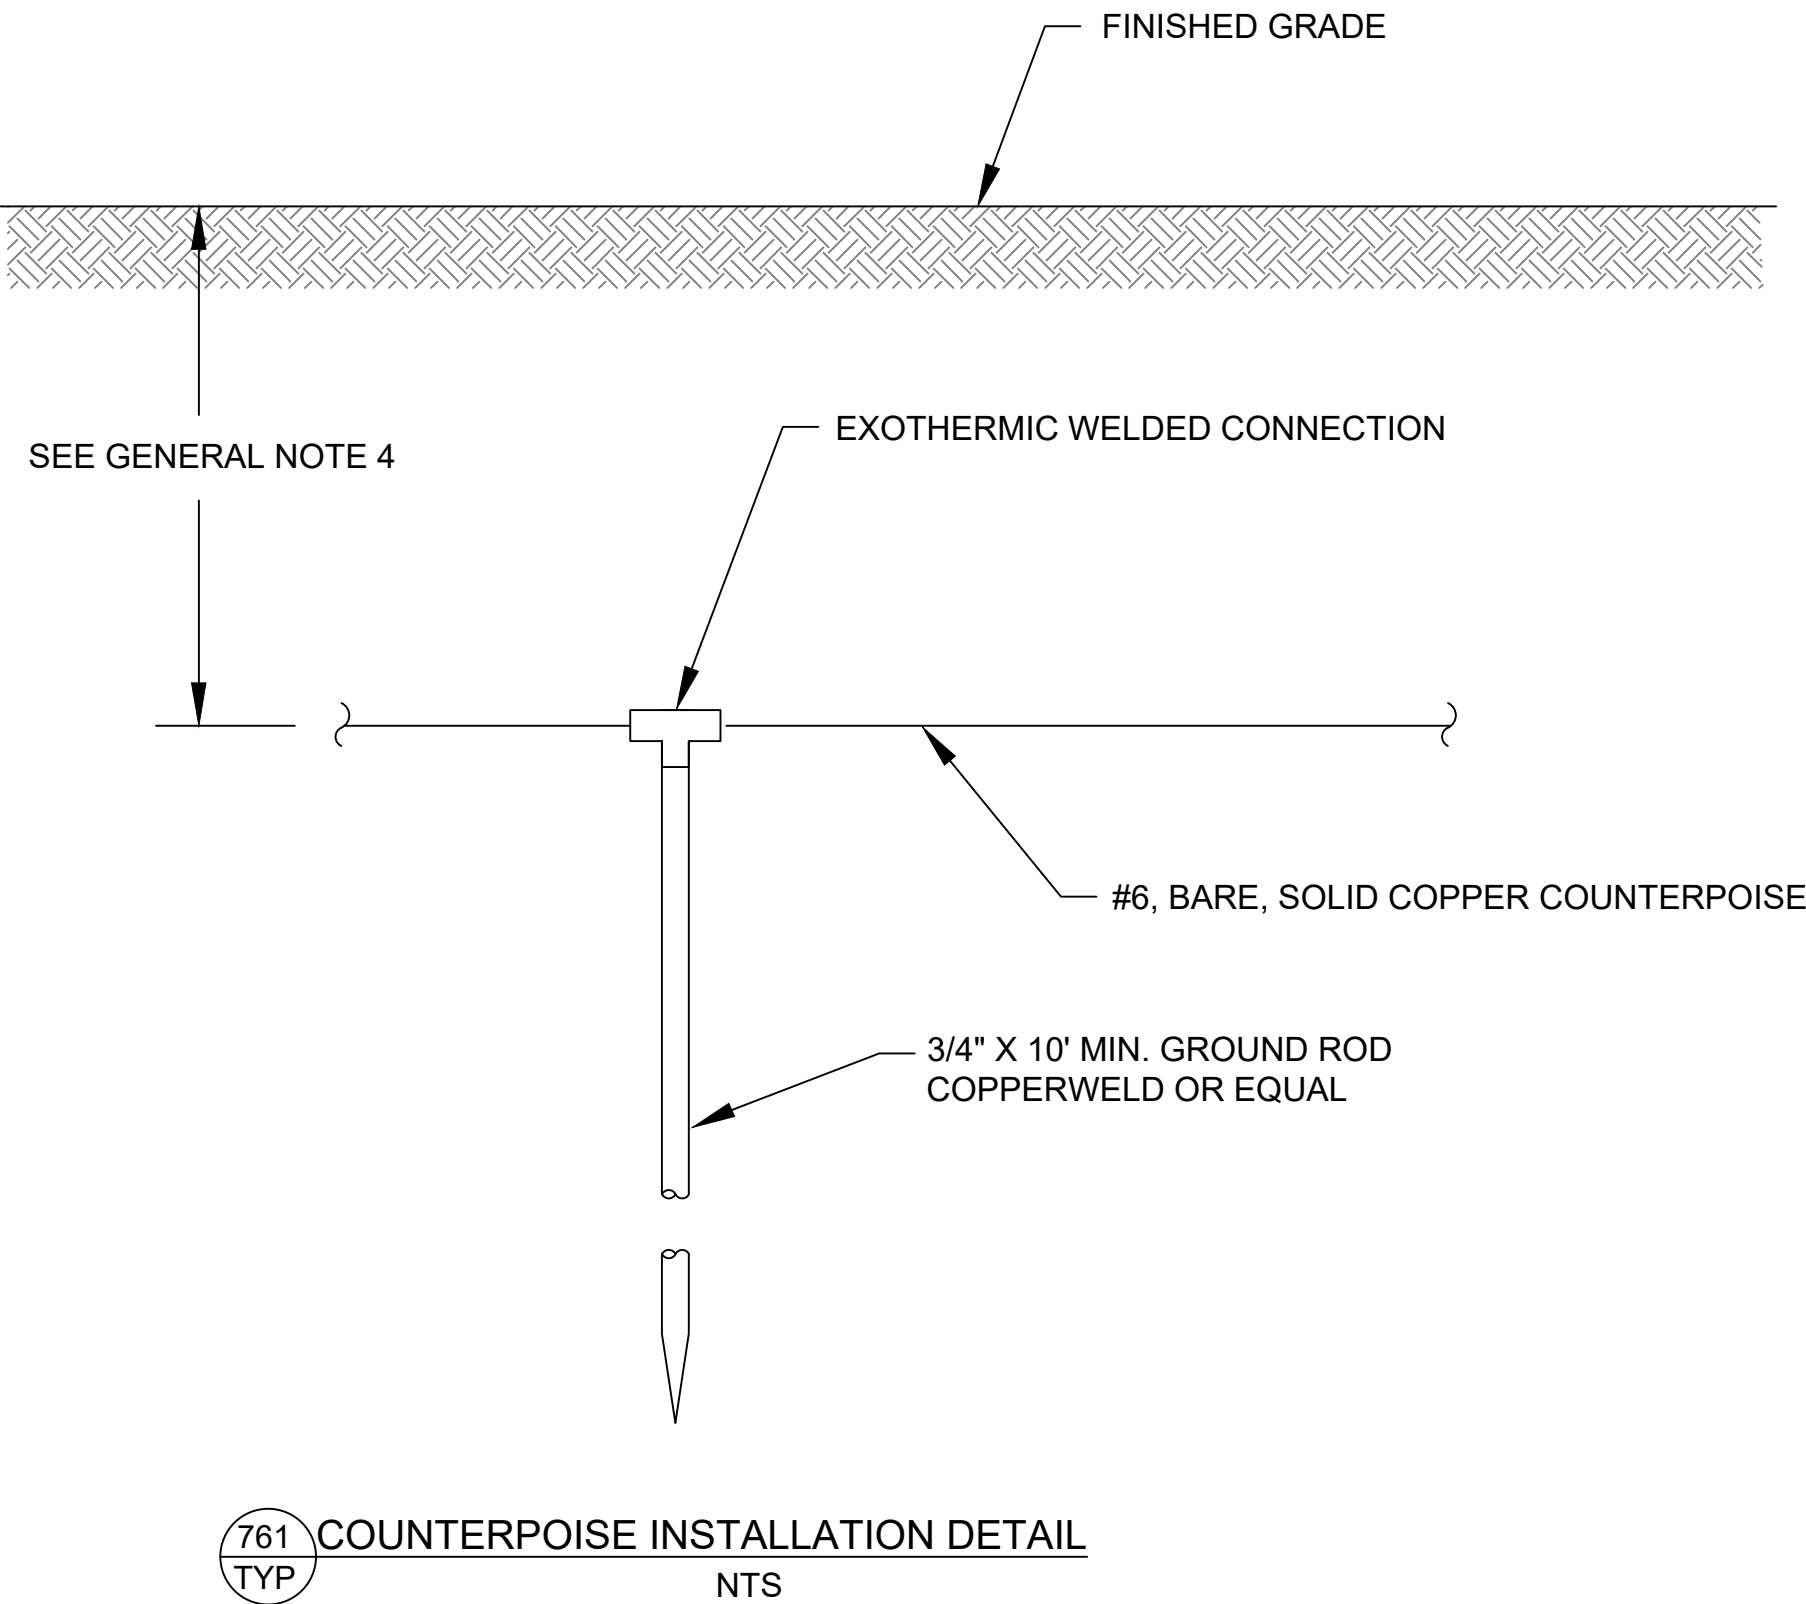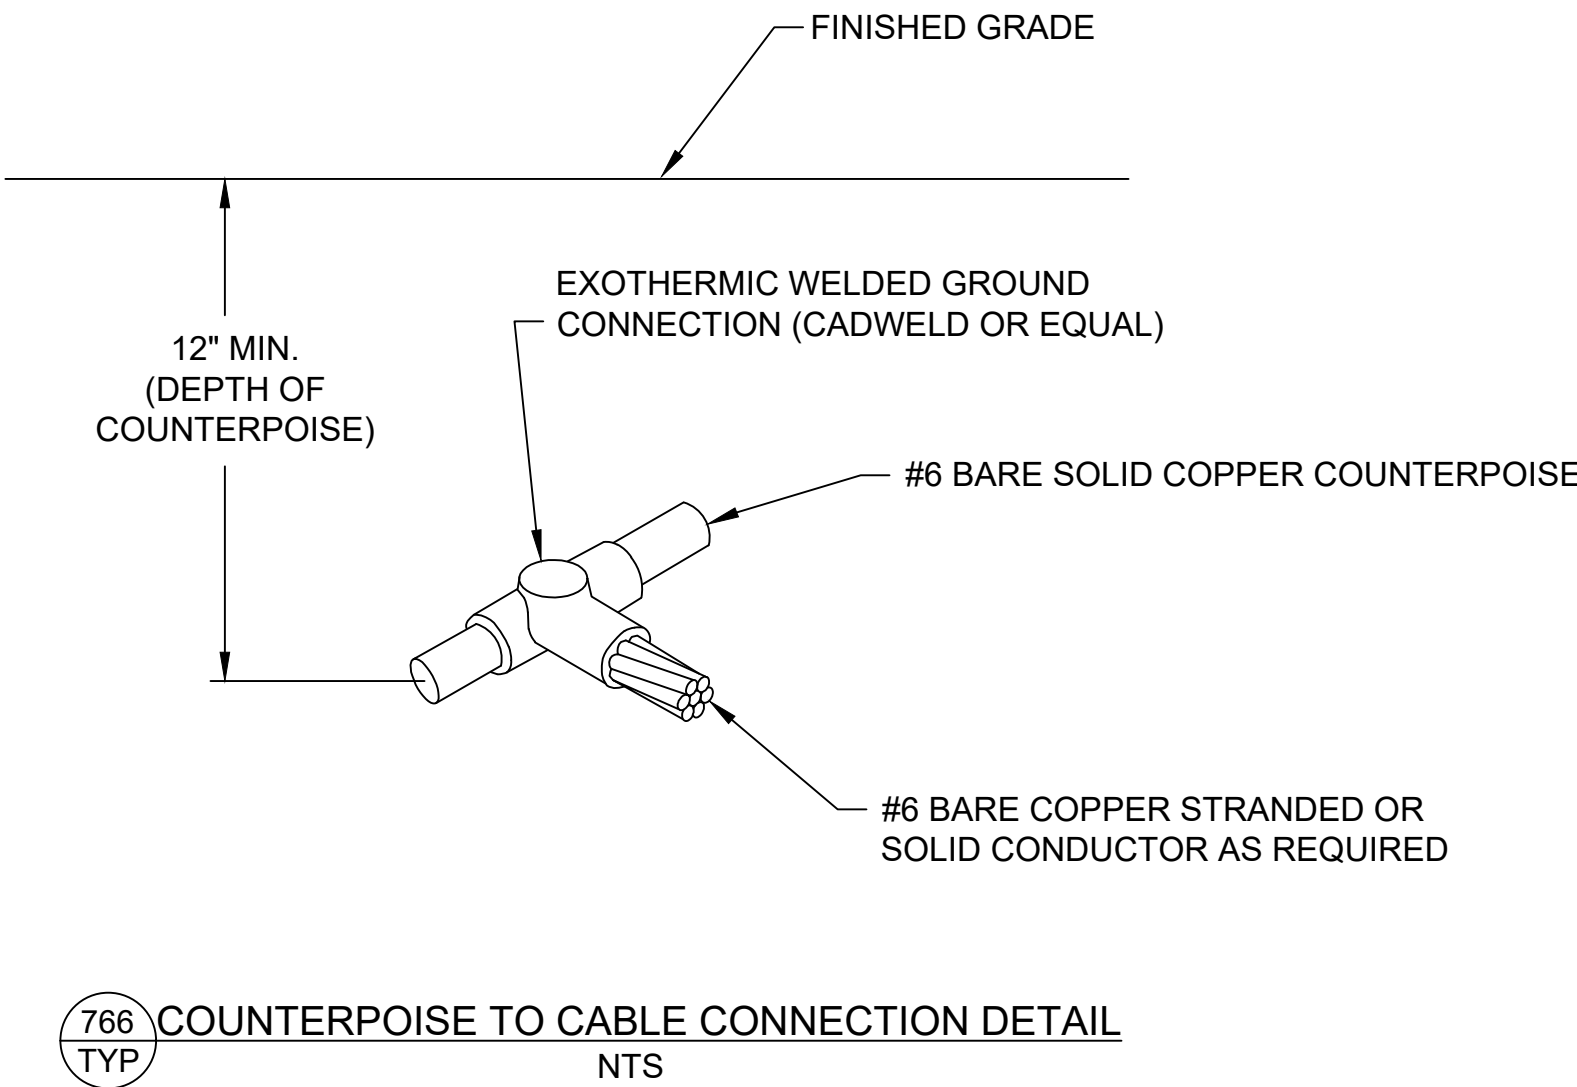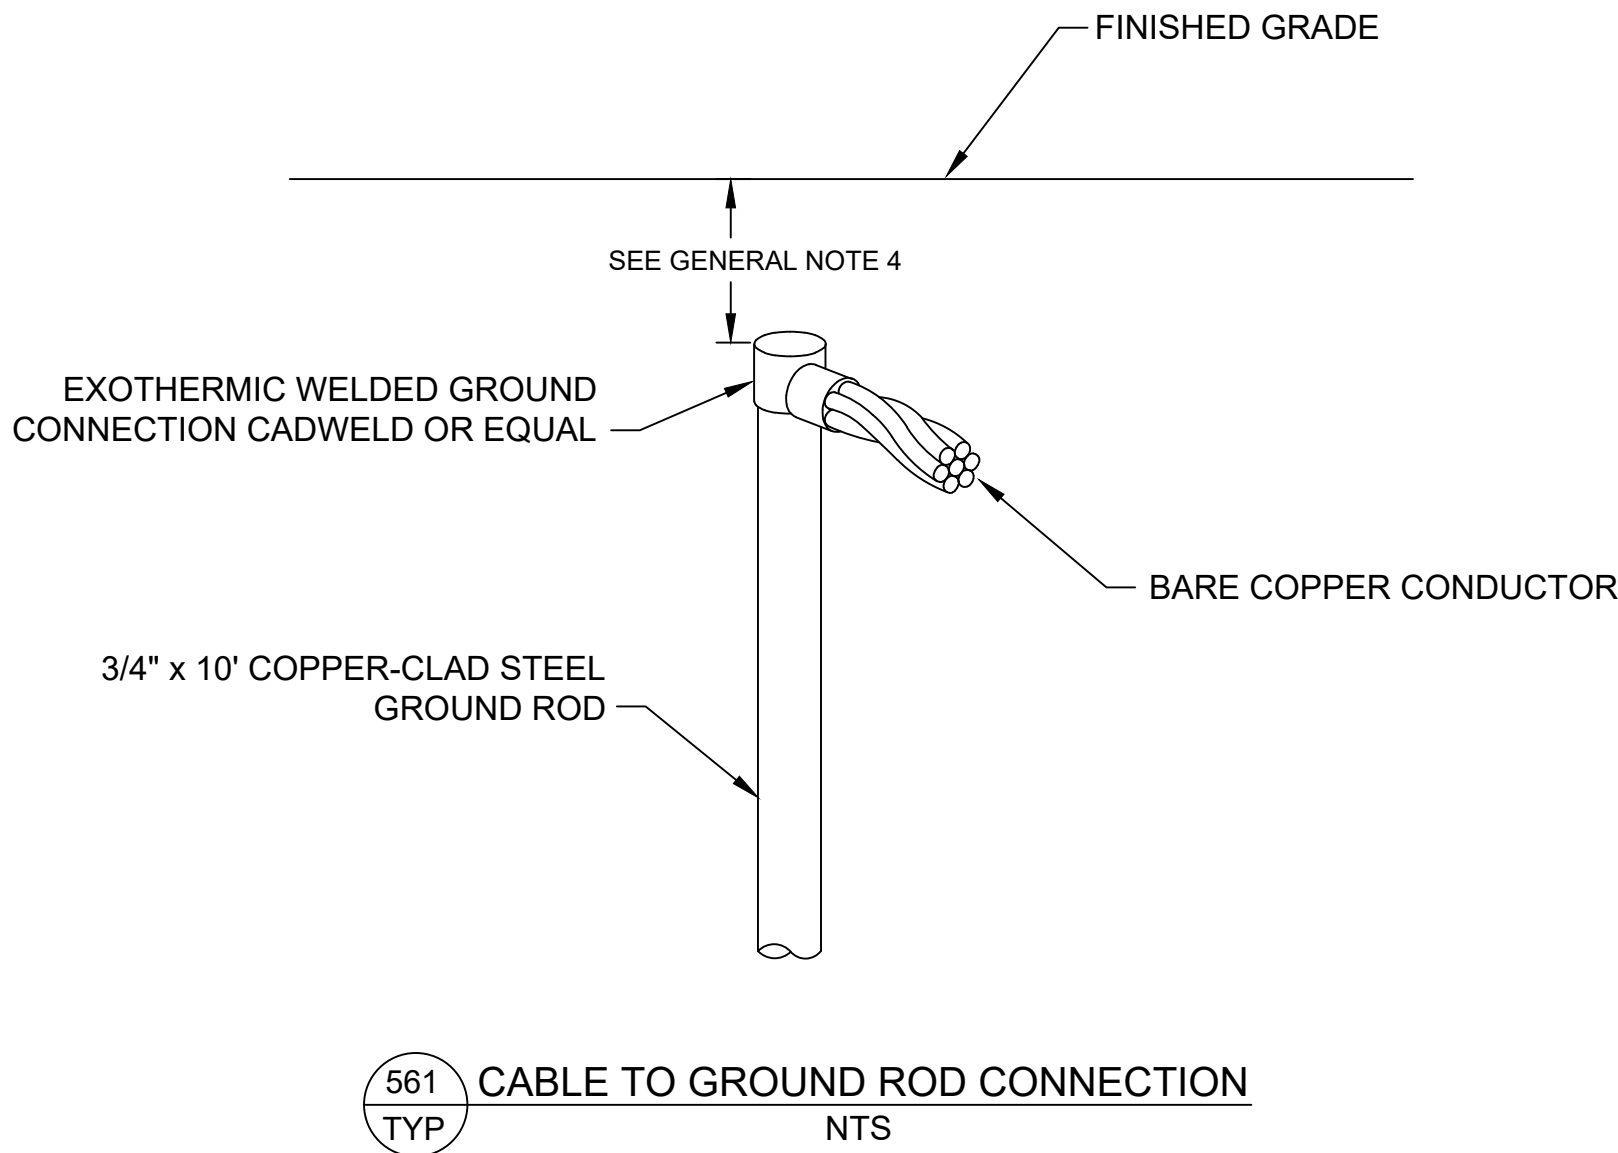

GENERAL NOTES

1. COST OF GROUND RODS IS INCIDENTAL TO THE ASSOCIATED ITEMS REQUIRING GROUNDING UNLESS OTHERWISE SPECIFIED.
2. WHERE POSSIBLE, NEW COUNTERPOISE SYSTEM SHALL BE CONNECTED TO ANY EXISTING COUNTERPOISE SYSTEM ENCOUNTERED.
3. GROUNDING ELECTRODES INSTALLED AS PART OF THE COUNTERPOISE SYSTEM SHALL BE SPACED AT DISTANCES NO GREATER THAN 500 FT. (MAX).
4. REFER TO CONDUIT/DUCTBANK DETAILS FOR DEPTHS.

D


C

B

A



C&S Engineers, Inc.

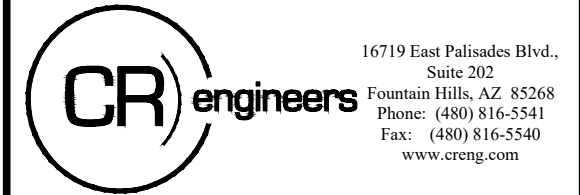

RUNWAY LIGHTS AND SIGNS
IMPROVEMENT PROJECT

LAKE HAVASU CITY MUNICIPAL AIRPORT
LAKE HAVASU CITY, AIRIZONA

MARK	DATE	DESCRIPTION
REVISIONS		
PROJECT NO: K33004009		
DATE: MARCH 2025		
DRAWN BY: JBW		
DESIGNED BY: SW		
CHECKED BY: CA		

GROUNDING
DETAILS



EA-402

D

C

B


A

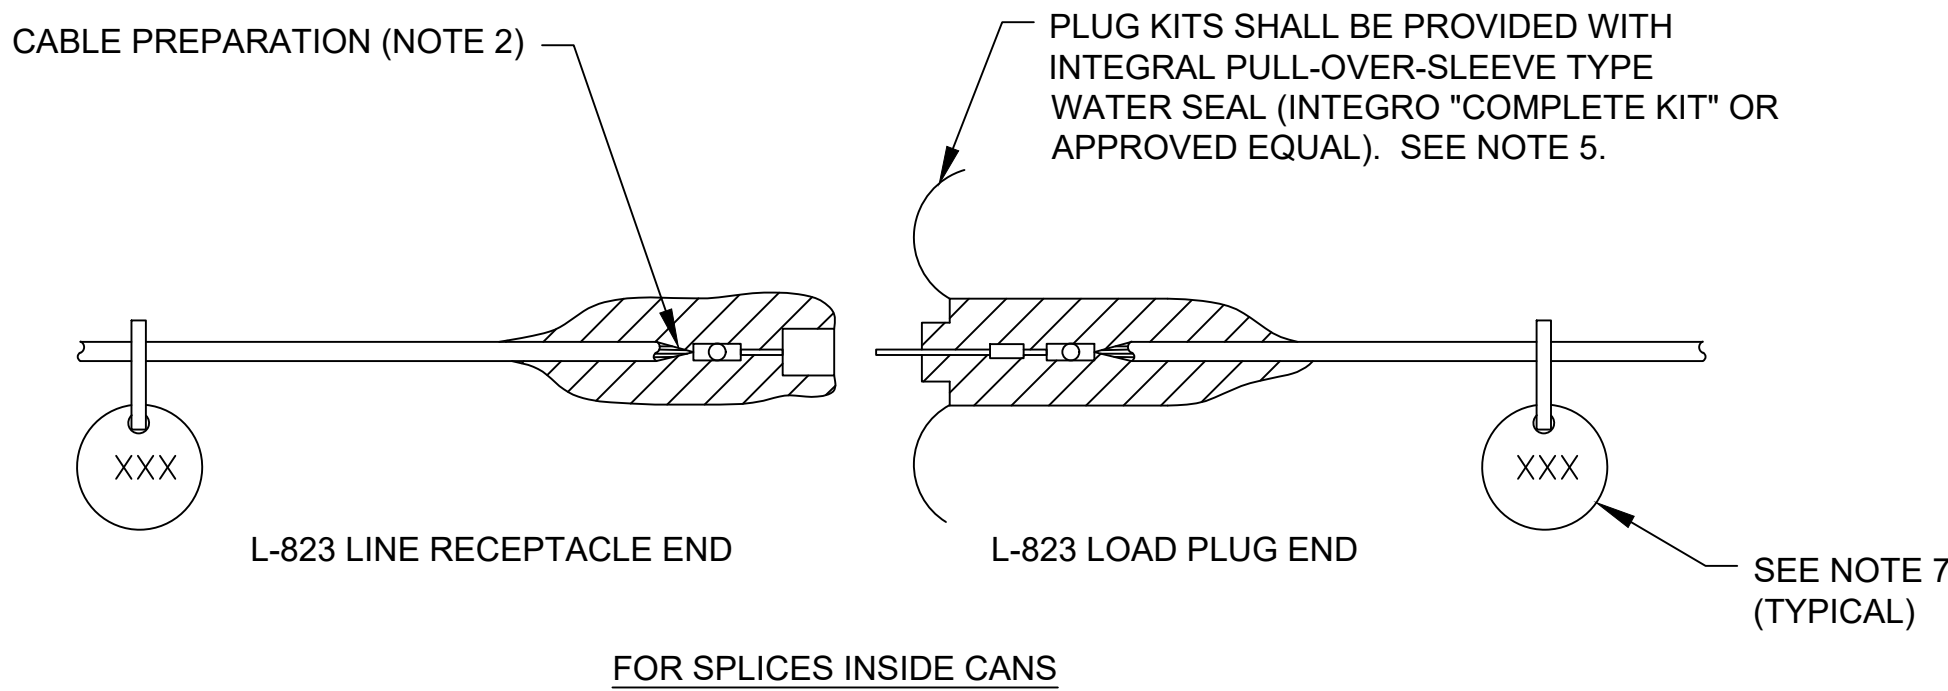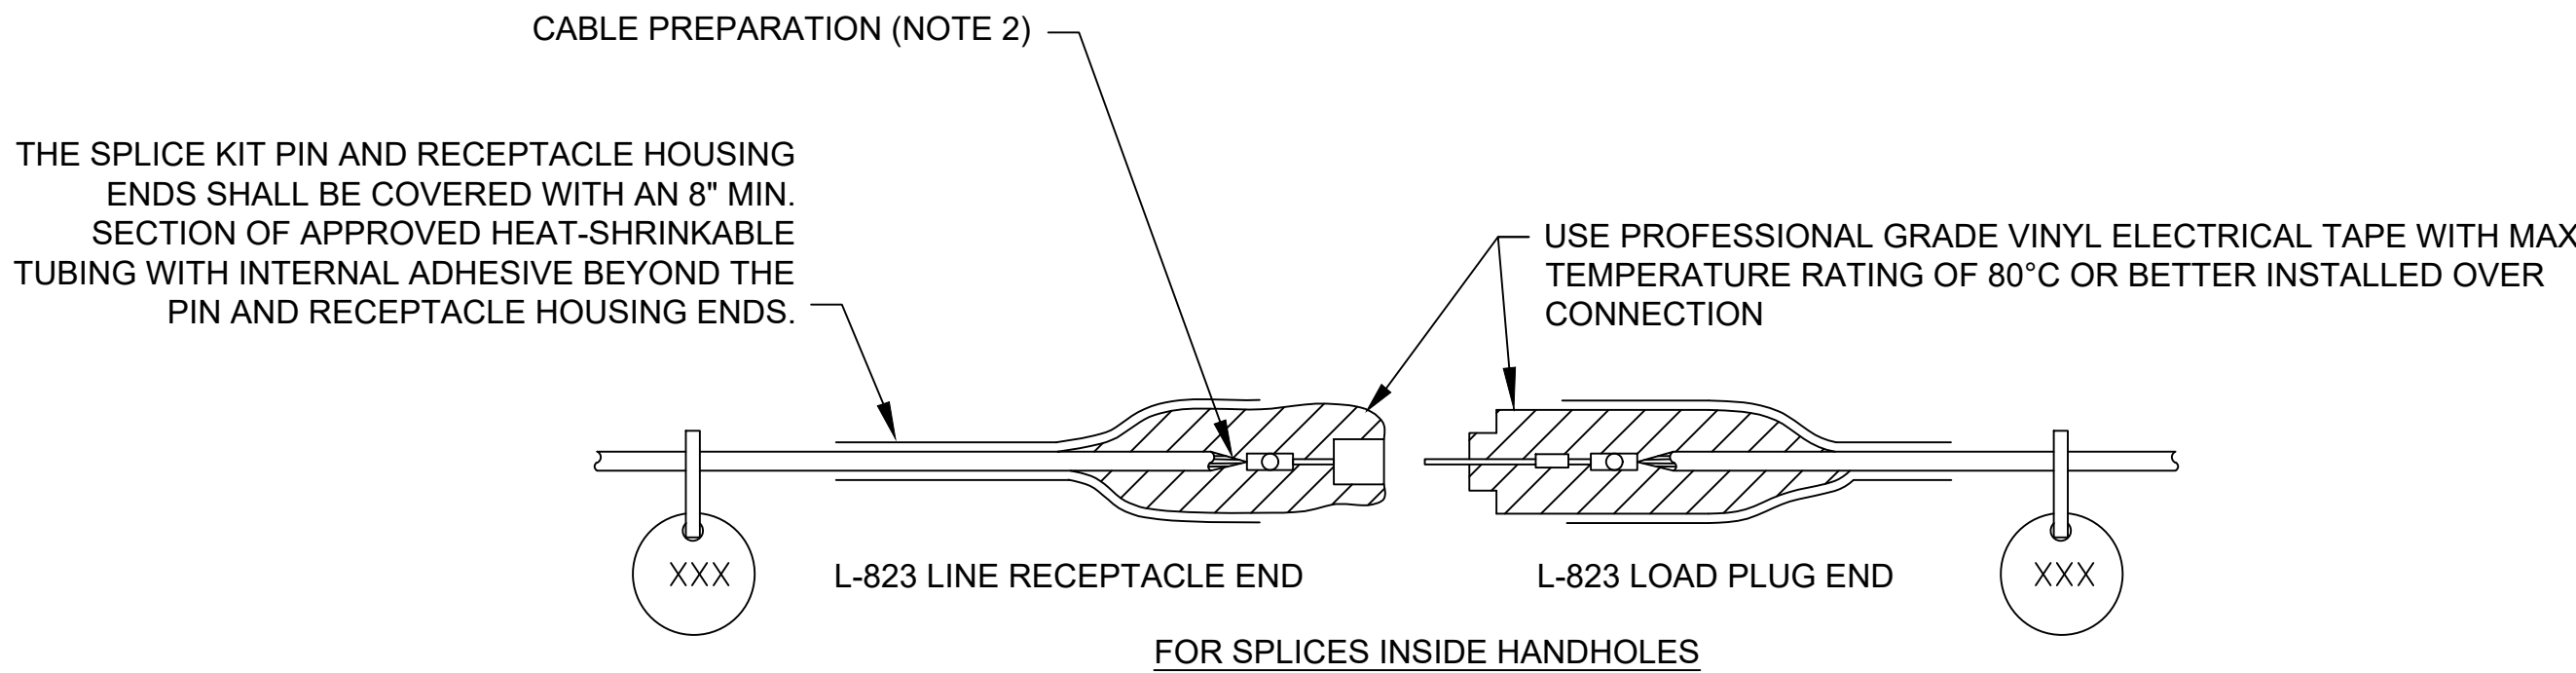

NOTES

1. PROVIDE MALE AND FEMALE L-823 CONNECTORS AS REQUIRED ON EACH CONDUCTOR IN EACH BASE, HANDHOLE, OR MANHOLE TO ALLOW ISOLATION OF HOMERUN CIRCUIT, NO STRAIGHT-THROUGH ALLOWED.
2. ALL CABLE ENDS SHALL BE PREPARED WITH THE USE OF A TAPERING TOOL SPECIFICALLY DESIGNED FOR USE WITH L-824 CABLES.
3. PLUG AND RECEPTACLE END FITTINGS SHALL BE CRIMPED ONTO THE CONDUCTOR BY USE OF AN AIRPORT PERSONNEL ACCEPTED RATCHETING TYPE CRIMPING TOOL.
4. AT THE POINT OF CONNECTION WITH THE EXISTING FIELD CIRCUITS, INSTALL NEW L-823 PLUGS ON BOTH THE NEW AND EXISTING CABLES. VERIFY INSULATION TYPES OF BOTH NEW AND EXISTING CABLES AND COORDINATE WITH TERMINATION KITS TO ASSURE PROPER AND WATERPROOF FIT.
5. INSTALL PROFESSIONAL GRADE VINYL ELECTRICAL TAPE ON CONNECTION AFTER PULLING SLEEVE OVER COMPLETE KIT.
6. THERE SHALL BE NO SPLICES BETWEEN LIGHTS, ONLY IN BASES OR HANDHOLES.
7. PROVIDE AND INSTALL NON-CONDUCTIVE CIRCUIT IDENTIFICATION TAGS ATTACHED TO EACH SIDE OF ALL CONNECTOR KITS.
8. ON THE CABLES FOR THE TAXIWAY AND SIGNAGE CIRCUITS, TAPE FROM THE BACK END OF THE CONNECTOR KIT ONTO CABLE FOR 3" EACH, BLUE THEN WHITE PHASE TAPE FOR SIGNS, BLUE ONLY PHASE TAPE FOR TAXIWAY EDGE LIGHTS, FOR FASTER IDENTIFICATION AND MATCH EXISTING MANHOLE LAYOUTS.


925 TYPICAL 5KV CABLE SPLICE
NTS

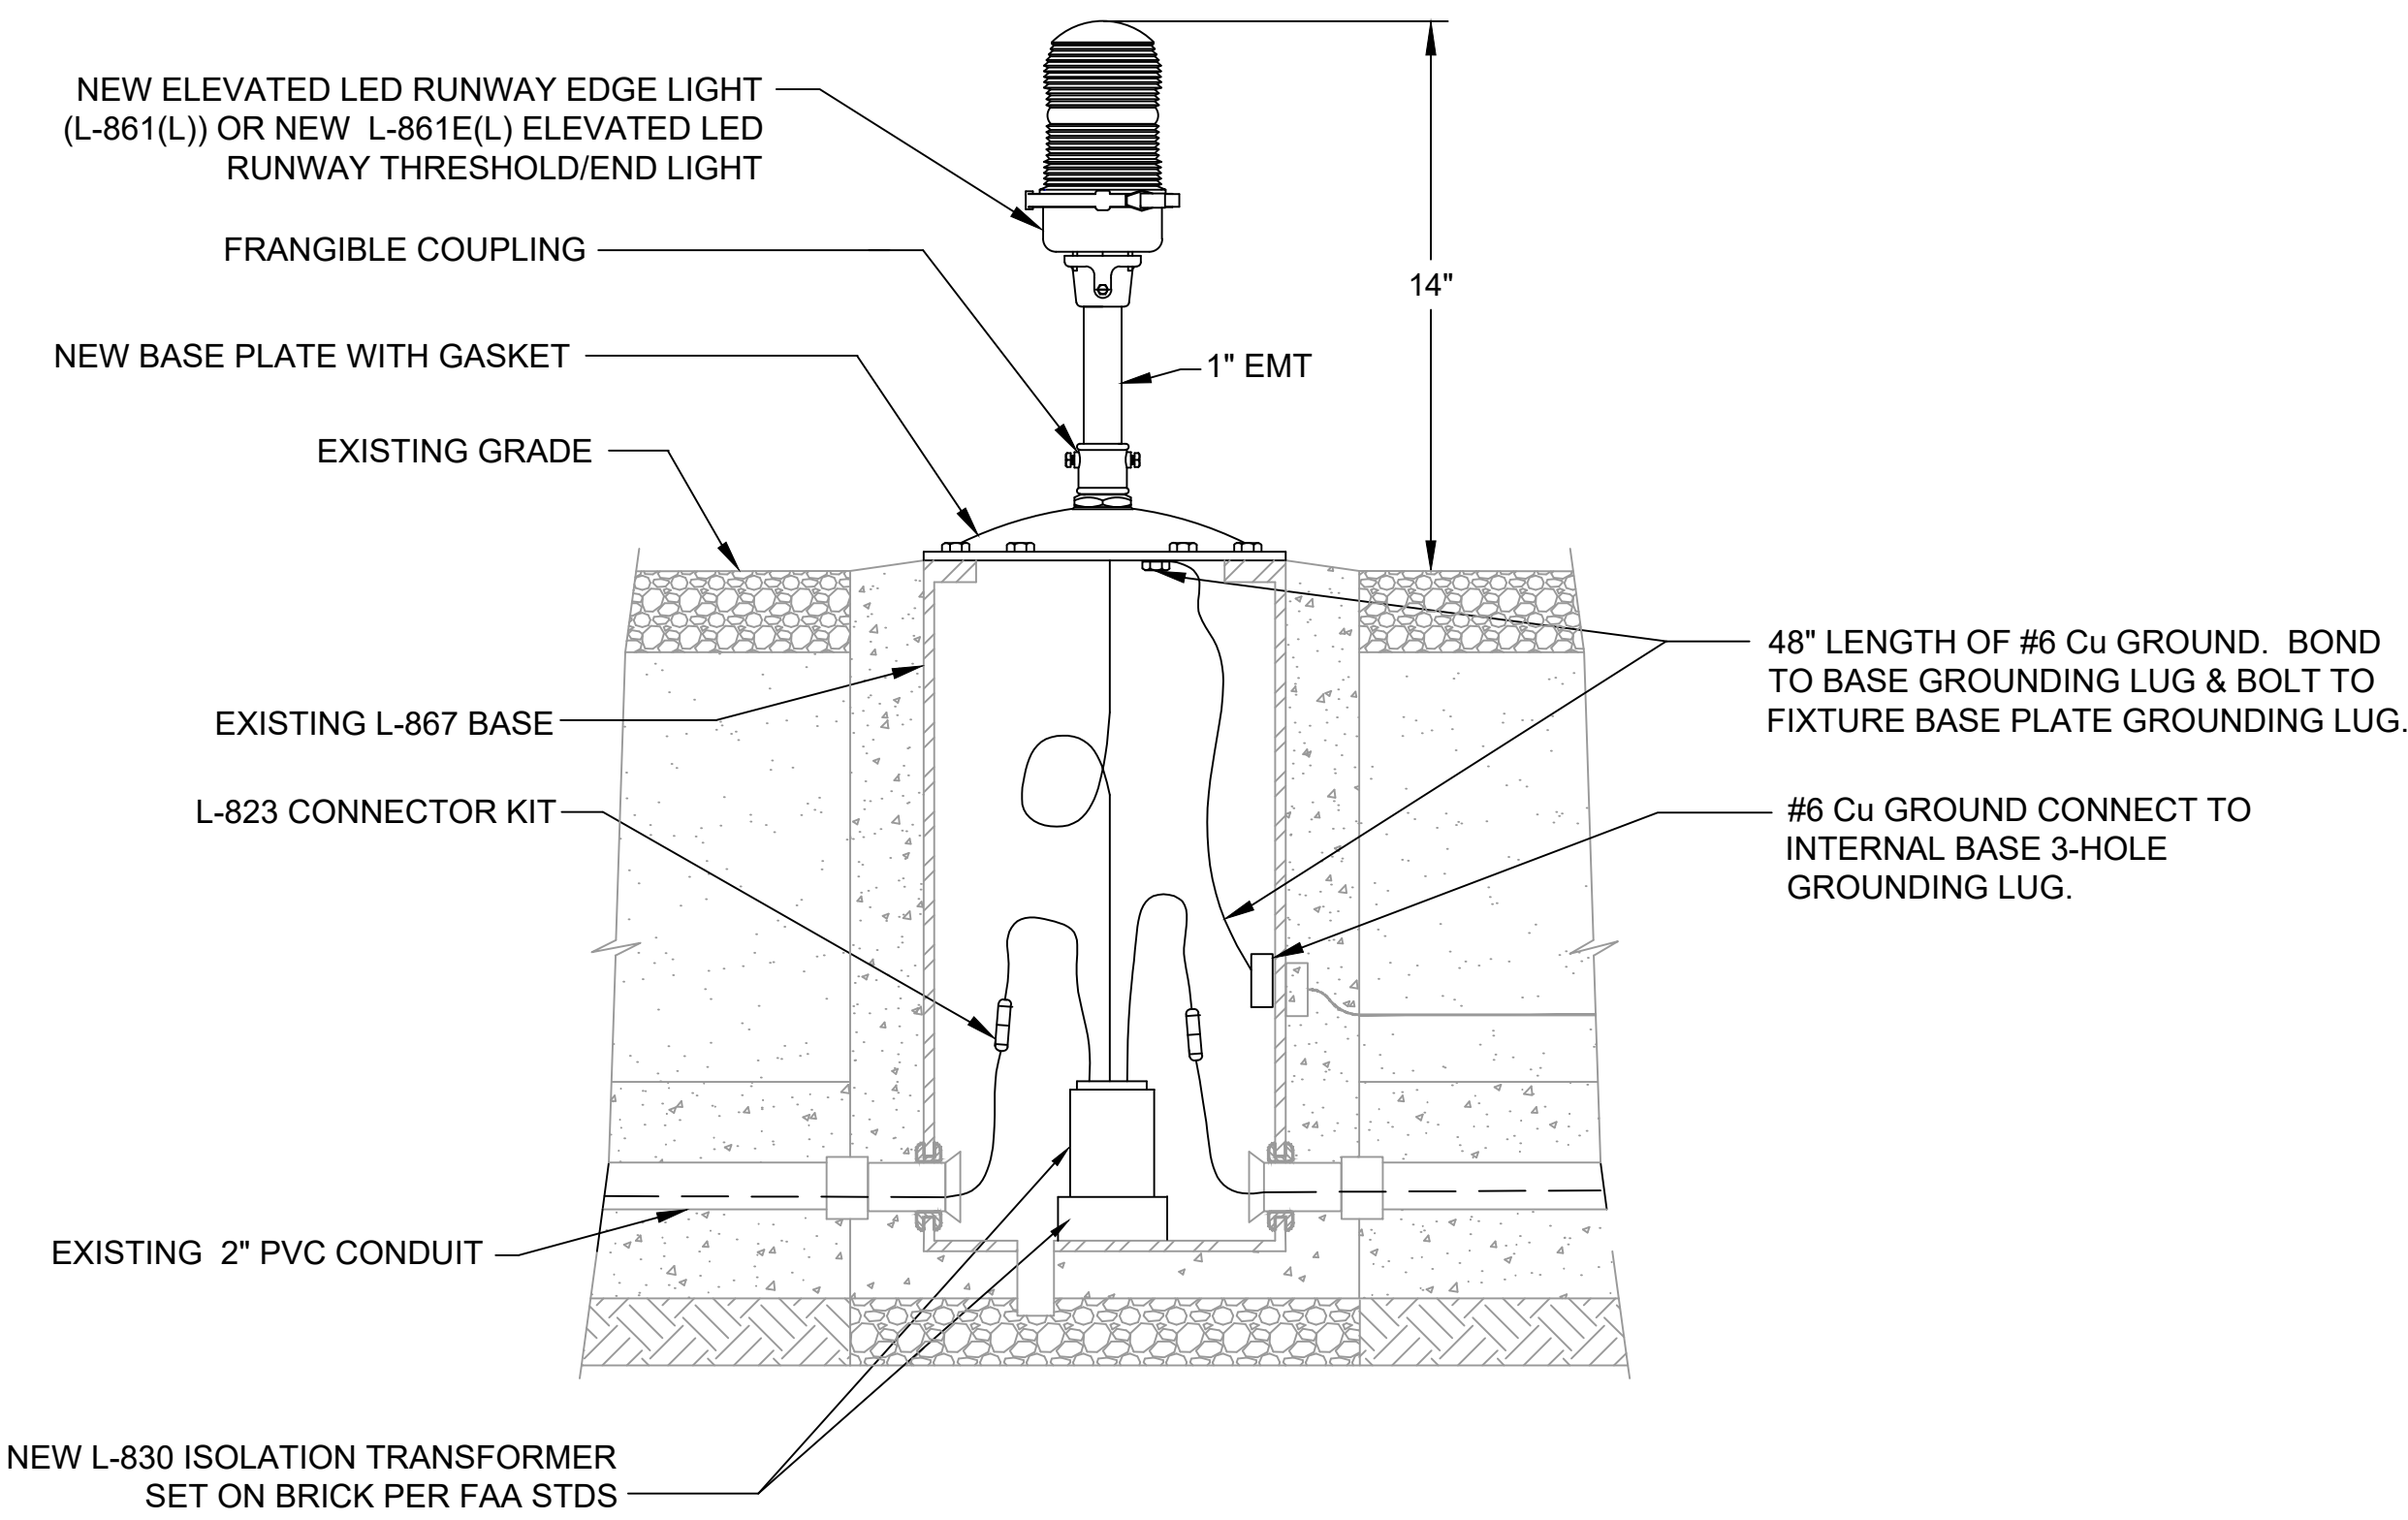

901 ELEVATED EDGE LIGHT ON EXISTING BASE CAN DETAIL
TYP NTS



C&S Engineers, Inc.

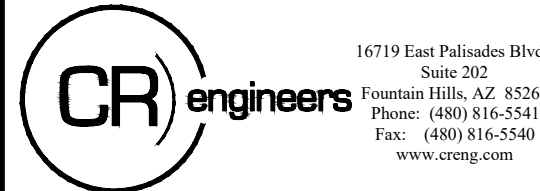

RUNWAY LIGHTS AND SIGNS
IMPROVEMENT PROJECT

LAKE HAVASU CITY MUNICIPAL AIRPORT
LAKE HAVASU CITY, AIRIZONA

MARK	DATE	DESCRIPTION
REVISIONS		
PROJECT NO: K33004009		
DATE: MARCH 2025		
DRAWN BY: JBW		
DESIGNED BY: SW		
CHECKED BY: CA		

5KV CABLE
SPLICE AND
EDGE LIGHT
DETAIL

EA-403




28 of 31

D

C

B

A

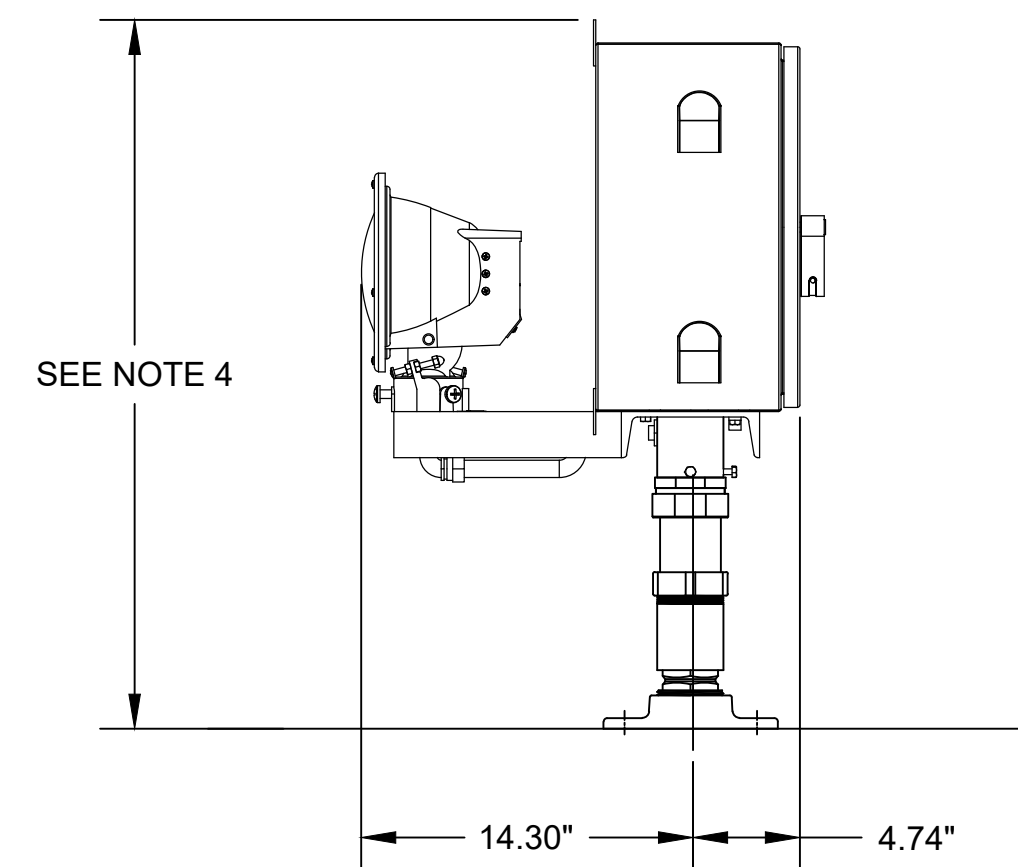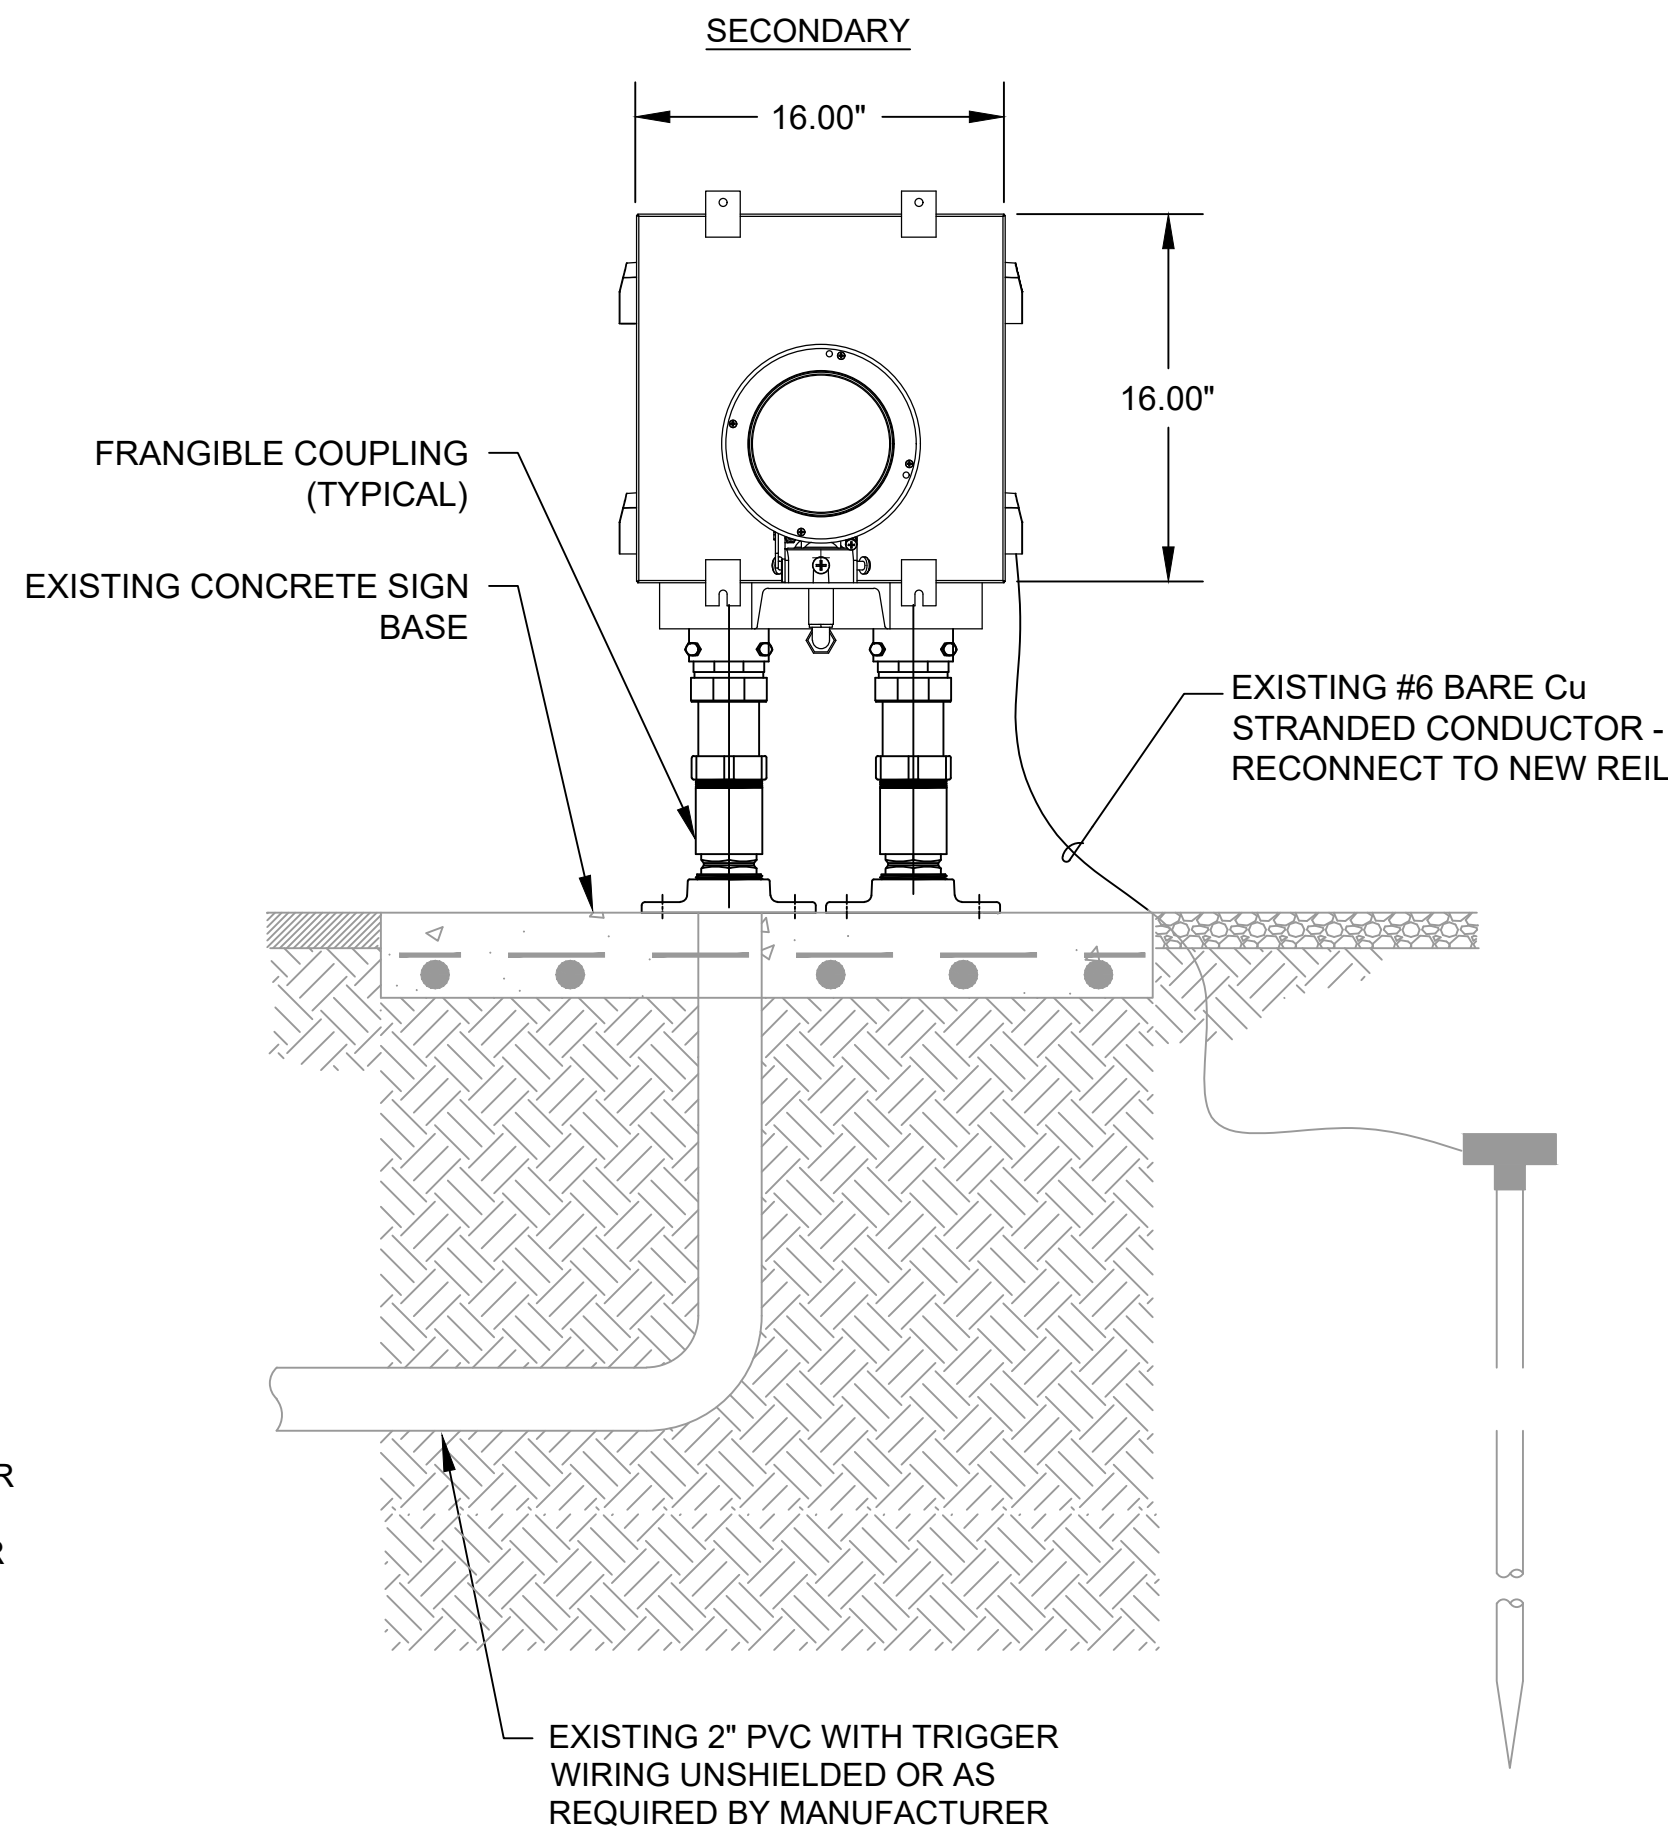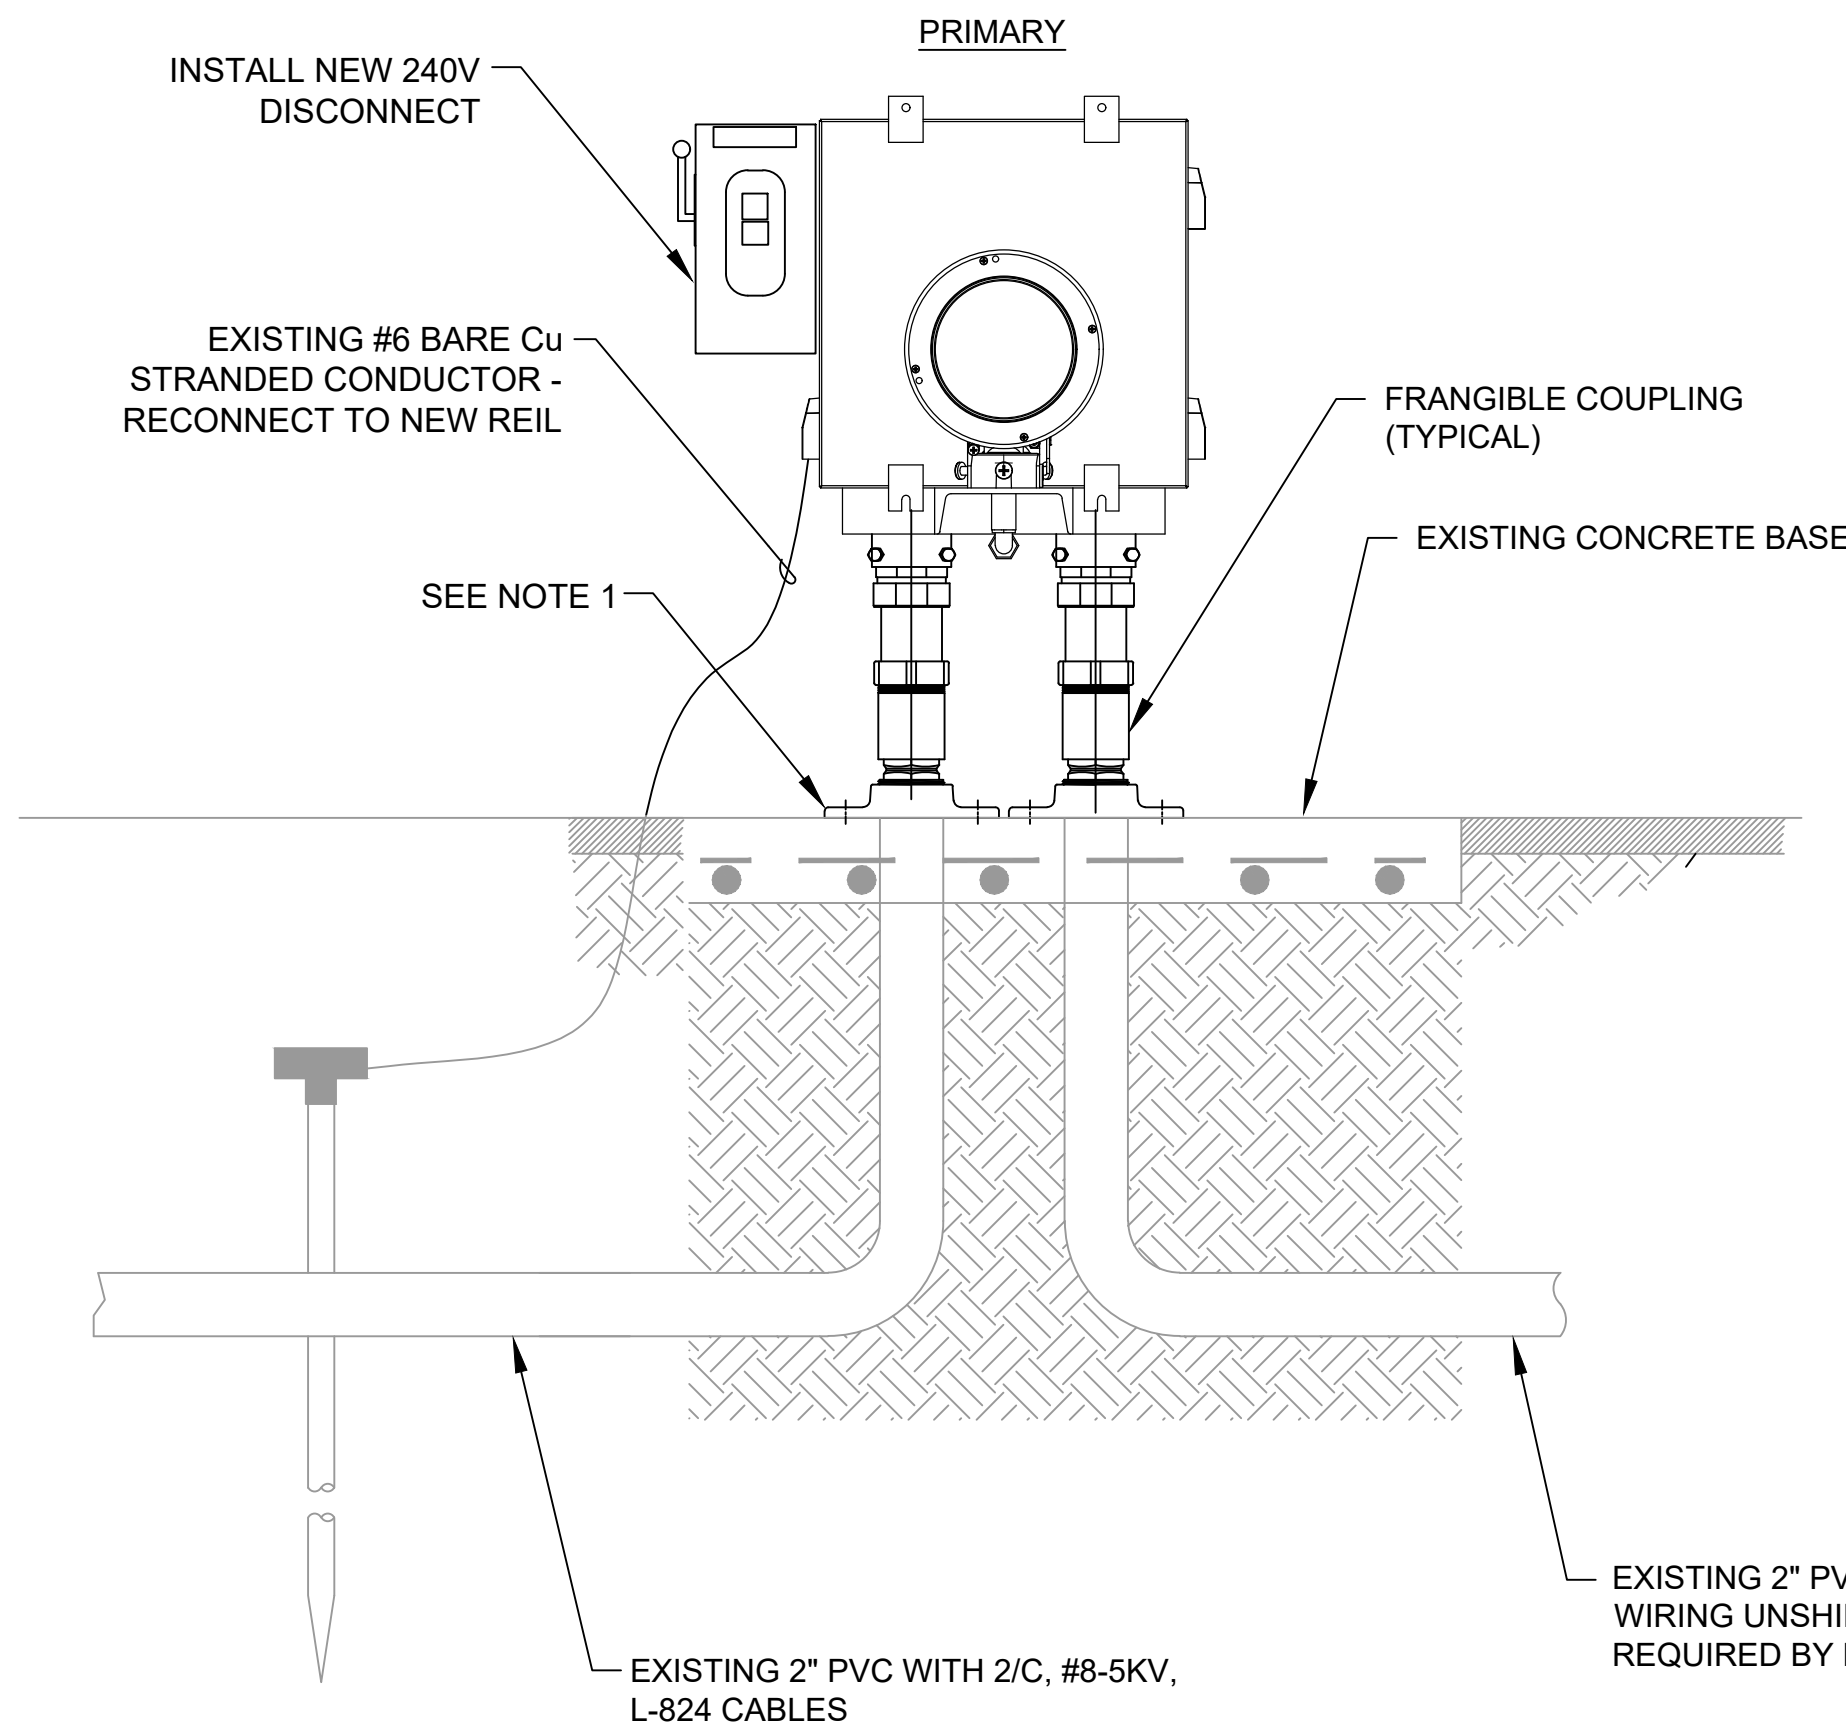


NOTES:

1. OPTIONAL BASE FLANGE SHOWN FOR REFERENCE ONLY. INSTALL PER MANUFACTURER'S RECOMMENDATIONS.
2. USE 2 INCH RGS FEMALE COUPLING IF BASE FLANGE NOT USED.
3. 2 INCH ELBOW FOR EXTERNAL WIRES.
4. THE OVERALL HEIGHT OF THE OPTICAL ASSEMBLY SHALL NOT EXCEED 36 INCHES.
5. ELEVATION FOR BOTH UNITS SHALL BE WITHIN THREE (3) FEET (MAX.) OF THE HORIZONTAL PLANE THROUGH RUNWAY CENTERLINE. CONTRACTOR SHALL FIELD SURVEY FINISHED CONSTRUCTION AND PROVIDE MEASUREMENTS IN THE RECORD DRAWINGS.
6. PROVIDE GROUNDING CONNECTION (#6 CU) AND GROUND ROD AT EACH REIL UNIT.
7. SAFETY EQUIPMENT GROUND ROD (3/4"x10' MIN.), COPPER CLAD OR EQUAL, INSTALLED A MIN. OF 6" BELOW FINISHED GRADE TO TOP OF GROUND ROD. DO NOT BOND COUNTERPOISE TO EQUIPMENT GROUND ROD - INSTALL SEPARATE COUNTERPOISE ROD PER L-108.
8. THE PAY ITEM FOR THE REILs IS ON A PER PAIR BASIS (I.E. TWO REIL UNITS FOR EACH UNIT OF PAY) WHICH SHALL INCLUDE ALL NECESSARY SCOPE TO RESULT IN A COMPLETE AND FULLY FUNCTIONAL SYSTEM.
9. RETURN OLD REILs TO THE AIRPORT.

Mar 17, 2025 - 4:40pm
Q:\PROJECTS\24000\24016 Lake Havasu Airport MRLS, REILS, RDRs\CAD\CAD SHEETS\24016 EA-404 REIL Details.dwg



C&S Engineers, Inc.

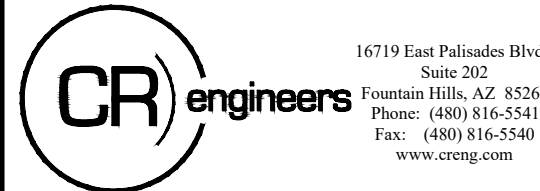

**RUNWAY LIGHTS AND SIGNS
IMPROVEMENT PROJECT**

**LAKE HAVASU CITY MUNICIPAL AIRPORT
LAKE HAVASU CITY, AIRIZONA**

MARK	DATE	DESCRIPTION
REVISIONS		
PROJECT NO: K33004009		
DATE: MARCH 2025		
DRAWN BY: JBW		
DESIGNED BY: SW		
CHECKED BY: CA		

**RUNWAY END
IDENTIFIER
LIGHT (REIL)
DETAILS**


EA-404

D

C

B

A

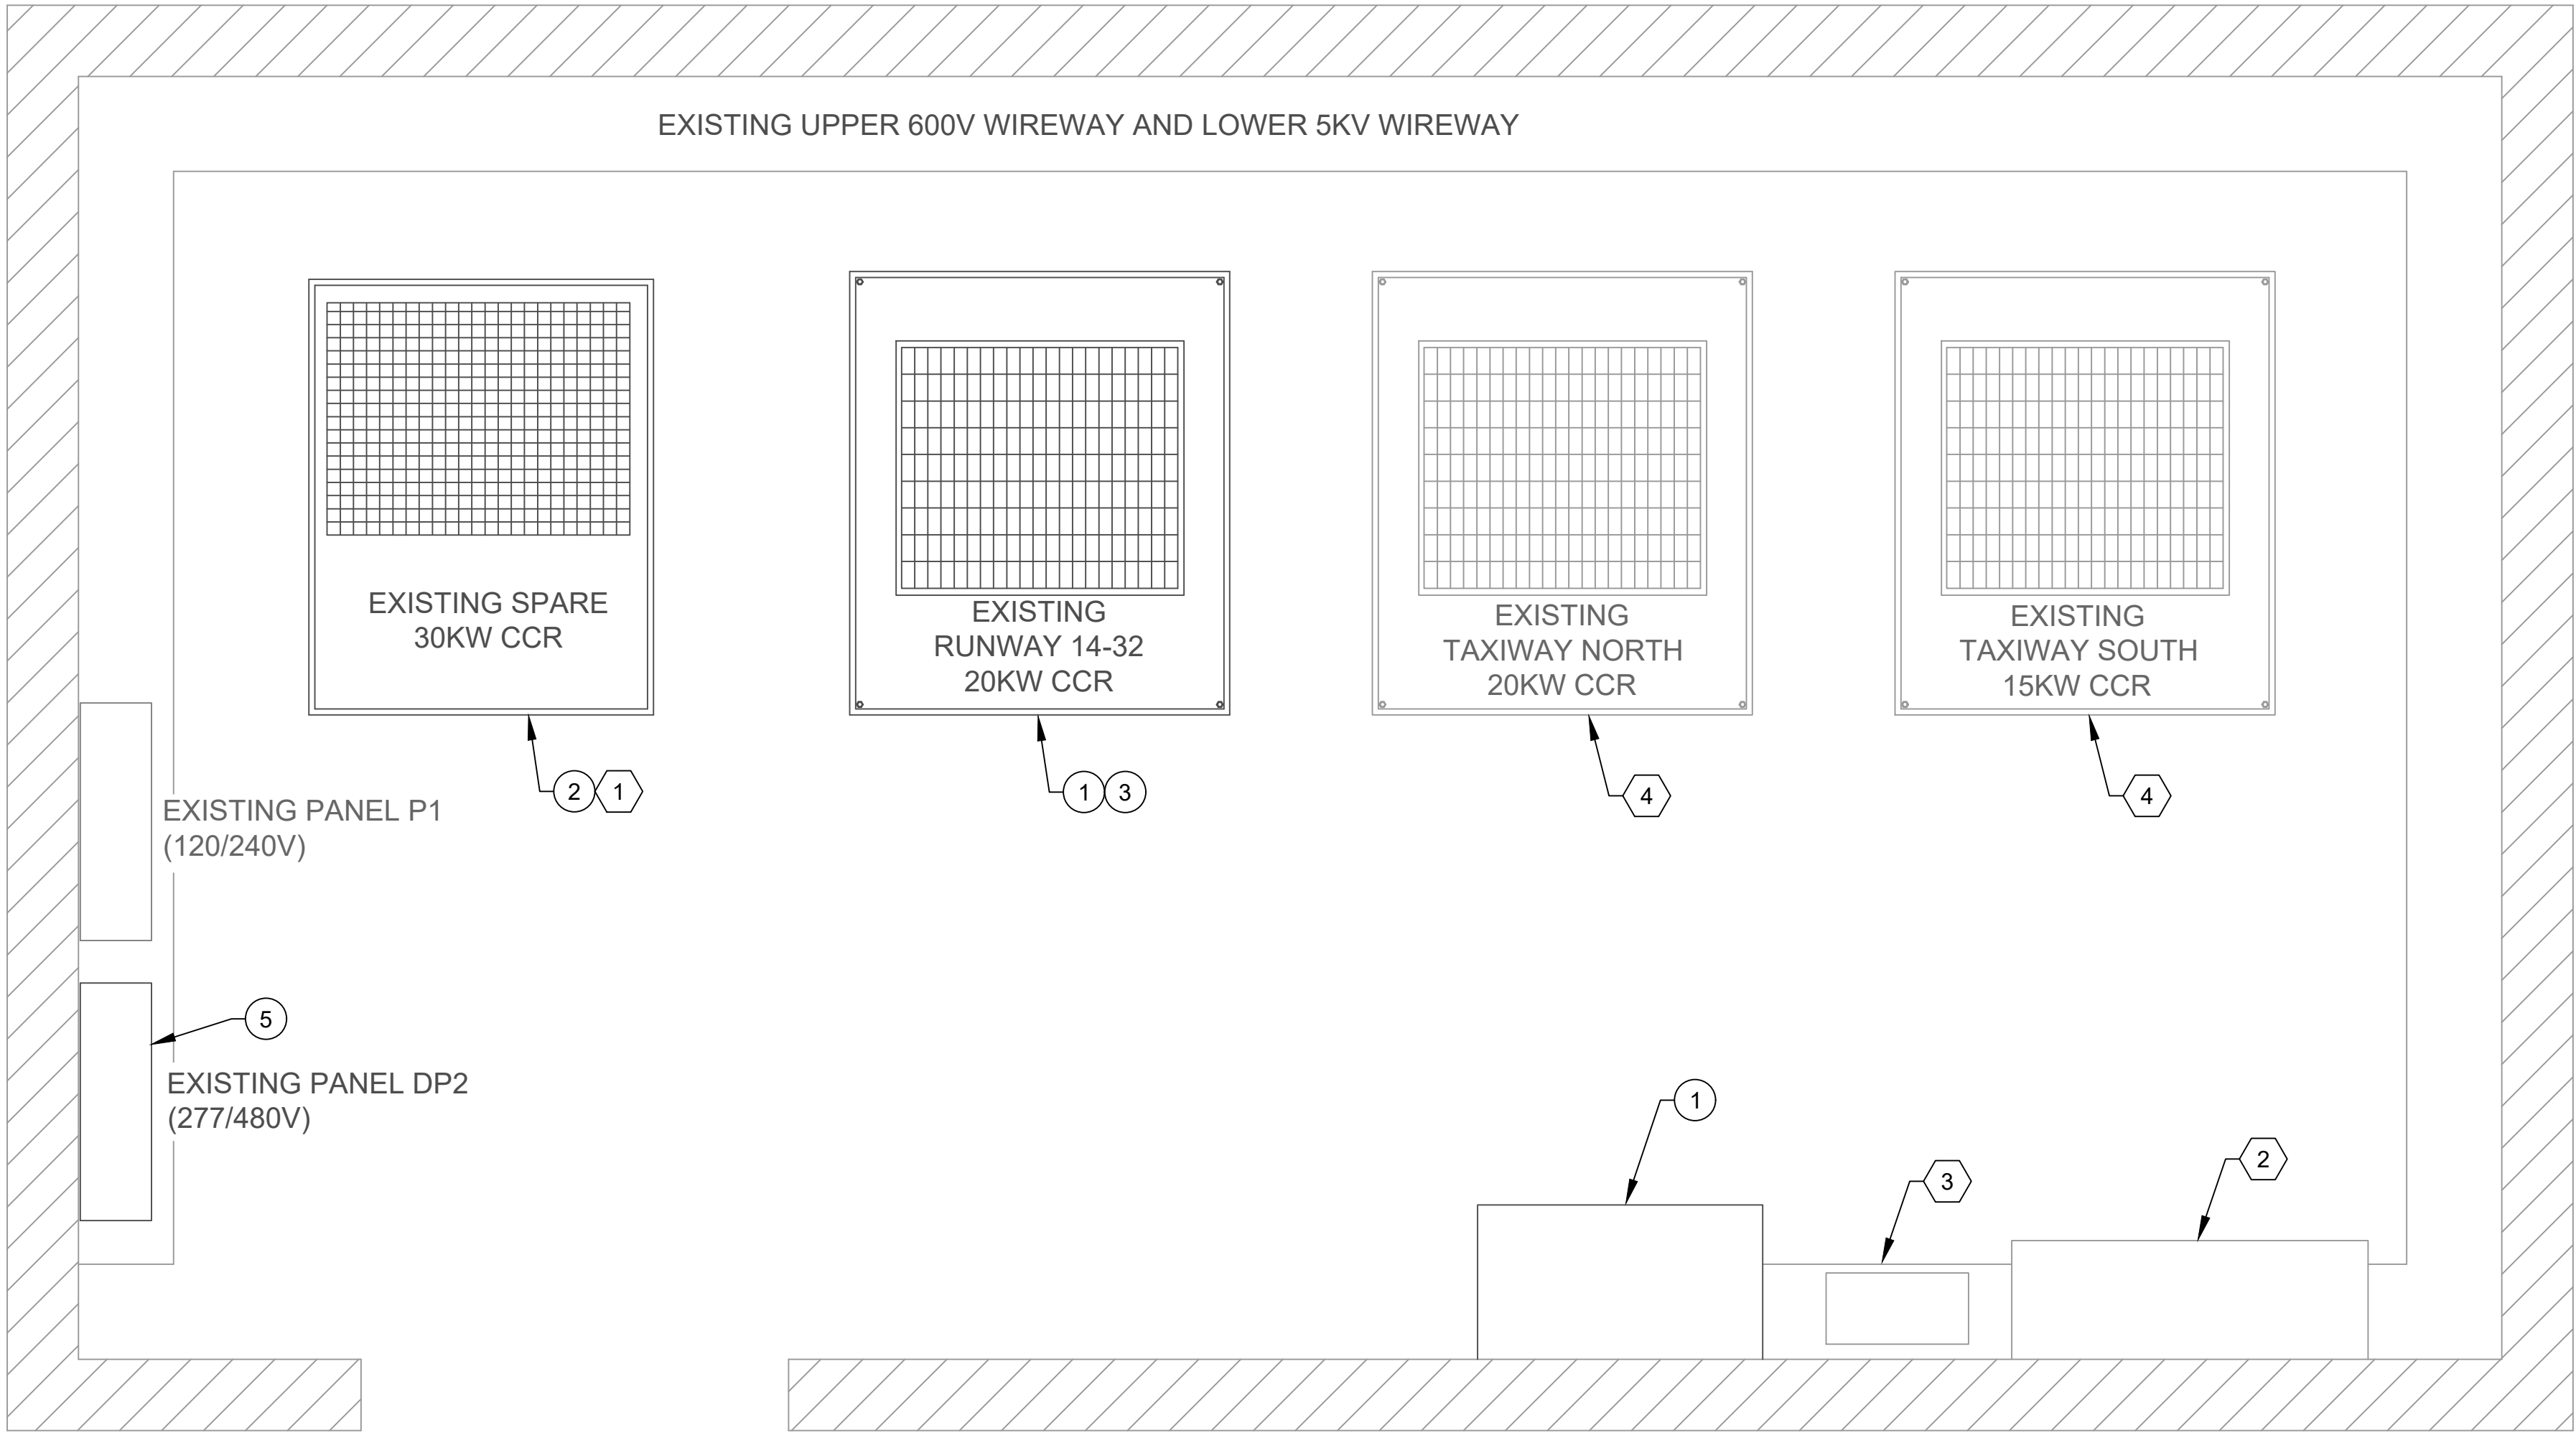

○ CONSTRUCTION NOTE ○

- 1 DISCONNECT EXISTING 20KW RUNWAY CCR FEEDER, OUTPUT CABLES AND CONTROL CABLES. RELOCATE EXISTING 20KW CCR AND INPUT FEEDER FOR RECONNECTION IN SPARE CCR POSITION.
- 2 DISCONNECT AND REMOVE EXISTING 30KW SPARE CCR AND RETURN TO AIRPORT. RECONNECT EXISTING 20KW RUNWAY CCR WITH EXISTING #6 FEEDER CABLES IN SPARE POSITION. INSTALL NEW L-824 CABLES TO S1 CUTOUT CABINET. CONNECT CCR TO GROUND BUS WITH #6 GROUND CONDUCTOR.
- 3 INSTALL NEW 7.5KW RUNWAY CCR AFTER CUTOVER TO NEW LED RUNWAY EDGE LIGHTS. RECONNECT EXISTING CONTROL AND L-824 OUTPUT CABLES. PROVIDE NEW 2-#10, #10 GND, 30A, 480V FEEDER CABLES FROM PANEL DP2. RECONNECT GROUND CONDUCTOR.
- 4 INSTALL AND CONNECT NEW L-824 FIELD CIRCUIT HOMERUN TO EXISTING S1 CUTOUT CABINET FOR NEW RUNWAY CIRCUIT.
- 4 INSTALL NEW 30A, 2P BREAKER FOR NEW CCR IN EXISTING PANEL DP2. REFER TO MODIFIED PANEL DP2 SCHEDULE ON SHEET EA-502.

◇ REFERENCE NOTE ◇

- 1 EXISTING SPARE 30KW CCR 480V INPUT FED WITH 240V FROM EXISTING PANEL P1
- 2 EXISTING L-821 LIGHTING CONTROL PANEL TO REMAIN
- 3 EXISTING L-854 RADIO TO REMAIN
- 4 EXISTING CCR TO REMAIN

D


C

B

A



C&S Engineers, Inc.

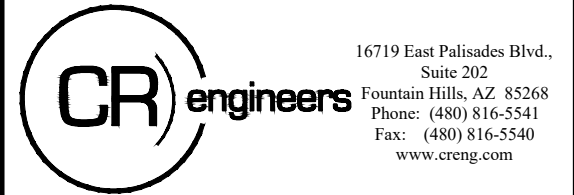

**RUNWAY LIGHTS AND SIGNS
IMPROVEMENT PROJECT**
LAKE HAVASU CITY MUNICIPAL AIRPORT
LAKE HAVASU CITY, AIRIZONA

MARK	DATE	DESCRIPTION
REVISIONS		
PROJECT NO: K33004009		
DATE: MARCH 2025		
DRAWN BY: JBW		
DESIGNED BY: SW		
CHECKED BY: CA		

**AIRFIELD
LIGHTING VAULT
EQUIPMENT
MODIFICATIONS**

EA-501

30 of 31

D

C

B

A

PANEL: P1		VOLTAGE: 120/240		MAIN CB: MLO		BUS AMPS: 125	
CB TYPE: BOLT-ON		MOUNTING: SURFACE		BRACING: 22K		BKR AIC: 22K	
CIRCUIT DESCRIPTION	BKR	CIRCUIT	LINE 1	LINE 2	CIRCUIT	BKR	CIRCUIT DESCRIPTION
PAPI 32	20	1					
	/				2	20	REIL 14
	2	3				/	
					4	2	
NOT LABELED	20	5					
	/				6	20	REIL 32
	2	7				/	
					8	2	
AC #1	40	9					
	/				10	100	**SPARE CCR
	2	11				/	
					12	2	
VAULT LIGHTS	20 / 1	13					
	20 / 1	15			14	20 / 1	L-821 CONTROL PANEL
					16	20 / 1	SPARE
	20 / 1	17					
	20 / 1	19			18	20 / 1	SPARE
	20 / 1	21			20	20 / 1	VAULT RECEPTACLE
	20 / 1	23			22	20 / 1	SHED
					24	20 / 1	GENERATOR RECEPTACLE
SPACE		25					
					26		SPACE
SPACE		27					
					28		SPACE
SPACE		29					
					30		SPACE
CONNECTED KVA PER PHASE			0.0	0.0	NOTES: SIEMENS TYPE BLH BREAKERS		
CONNECTED AMPS PER PHASE			0.0	0.0	** DISCONNECT EXISTING SPARE CCR FEEDER		
25% OF CONTINUOUS & LIGHTING LOAD (KVA)			0.0	0.0	RELABEL BREAKER AS SPARE		
LARGEST MOTOR (25%)			0.0	0.0			
CODE KVA PER PHASE			0.0	0.0			
CODE AMPS PER PHASE AT 120V			0.0	0.0			

(EXISTING SPARE CCR IS 480V INPUT)



EXISTING PANEL P1 SCHEDULE

PANEL: DP2		VOLTAGE: 277/480		MAIN CB: MLO		BUS AMPS: 250		
CB TYPE: BOLT-ON		MOUNTING: SURFACE		BRACING: 25k		BKR AIC: 25k		
CIRCUIT DESCRIPTION	BKR	CIRCUIT	PHASE A	PHASE B	PHASE C	CIRCUIT	BKR	CIRCUIT DESCRIPTION
BEACON	20	1						
	/					2	20	SPARE
	2	3					/	
						4	2	
PAPI 14	20	5						
	/					6	20	PRIMARY WINDCONE
	2	7					/	(SEGMENTED CIRCLE)
						8	2	(A WOS SUB PANEL)
*SPARE CCR	60	9						
(OLD 20KW RWY CCR)	/					10	60	TAXIWAY NORTH (TN) CCR
	2	11					/	
						12	2	
TAXIWAY SOUTH (TS) CCR	60	13						
	/					14	100	50KVA TRANSFORMER
	2	15					/	(PANEL P1)
						16	2	
SPARE	20 / 1	17						
						18	20 / 1	SPARE
SPARE	20 / 1	19						
						20	20 / 1	SPARE
SPARE	20 / 1	21						
						22	20 / 1	SPARE
NEW 7.5KW RUNWAY CCR	**30	23						
	/					24	20 / 1	SPARE
	2	25						
						26		SPACE
SPACE		27						
						28		SPACE
SPACE		29						
						30		SPACE
CONNECTED KVA PER PHASE			0.0	0.0	0.0	NOTES: SIEMENS TYPE NGB BREAKERS		
CONNECTED AMPS PER PHASE			0.0	0.0	0.0	* RECONNECT RELOCATED CCR TO EXISTING		
25% OF CONTINUOUS & LIGHTING LOAD (KVA)			0.0	0.0	0.0	BREAKER. RELABEL AS SPARE		
LARGEST MOTOR (25%)			0.0	0.0	0.0	** INSTALL NEW 30A 2-POLE BREAKER FOR		
CODE KVA PER PHASE			0.0	0.0	0.0	NEW 7.5KW RUNWAY CCR.		
CODE AMPS PER PHASE AT 277V			0.0	0.0	0.0			

EXISTING PANEL PD2 SCHEDULE



C&S Engineers, Inc.

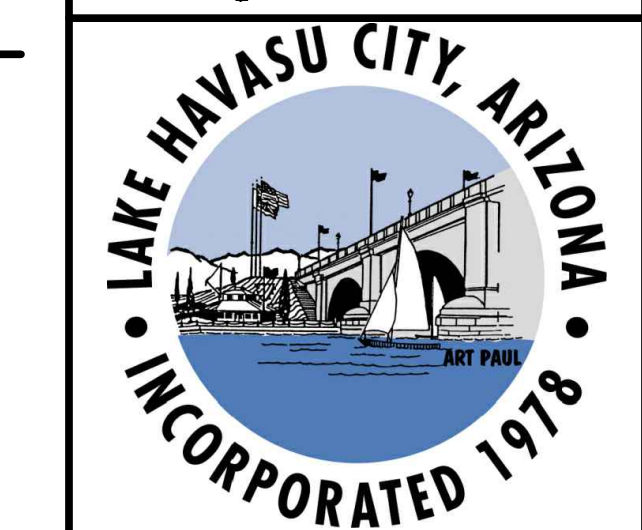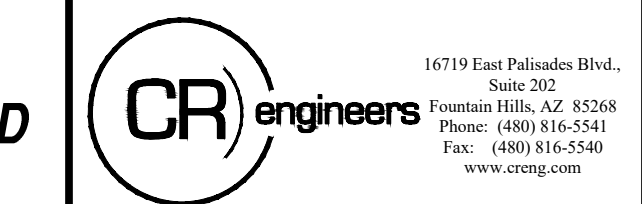

RUNWAY LIGHTS AND SIGNS
IMPROVEMENT PROJECT

LAKE HAVASU CITY MUNICIPAL AIRPORT
LAKE HAVASU CITY, AIRIZONA

MARK	DATE	DESCRIPTION
REVISIONS		
PROJECT NO: K33004009		
DATE: MARCH 2025		
DRAWN BY: JBW		
DESIGNED BY: SW		
CHECKED BY: CA		

AIRFIELD
LIGHTING
VAULT PANEL
SCHEDULES

Mar 17, 2025 - 4:40pm
Q:\PROJECTS\24000\24016 Lake Havasu Airport - REILS, RDRs, CAD\CAD SHEETS\24016 EA-502 AIRFIELD LIGHTING VAULT PANEL SCHEDULES.dwg