

RESOLUTION 15-2930

A RESOLUTION OF THE MAYOR AND CITY COUNCIL OF LAKE HAVASU CITY, MOHAVE COUNTY, ARIZONA, DECLARING AS A PUBLIC RECORD THE "LAKE HAVASU CITY AMENDMENTS TO THE 2011 EDITION OF THE NATIONAL ELECTRICAL CODE" DATED MAY 12, 2015

IT IS RESOLVED by the Mayor and City Council of Lake Havasu City, Arizona, that the document entitled "Lake Havasu City Amendments to the 2011 Edition of the National Electrical Code" is declared a public record and at least three copies are on file in the City Clerk's Office for public use and inspection.


PASSED AND ADOPTED by the City Council of Lake Havasu City, Arizona, on May 12, 2015.

APPROVED:




Mark S. Nexsen, Mayor

ATTEST:

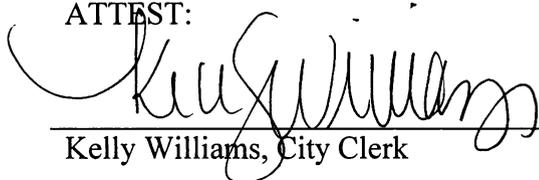


Kelly Williams, City Clerk

APPROVED AS TO FORM:

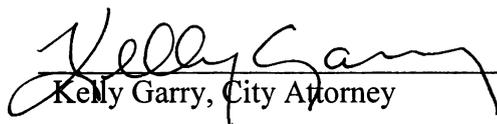

Kelly Garry, City Attorney

REVIEWED BY:

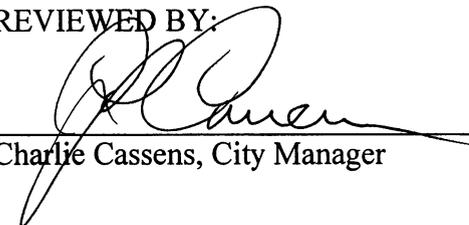

Charlie Cassens, City Manager

**LAKE HAVASU CITY AMENDMENTS TO THE 2011 EDITION OF THE NATIONAL
ELECTRICAL CODE**

May 12, 2015

Section 90.10 Amend to add section 90.10 to read:

Building Classifications. For the purpose of electrical code applications, all buildings erected within the jurisdiction of the City shall be classified as follows:

- A. Residential
- B. Commercial

Article 100 Amend to insert after Clothes Closet:

Commercial: All buildings not defined as residential by this article shall be considered commercial for purposes of this code.

Article 100 Amend to insert after Remote-Control Circuit:

Residential: Buildings whose actual or potential purpose is for human habitation, for one and two family dwellings, or multi-family dwellings not exceeding three floors above grade. For the purpose of this definition the first floor of a building shall be that floor that has 50 percent or more of the exterior wall surface area level with or above finished grade. One additional level that is the first level and not designed for human habitation and used only for vehicle parking, storage or similar use shall be permitted. Buildings of public accommodation e.g. hotels, motels and inns are not included within this classification.

Section 225.32 Amend entire section, excluding exceptions to read:

The disconnecting means shall be installed outside of a building or other structure at a readily accessible location nearest the point of entrance of the service conductors. The disconnecting means may be installed inside of a commercial or industrial building within the confines of an electrical equipment room. Electrical equipment rooms shall be constructed to meet the following conditions:

1. The equipment room shall separate the electrical equipment from other portions of the building by not less than a 2-hour rated fire barrier complying with IBC section 706.
2. Access for Fire Department personnel shall be provided by a minimum 3'-0" x 6'-8" exterior door.
3. The owner shall place an equipment door key in a lock box accessible to the Fire Department and the utility server on or near the equipment room door.
4. The equipment room shall be limited to electrical and communication equipment only.
5. No storage shall occur in the electrical equipment room.
6. Electrical equipment rooms shall be vented at a ratio of 1 square foot to 150 square feet of floor area when ducts do not provide conditioned air.

Section 230.70 (A) (1) Amend part (A) item (1) to read:

The service disconnecting means shall be installed outside of a building or other structure at a readily accessible location nearest the point of entrance of the service conductors. The service disconnecting means may be installed inside of a commercial or industrial building within the confines of an electrical equipment room. Electrical equipment rooms shall be constructed to meet the following conditions:

1. The equipment room shall separate the electrical equipment from other portions of the building by not less than a 2-hour rated fire barrier complying with IBC section 706.
2. Access for Fire Department personnel shall be provided by a minimum 3'-0" x 6'-8" exterior door.
3. The owner shall place an equipment door key in a lock box accessible to the Fire Department and the utility server on or near the equipment room door.
4. The equipment room shall be limited to electrical and communication equipment only.
5. No storage shall occur in the electrical equipment room.
6. Electrical equipment rooms shall be vented at a ration of 1 square foot to 150 square feet of floor area when ducts do not provide conditioned air.

Section 250.50 Amend section to read:

In new construction item 250.52 (A) (3) shall be required for the grounding electrode system. Each item in 250.52 (A) (1) through (A) (7) shall be bonded together to form the grounding electrode system. In existing building or structures where none of these electrodes are available, one or more of the electrodes specified in 250.52 (A) (4) through (A) (8) shall be installed and used.

Section 250.52 (A) (3) Amend part (A) item (3) to read:

An electrode encased by at least 2 inches of concrete, located within and near the bottom of a concrete foundation or footing that is in direct contact with earth, consisting of at least 20 feet of bare copper conductor not smaller than 4 AWG.

Section 334.10 Amend section to read:

Type NM, Type NMC and Type NMS cables shall be permitted to be used in residential uses as defined in article 100:

Section 334.10 (3) Amend to delete item (3)

Section 680.26(B)(2)(a) Amend entire section to read:

Structural reinforcing steel. Structural reinforcing steel shall be provided at 24" o.c. each way and connected to the pool, spa or hot tub shell at four equal points along the perimeter. Structural reinforcing steel shall be bonded in accordance with 680.26(B)(1)(a).

Section 680.26(B)(2)(1) Amend entire section to read:

At least one minimum 8 AWG bare solid copper conductor shall be provided. Such conductor shall be connected to the pool, spa or hot tub conductive shell at four equal points along the perimeter. For non-conductive pool shells, bonding at four points shall not be required. Connections shall be made as required by 680.26(B).

Section 690.14 C (1) Amend to read:

The photovoltaic disconnecting means shall be installed at a readily accessible location outside of a building or structure nearest the point of entrance of the system conductors.